
REAR ELEVATION

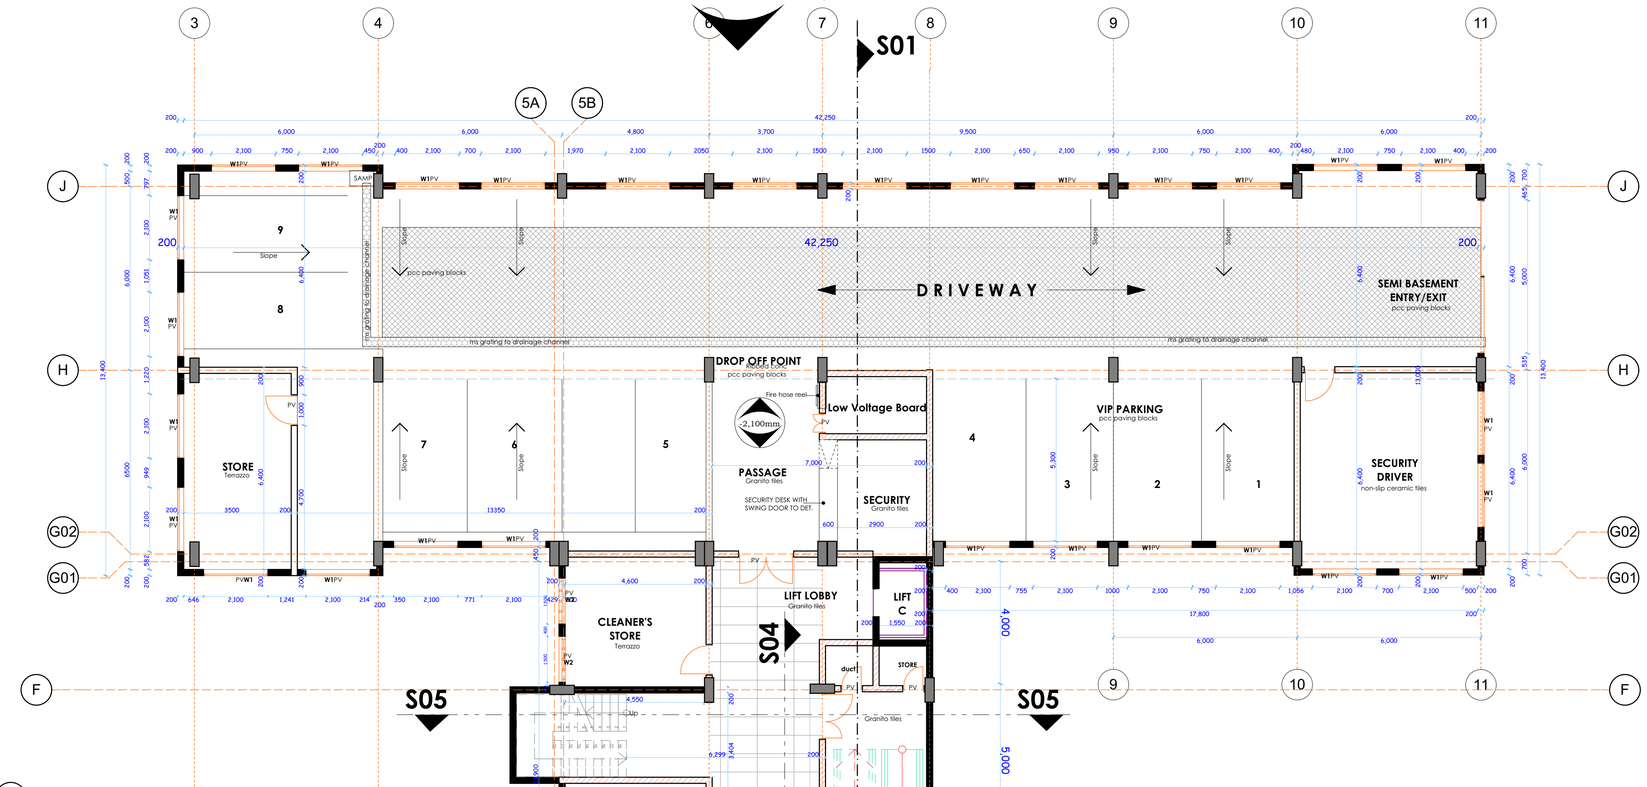

LEVEL ONE: SEMI-BASEMENT

FRONT ELEVATION

SIDE B ELEVATION

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding,on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete somound. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
LEVEL ONE : SEMIBASEMENT

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:100
	2	
	3	

project job no. Job No. 9951 A — **Drawing no.** L (001)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
	Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

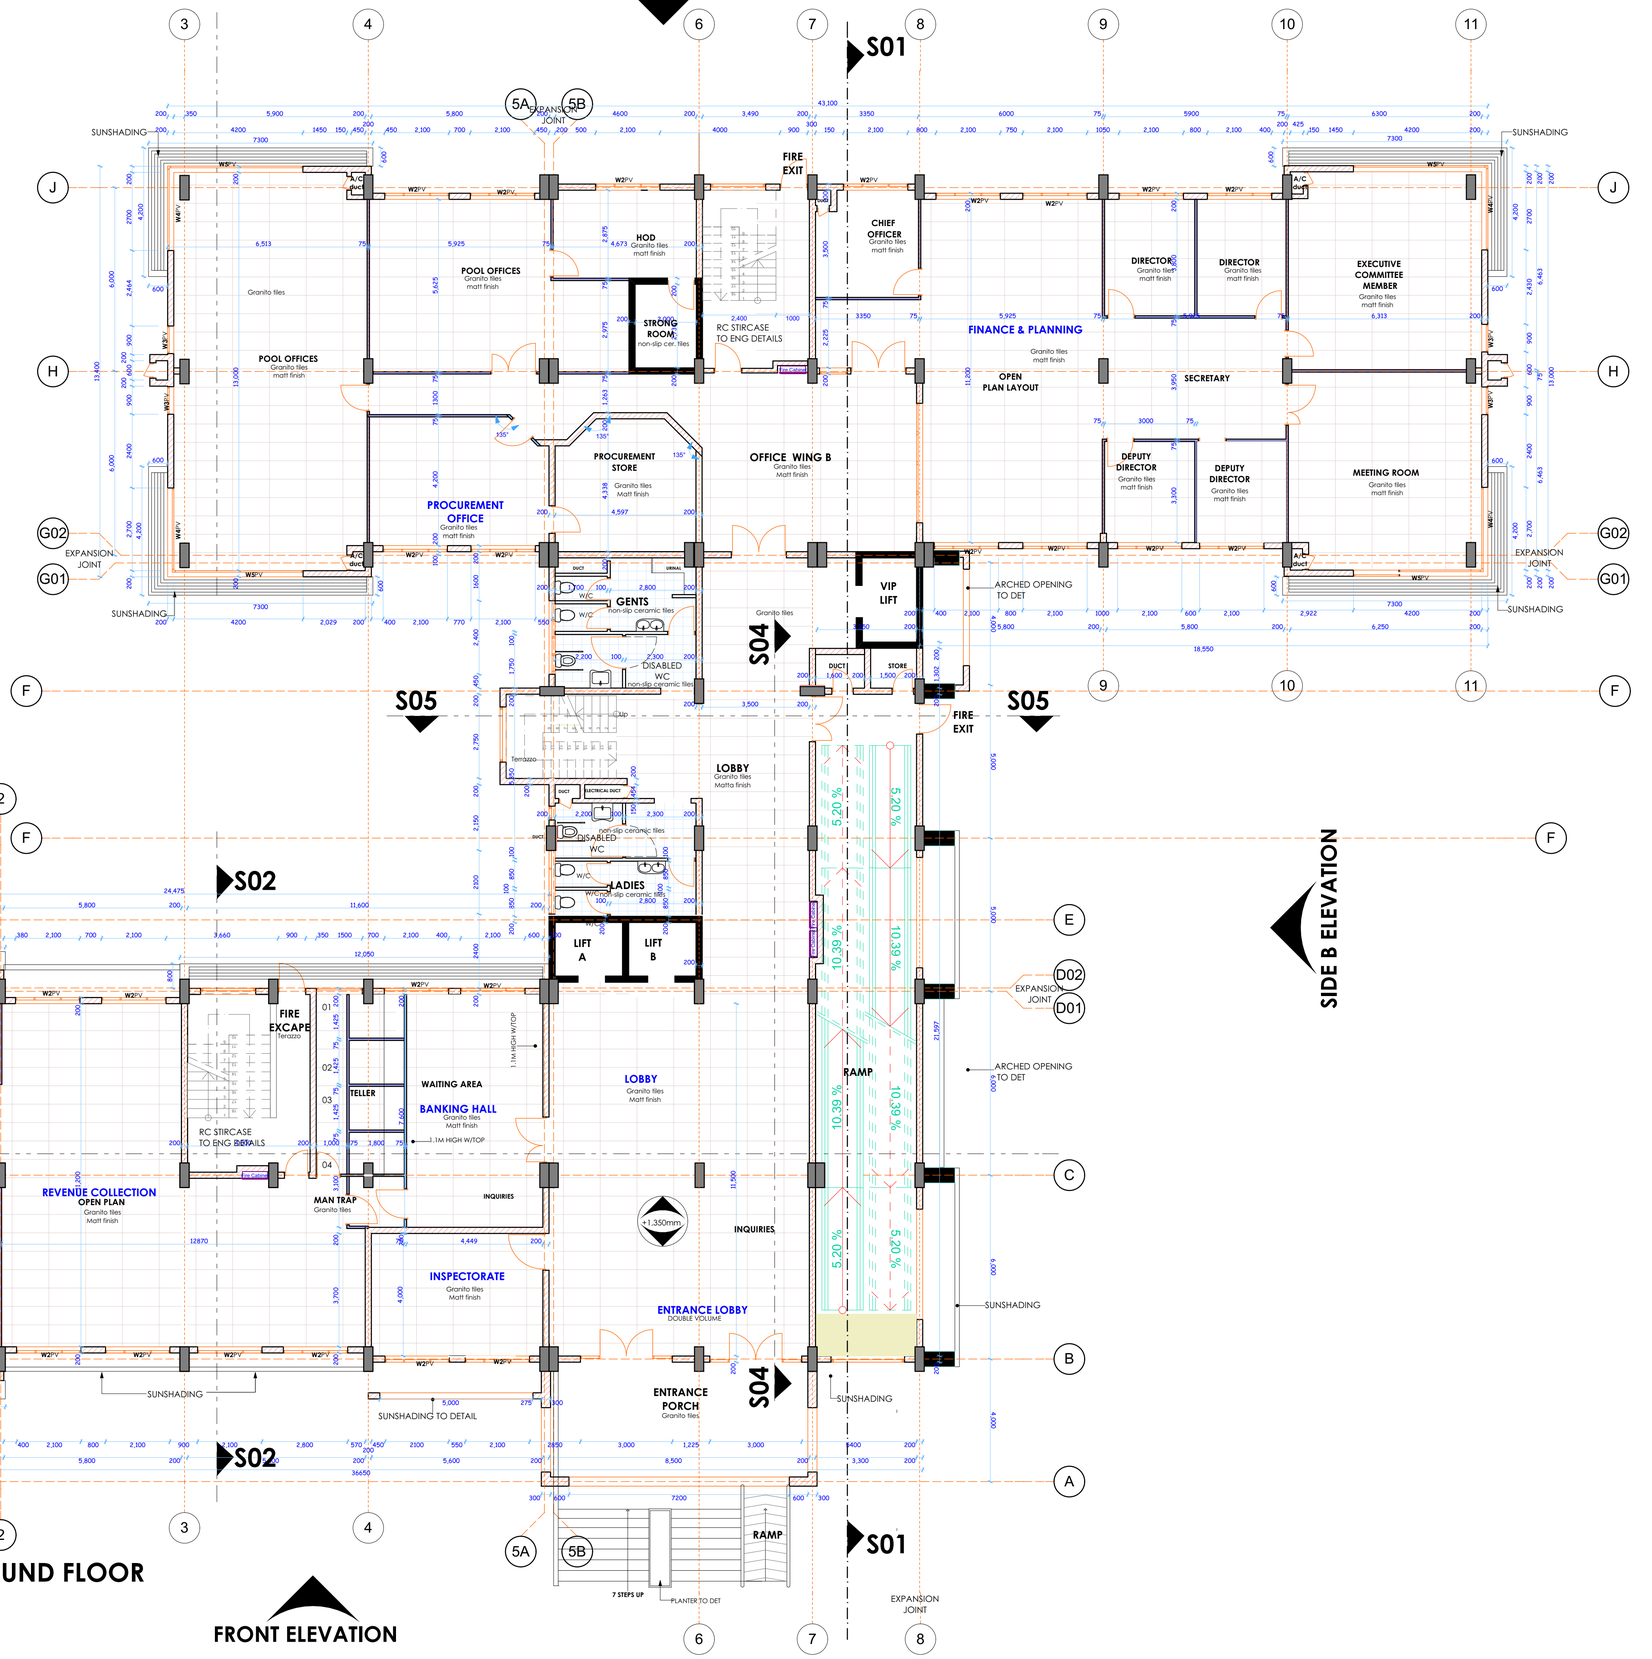

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete surround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\/Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
LEVEL TWO : GROUND FLOOR

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	
	2	
	3	

project job no. Job No. 9951 A — **Drawing no.** L (002)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
	Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

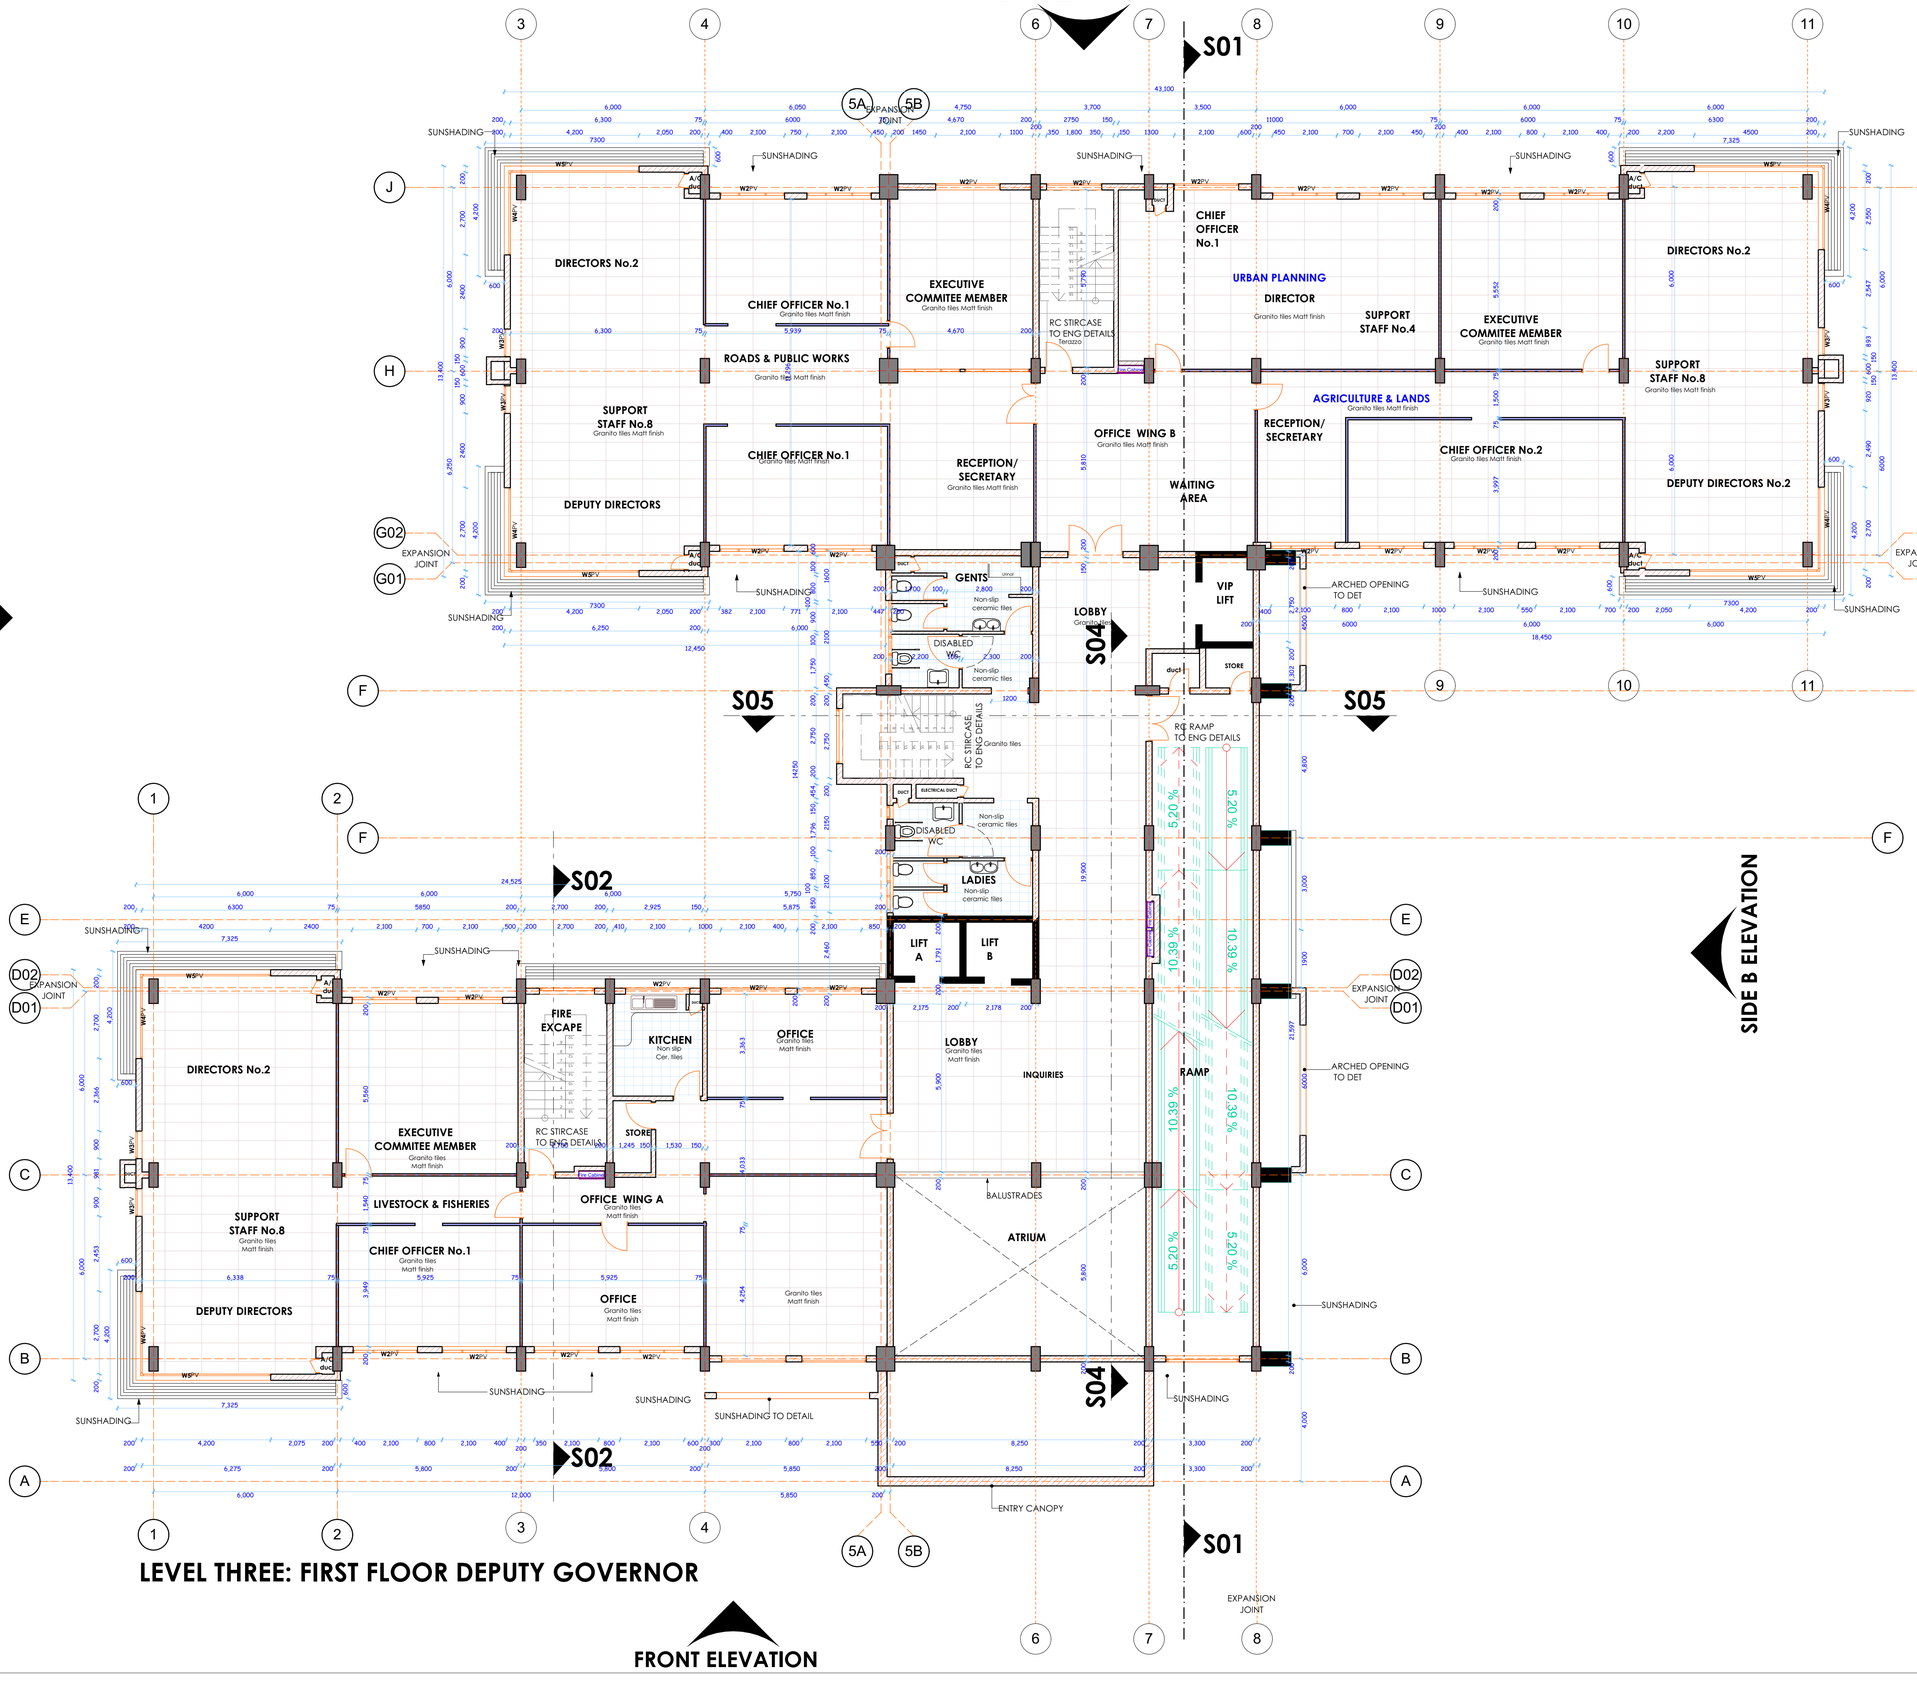

LEVEL THREE: FIRST FLOOR DEPUTY GOVERNOR

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\/Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
LEVEL THREE : 1st FLOOR

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:100
	2	
	3	

project job no. Job No. 9951 A — **Drawing no.** L (003)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

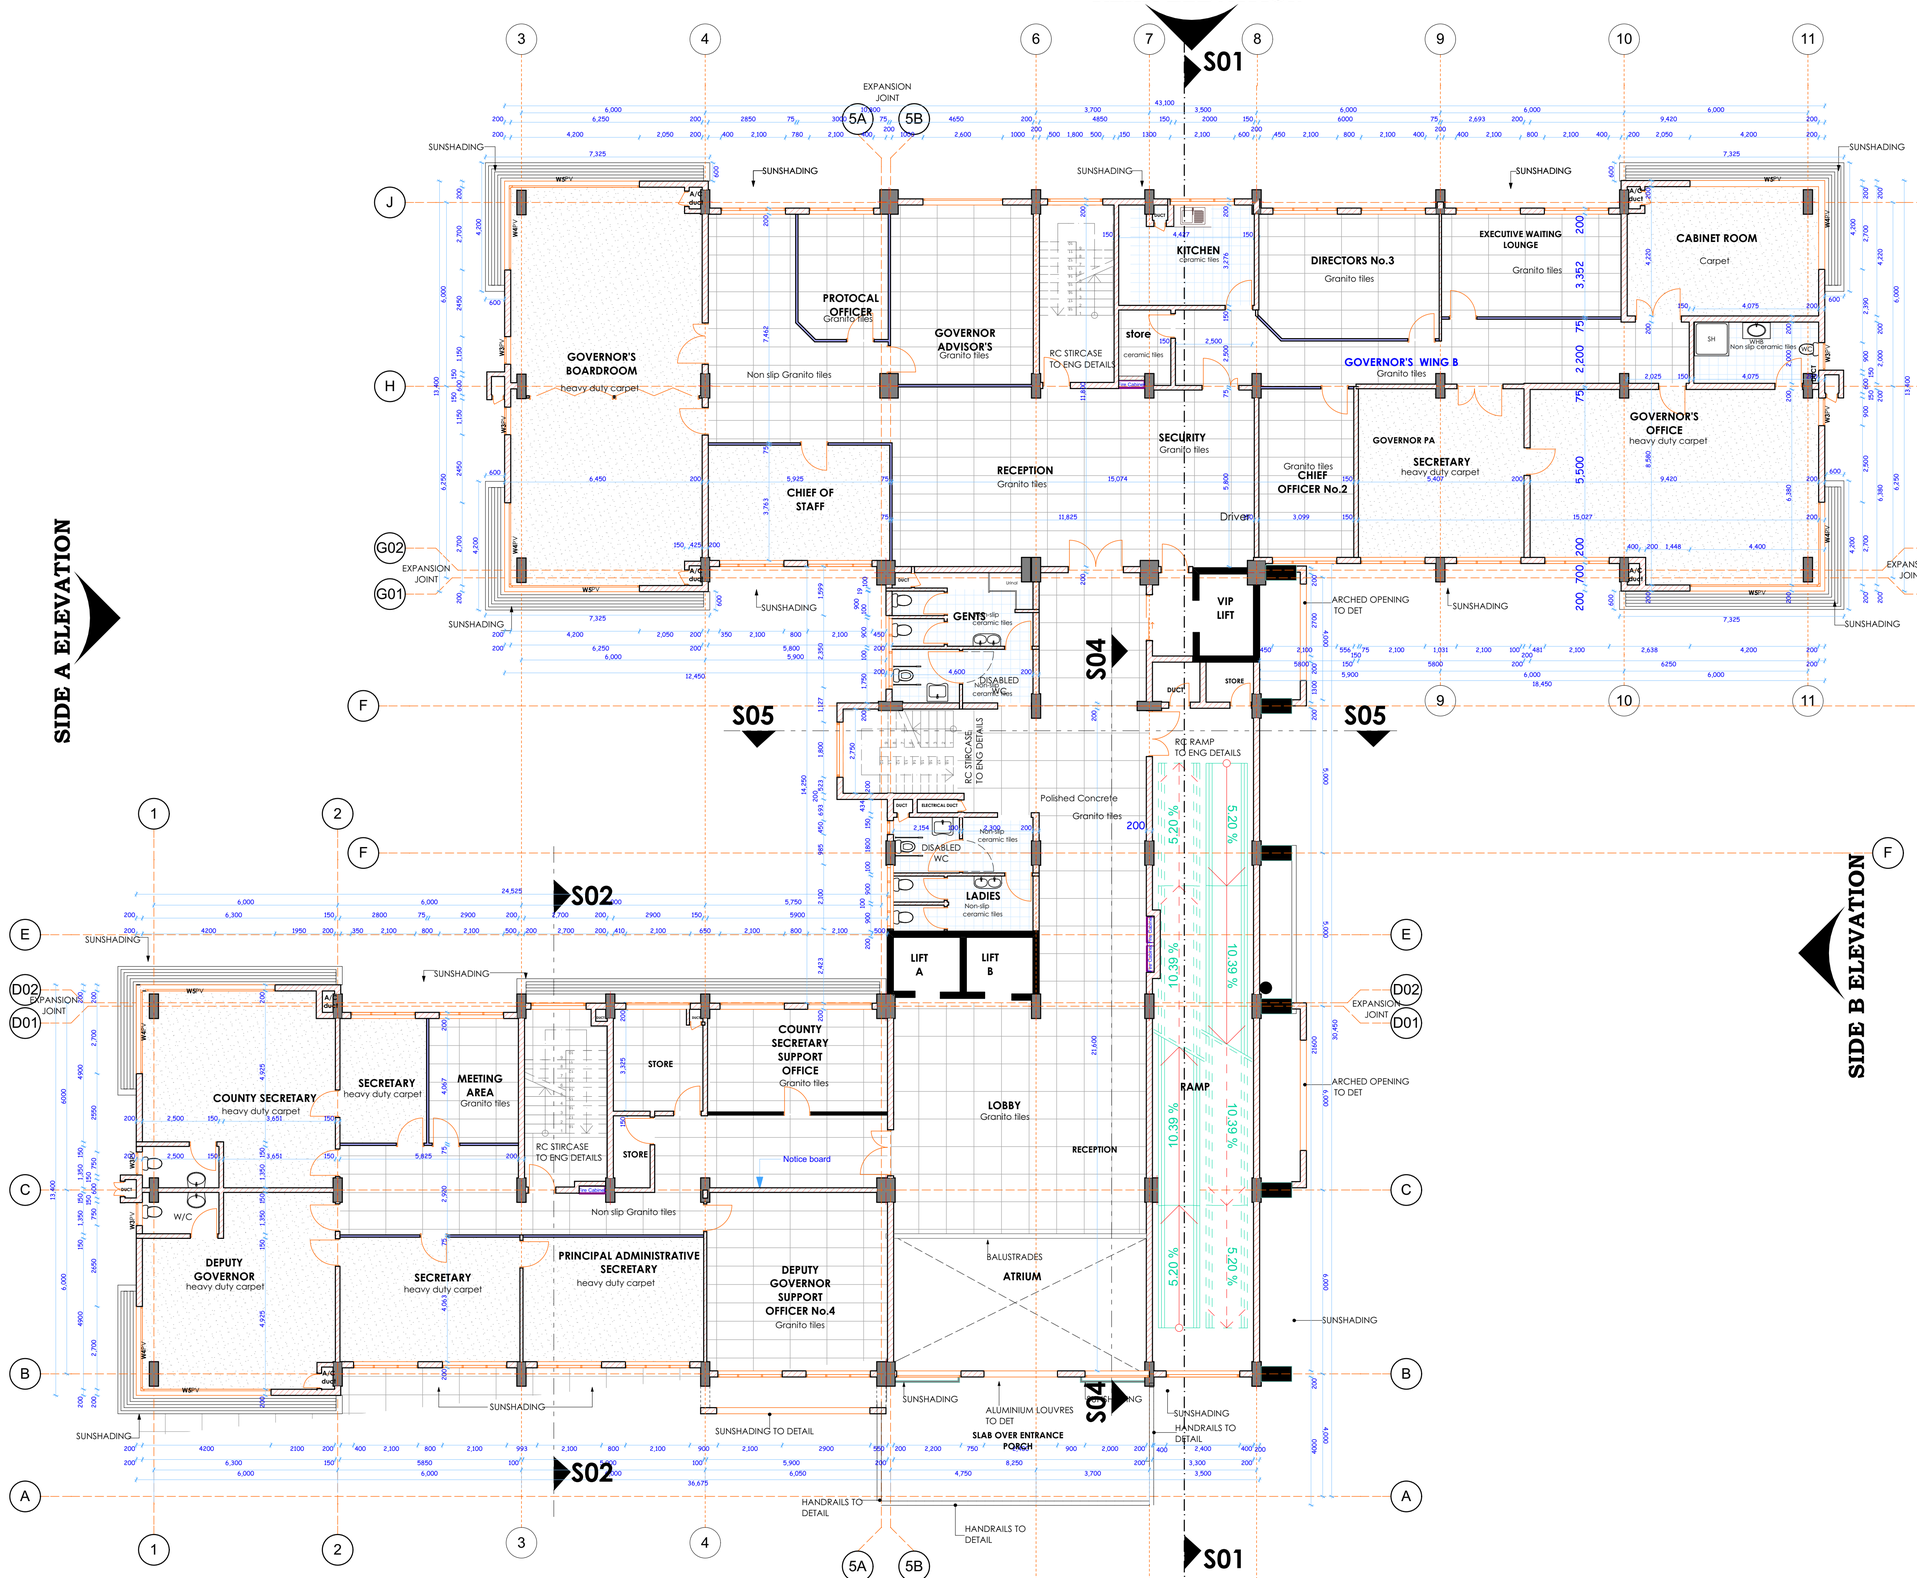

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS3255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\/Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
LEVEL FOUR : SECOND FLOOR

Folio no.
D103 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:100
	2	
	3	

project job no. Job No. 9951 A
Drawing no. L (004)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

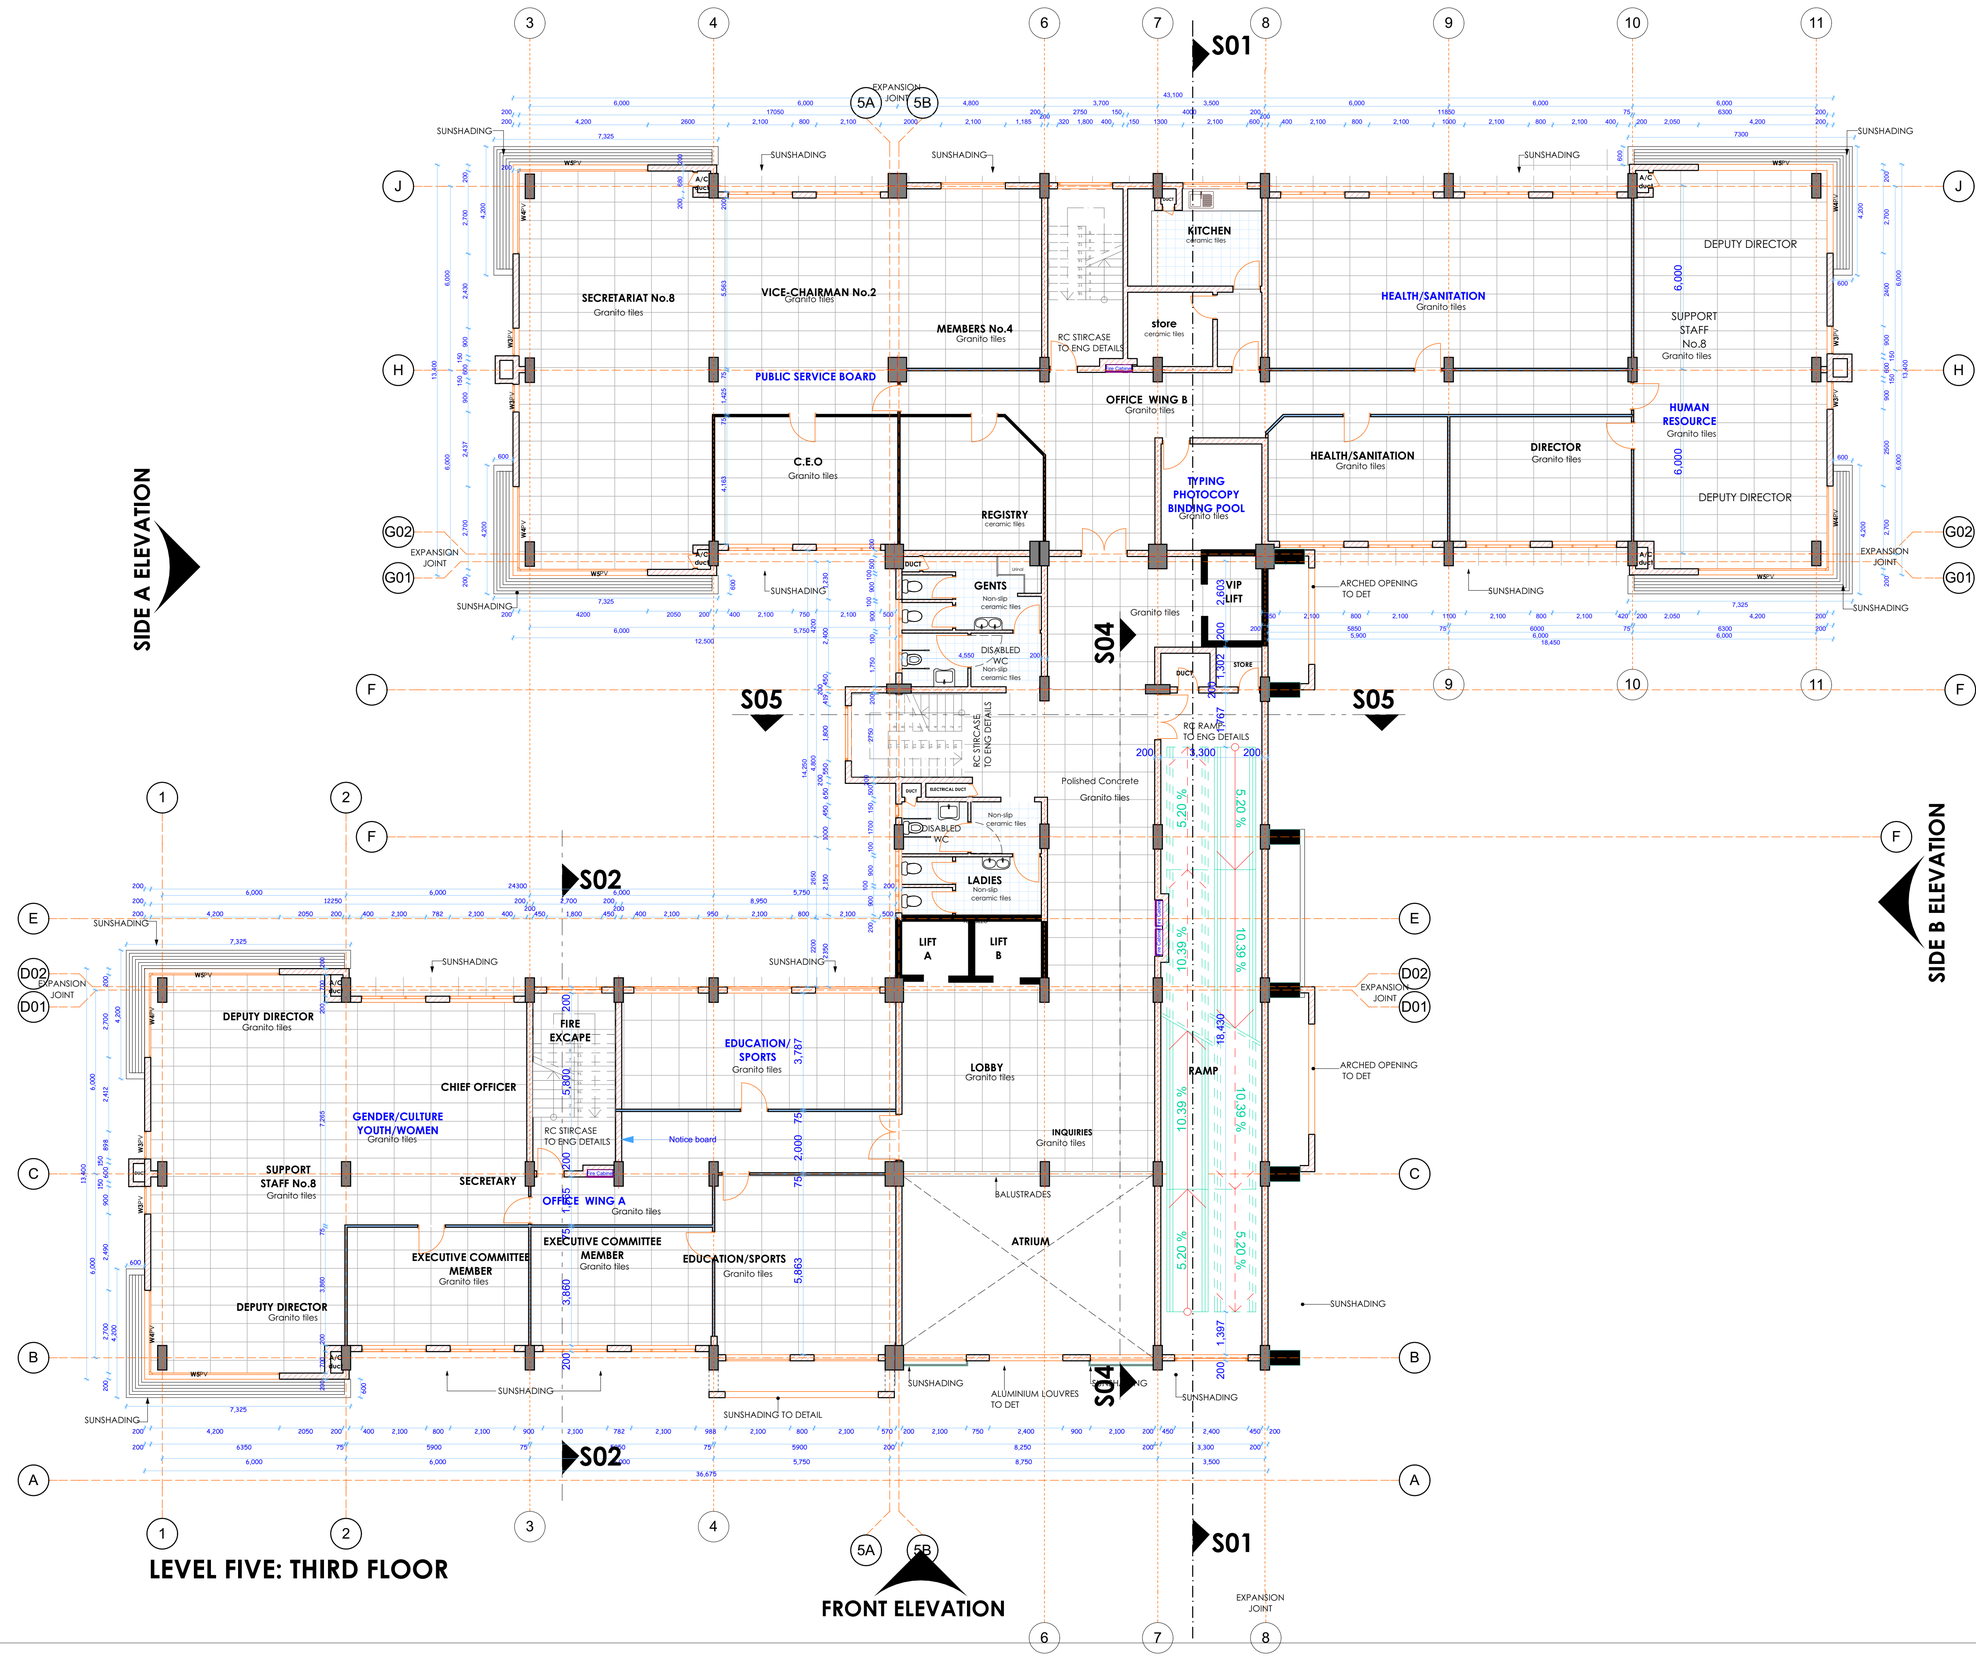

LEVEL FIVE: THIRD FLOOR

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
LEVEL FIVE : THIRD FLOOR

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A

Drawing no. L (005)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

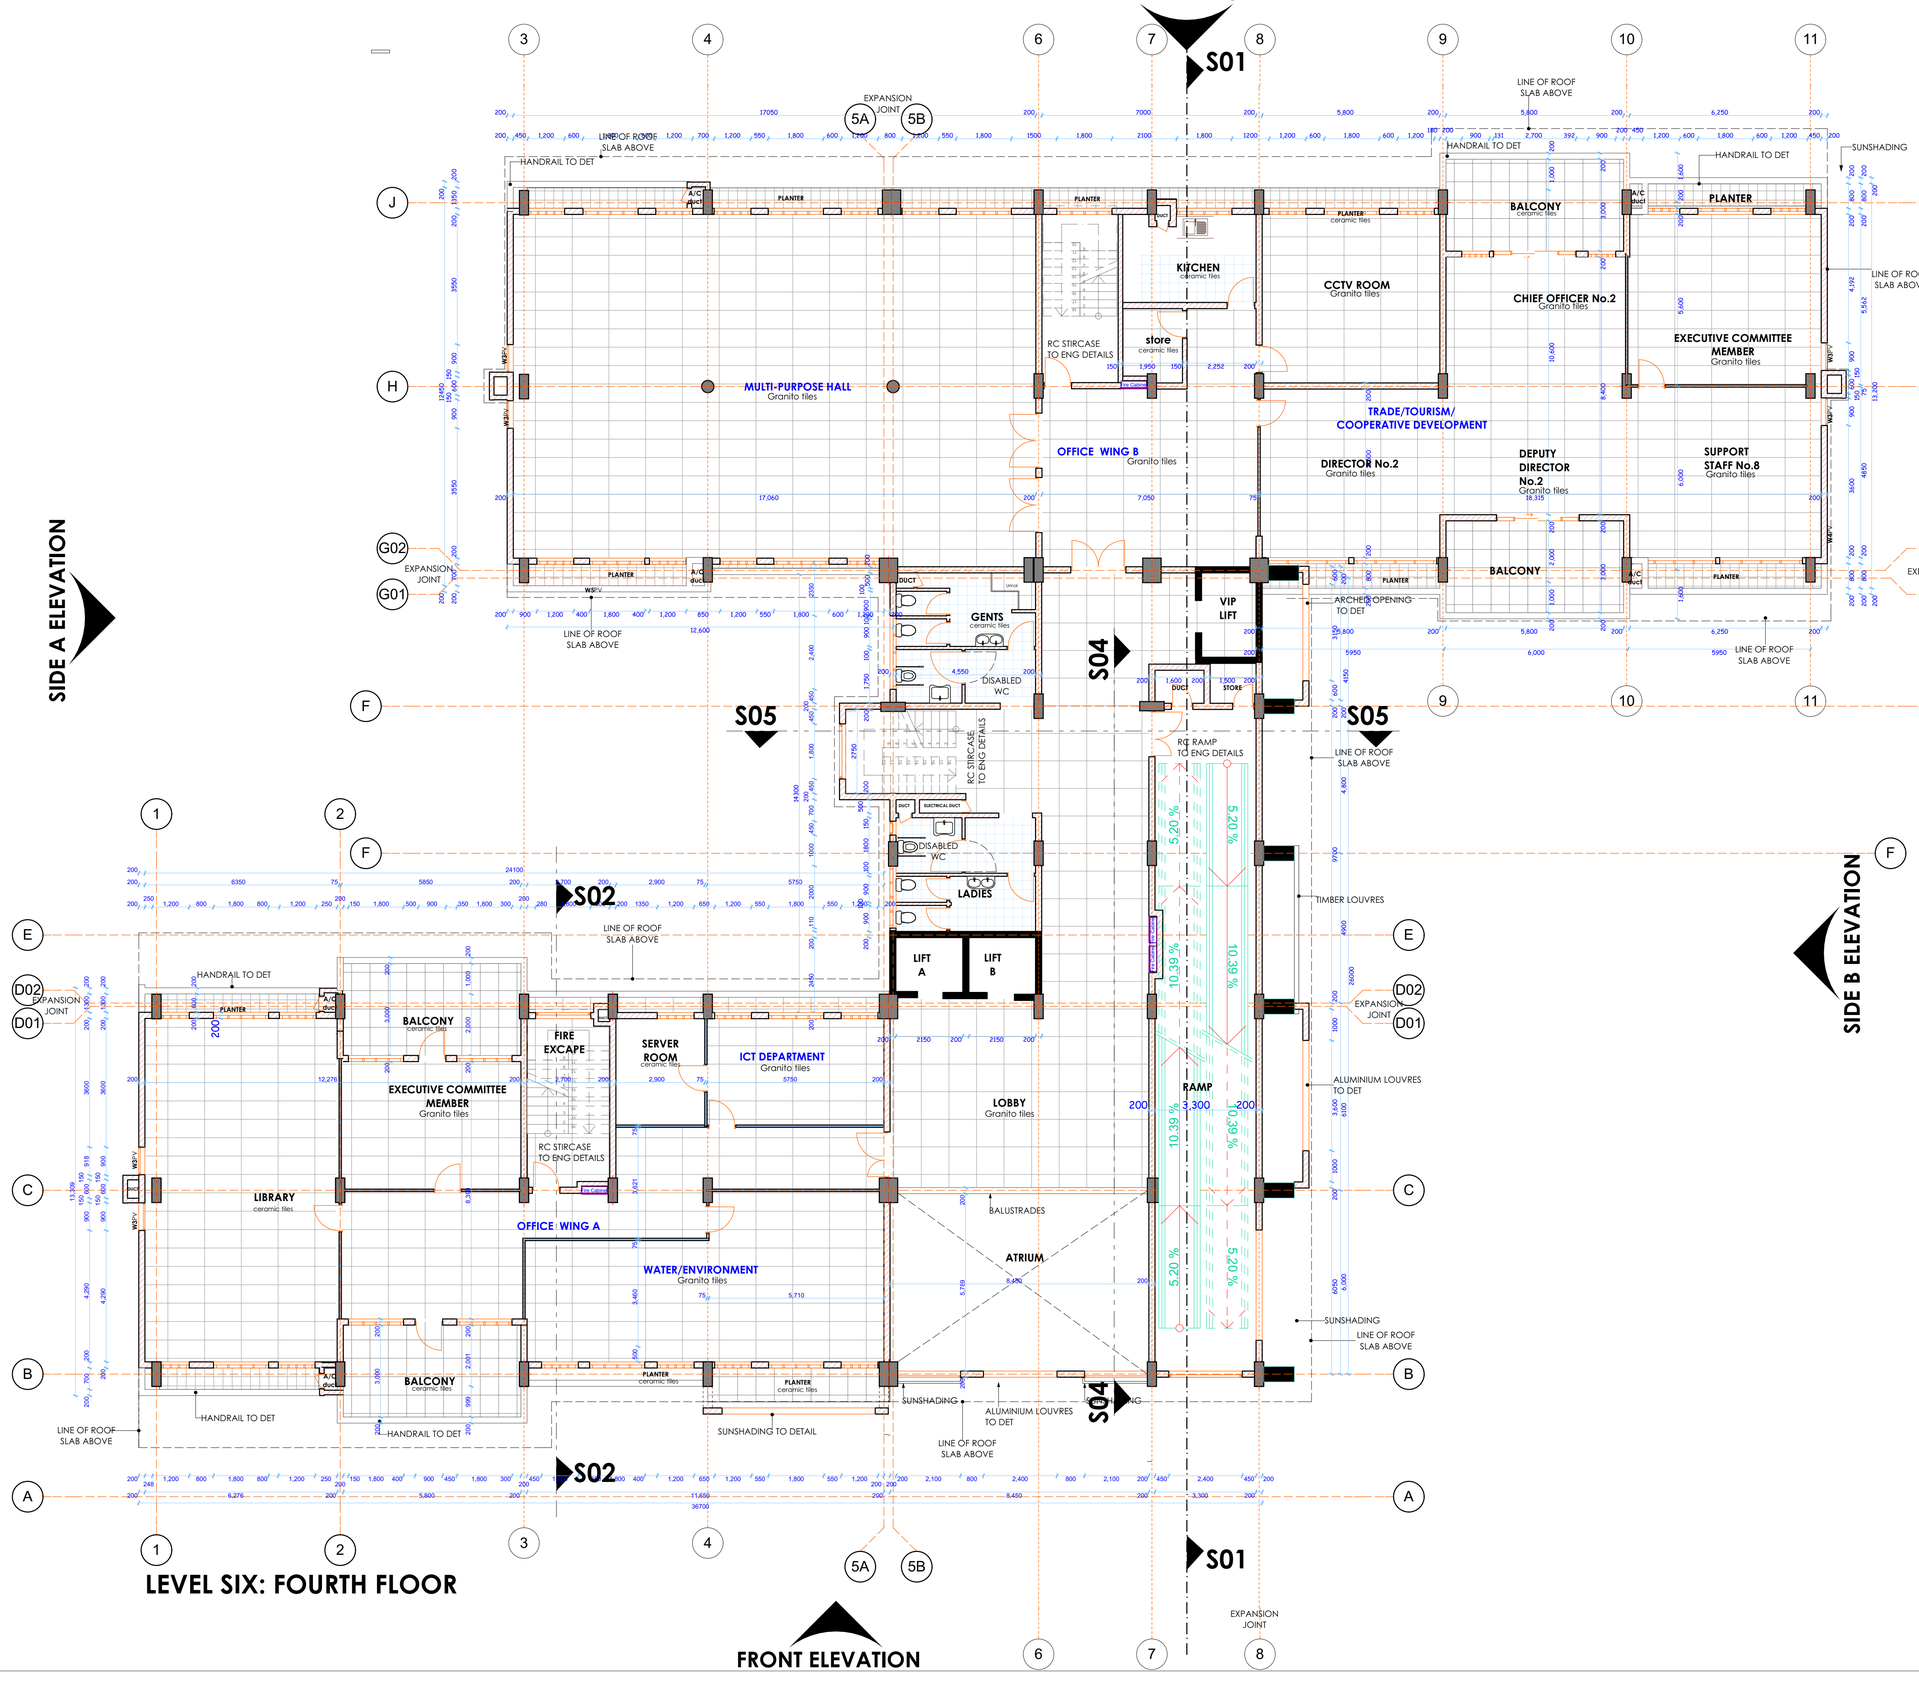

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All hesting of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\/Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
LEVEL SIX : 4th FLOOR

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale	1	1:100
	2	
	3	

project job no. Job No. 9951 A — **Drawing no.** L (006)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

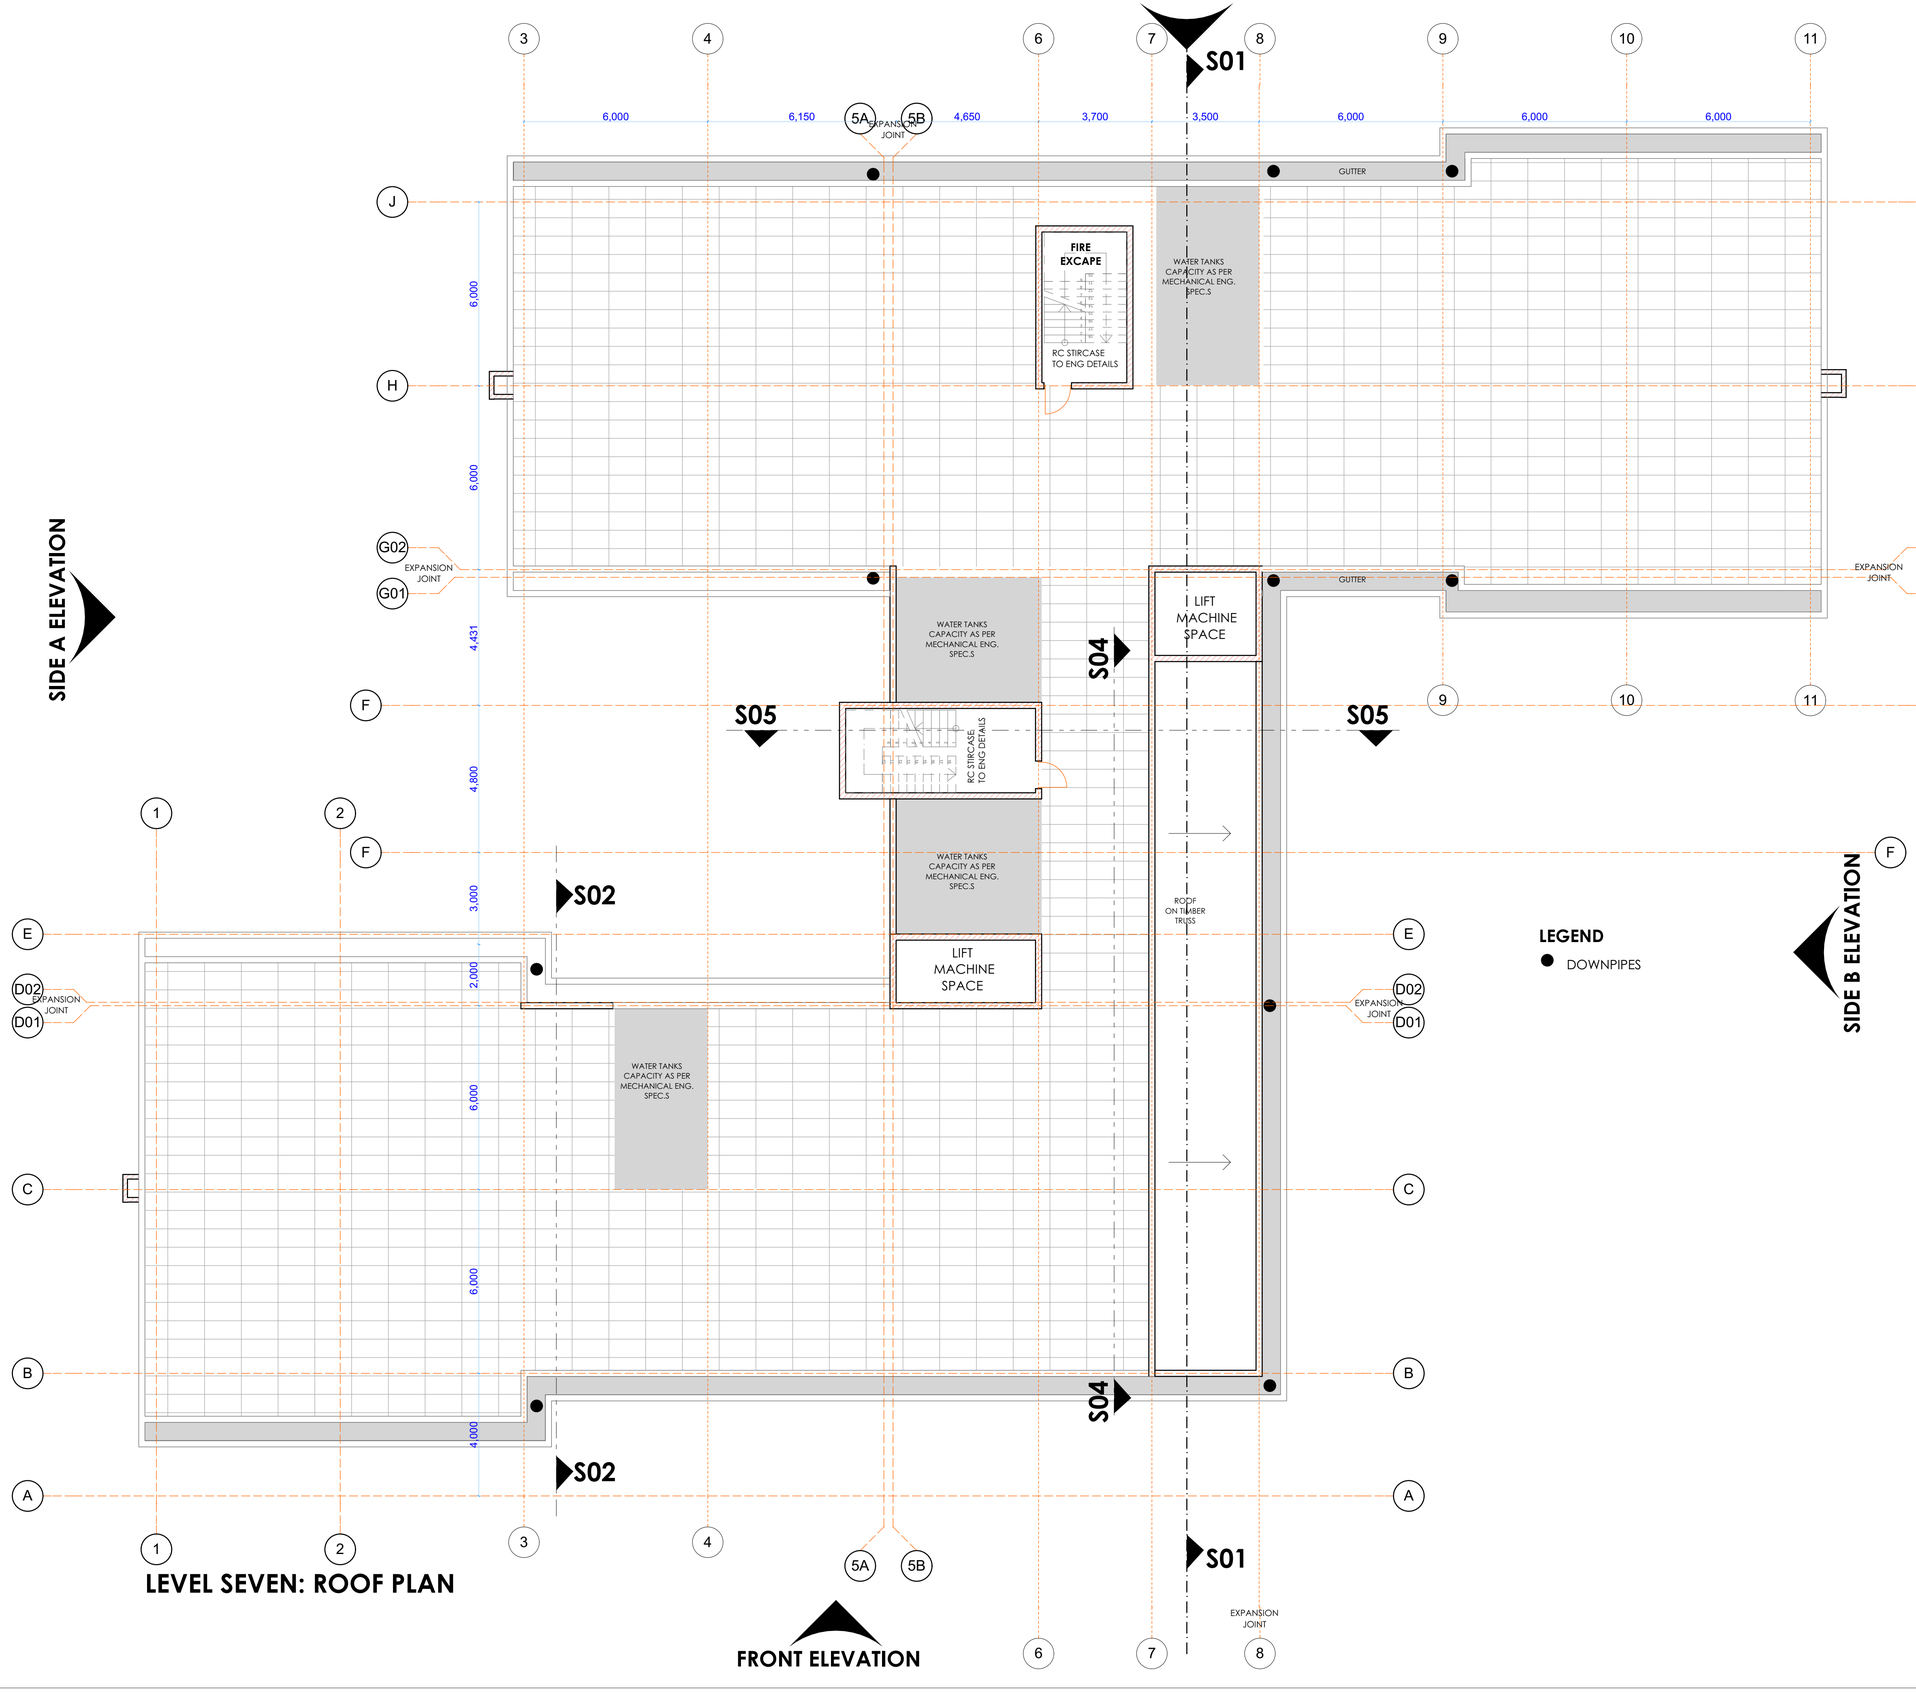

LEVEL SEVEN: ROOF PLAN

LEGEND

- DOWNPIPES

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect. or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
ROOF LAYOUT PLAN

Folio no.
D103 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:100
	2	
	3	

project job no. Job No. 9951 A — **Drawing no.** L (00)


	name	signed	date
Drawn & Designed by	Arch Hellen J.M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

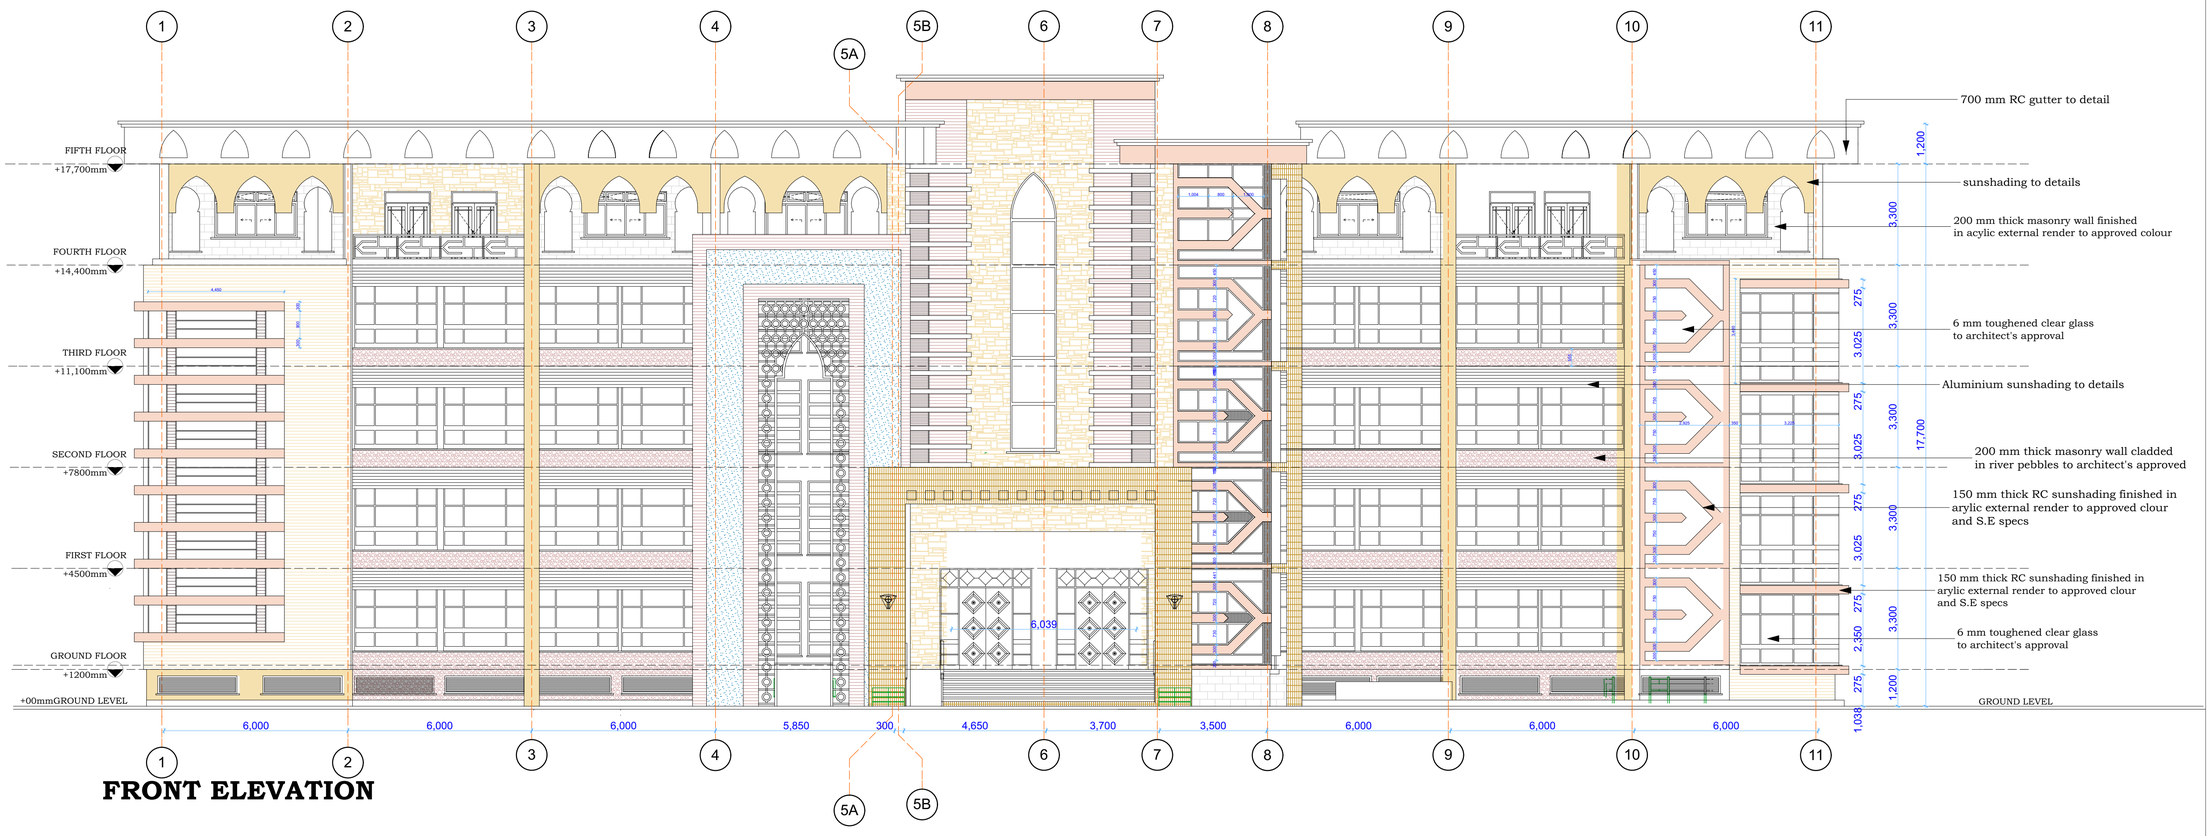

FRONT ELEVATION

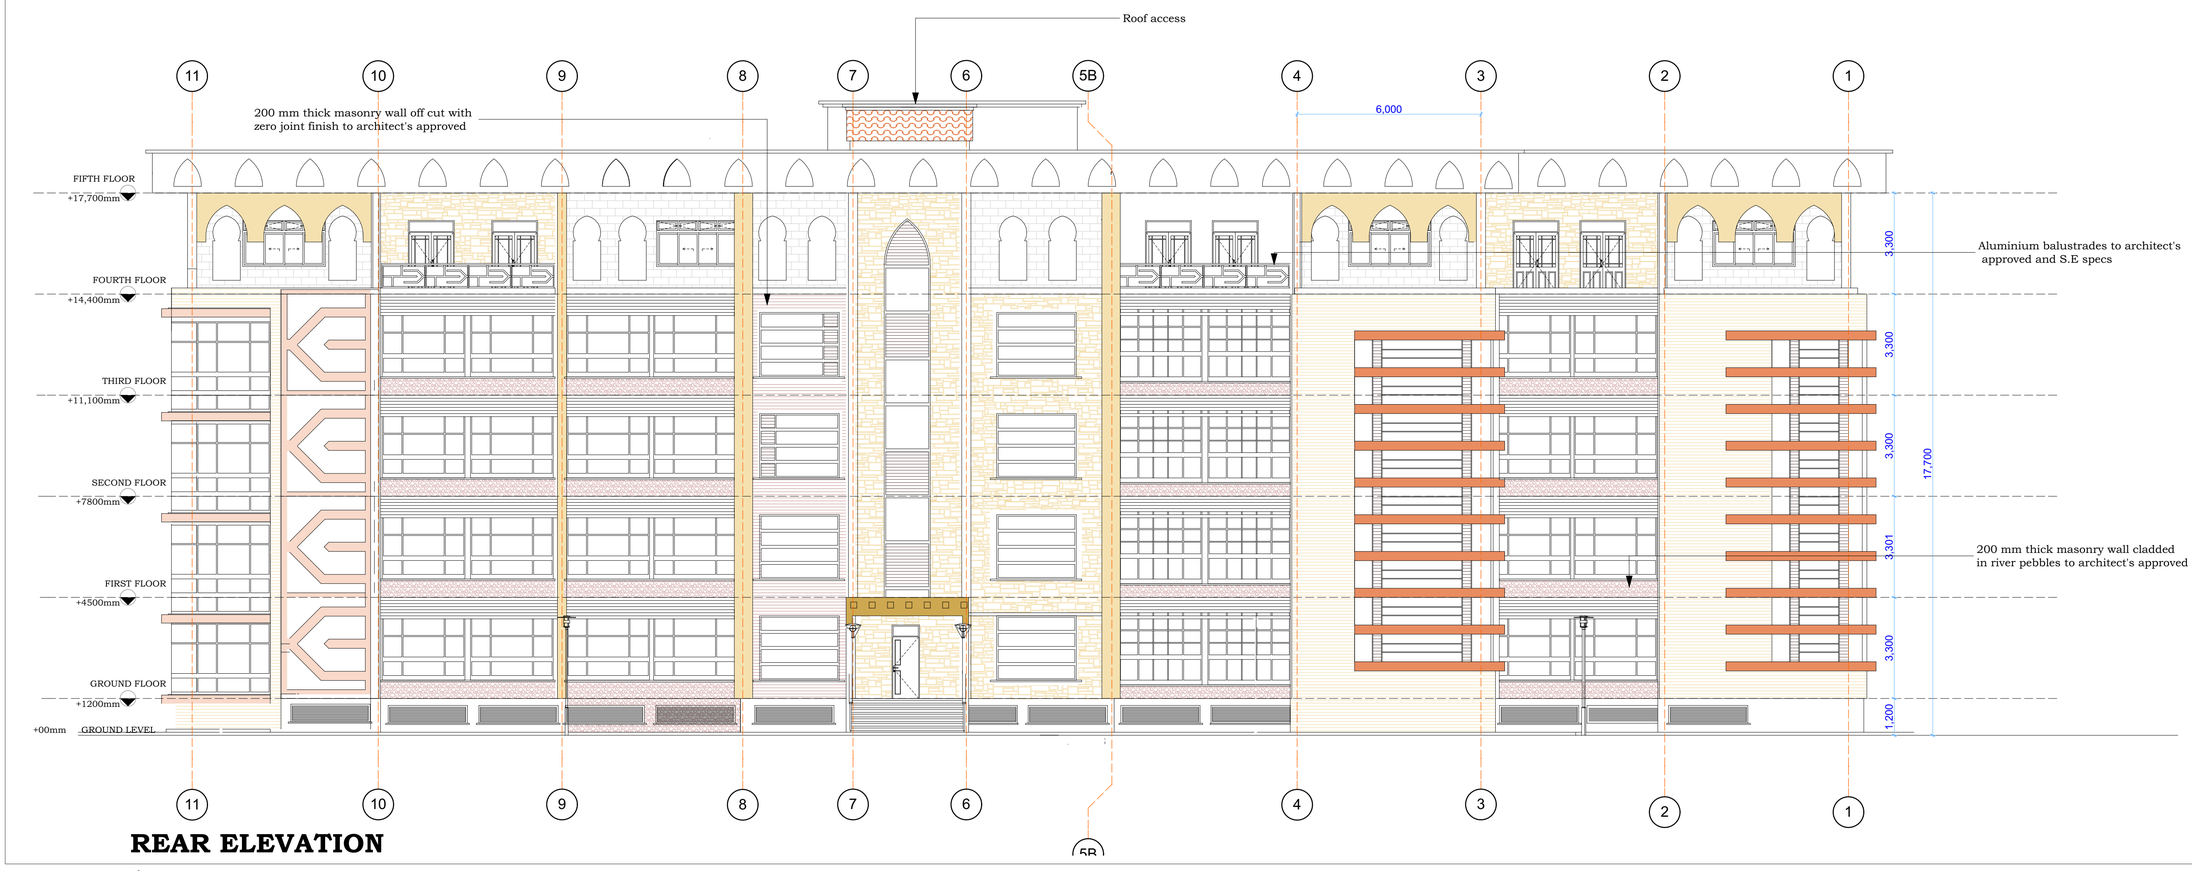

REAR ELEVATION

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS3255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project

PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title

ELEVATIONS

Folio no.

D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department

TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A

drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

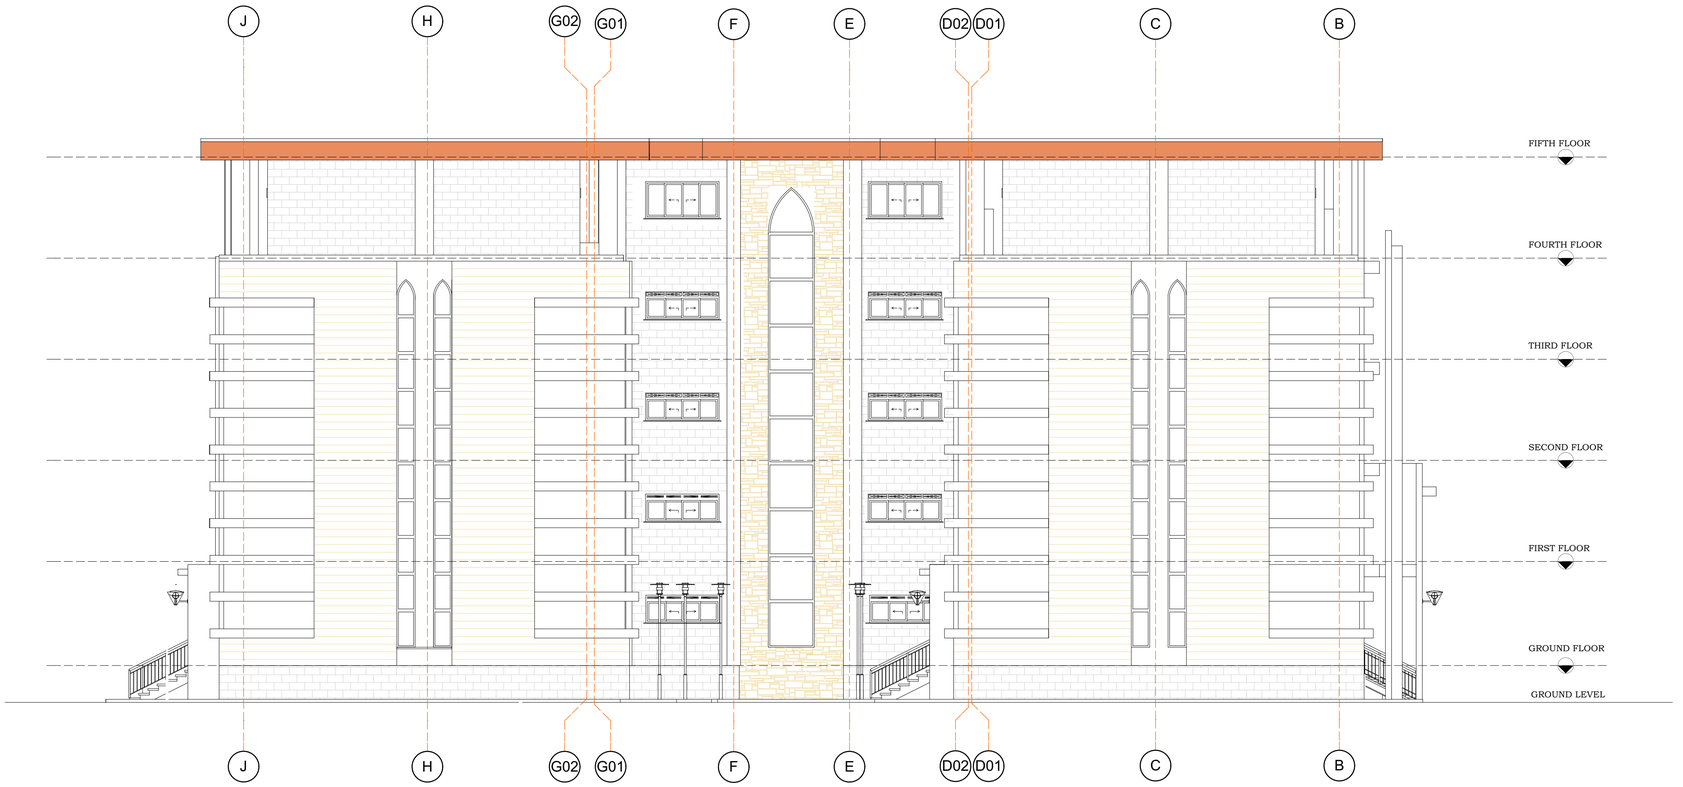

SIDE A ELEVATION

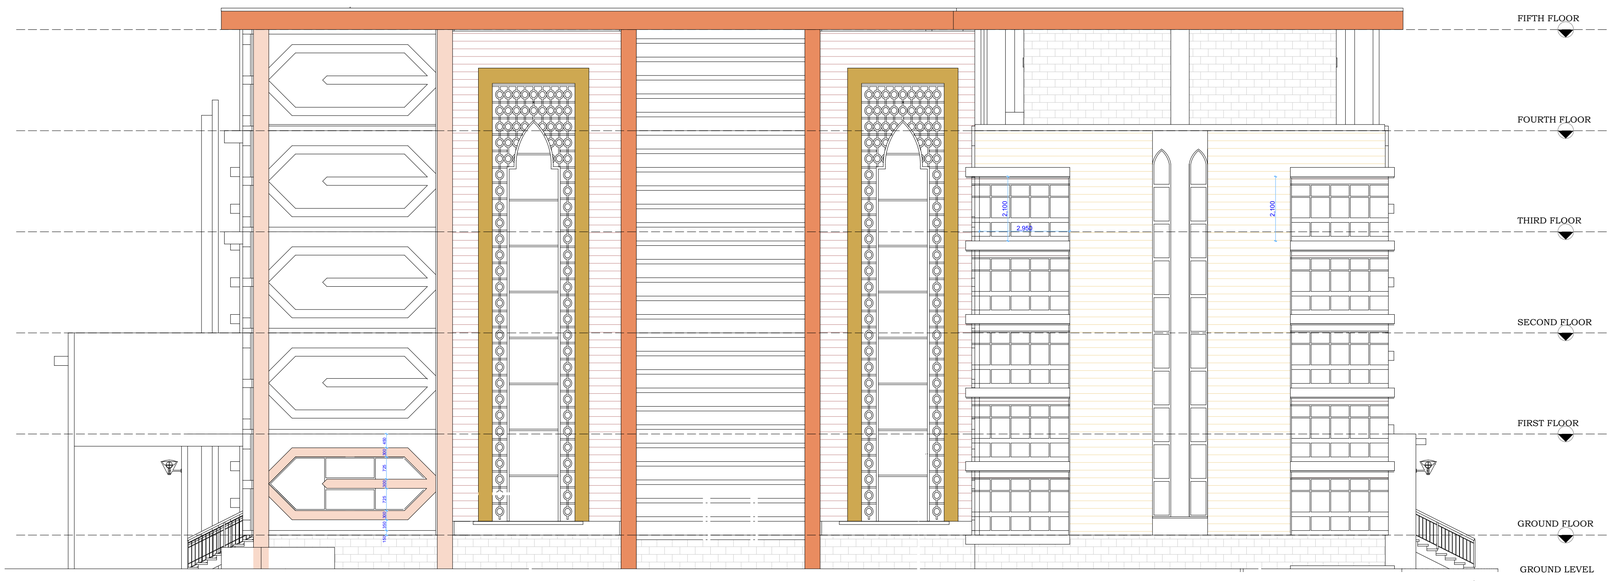

SIDE B ELEVATION

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete surround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project

PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title

ELEVATIONS

Folio no.

D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department

TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

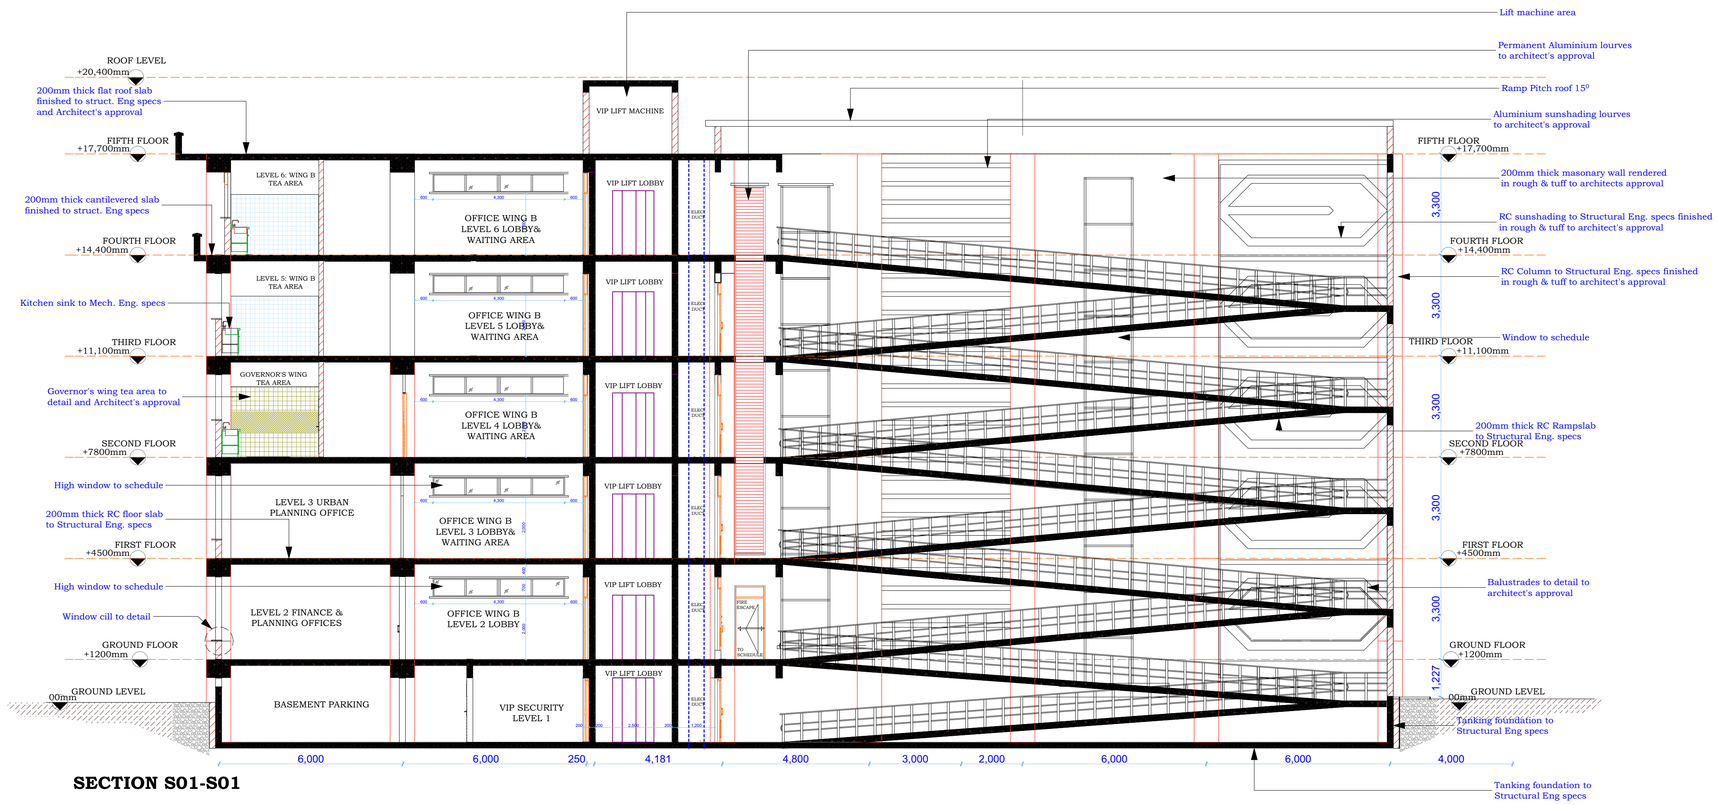

SECTION S01-S01

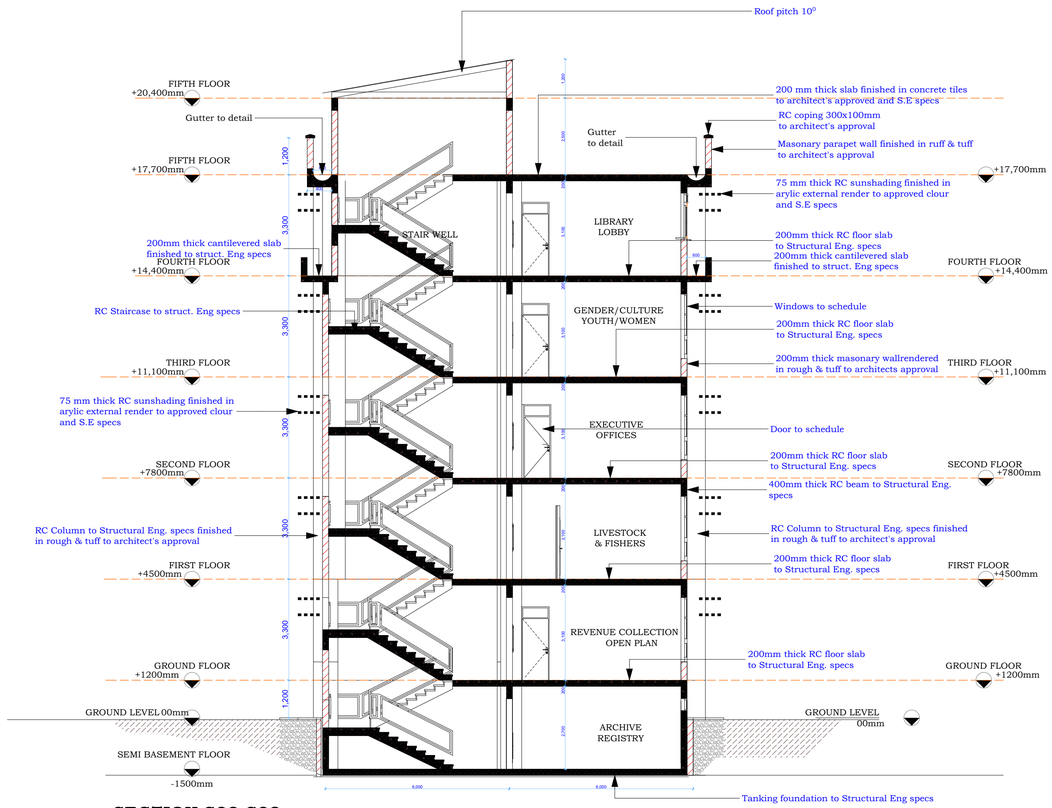

SECTION S02-S02

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project

PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title

SECTIONS

Folio no.

D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department

TANA RIVER COUNTY

client signature

code

scale		
	1	1:100
	2	
	3	

project job no.	drawing no.
Job No. 9951 A	

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT

STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

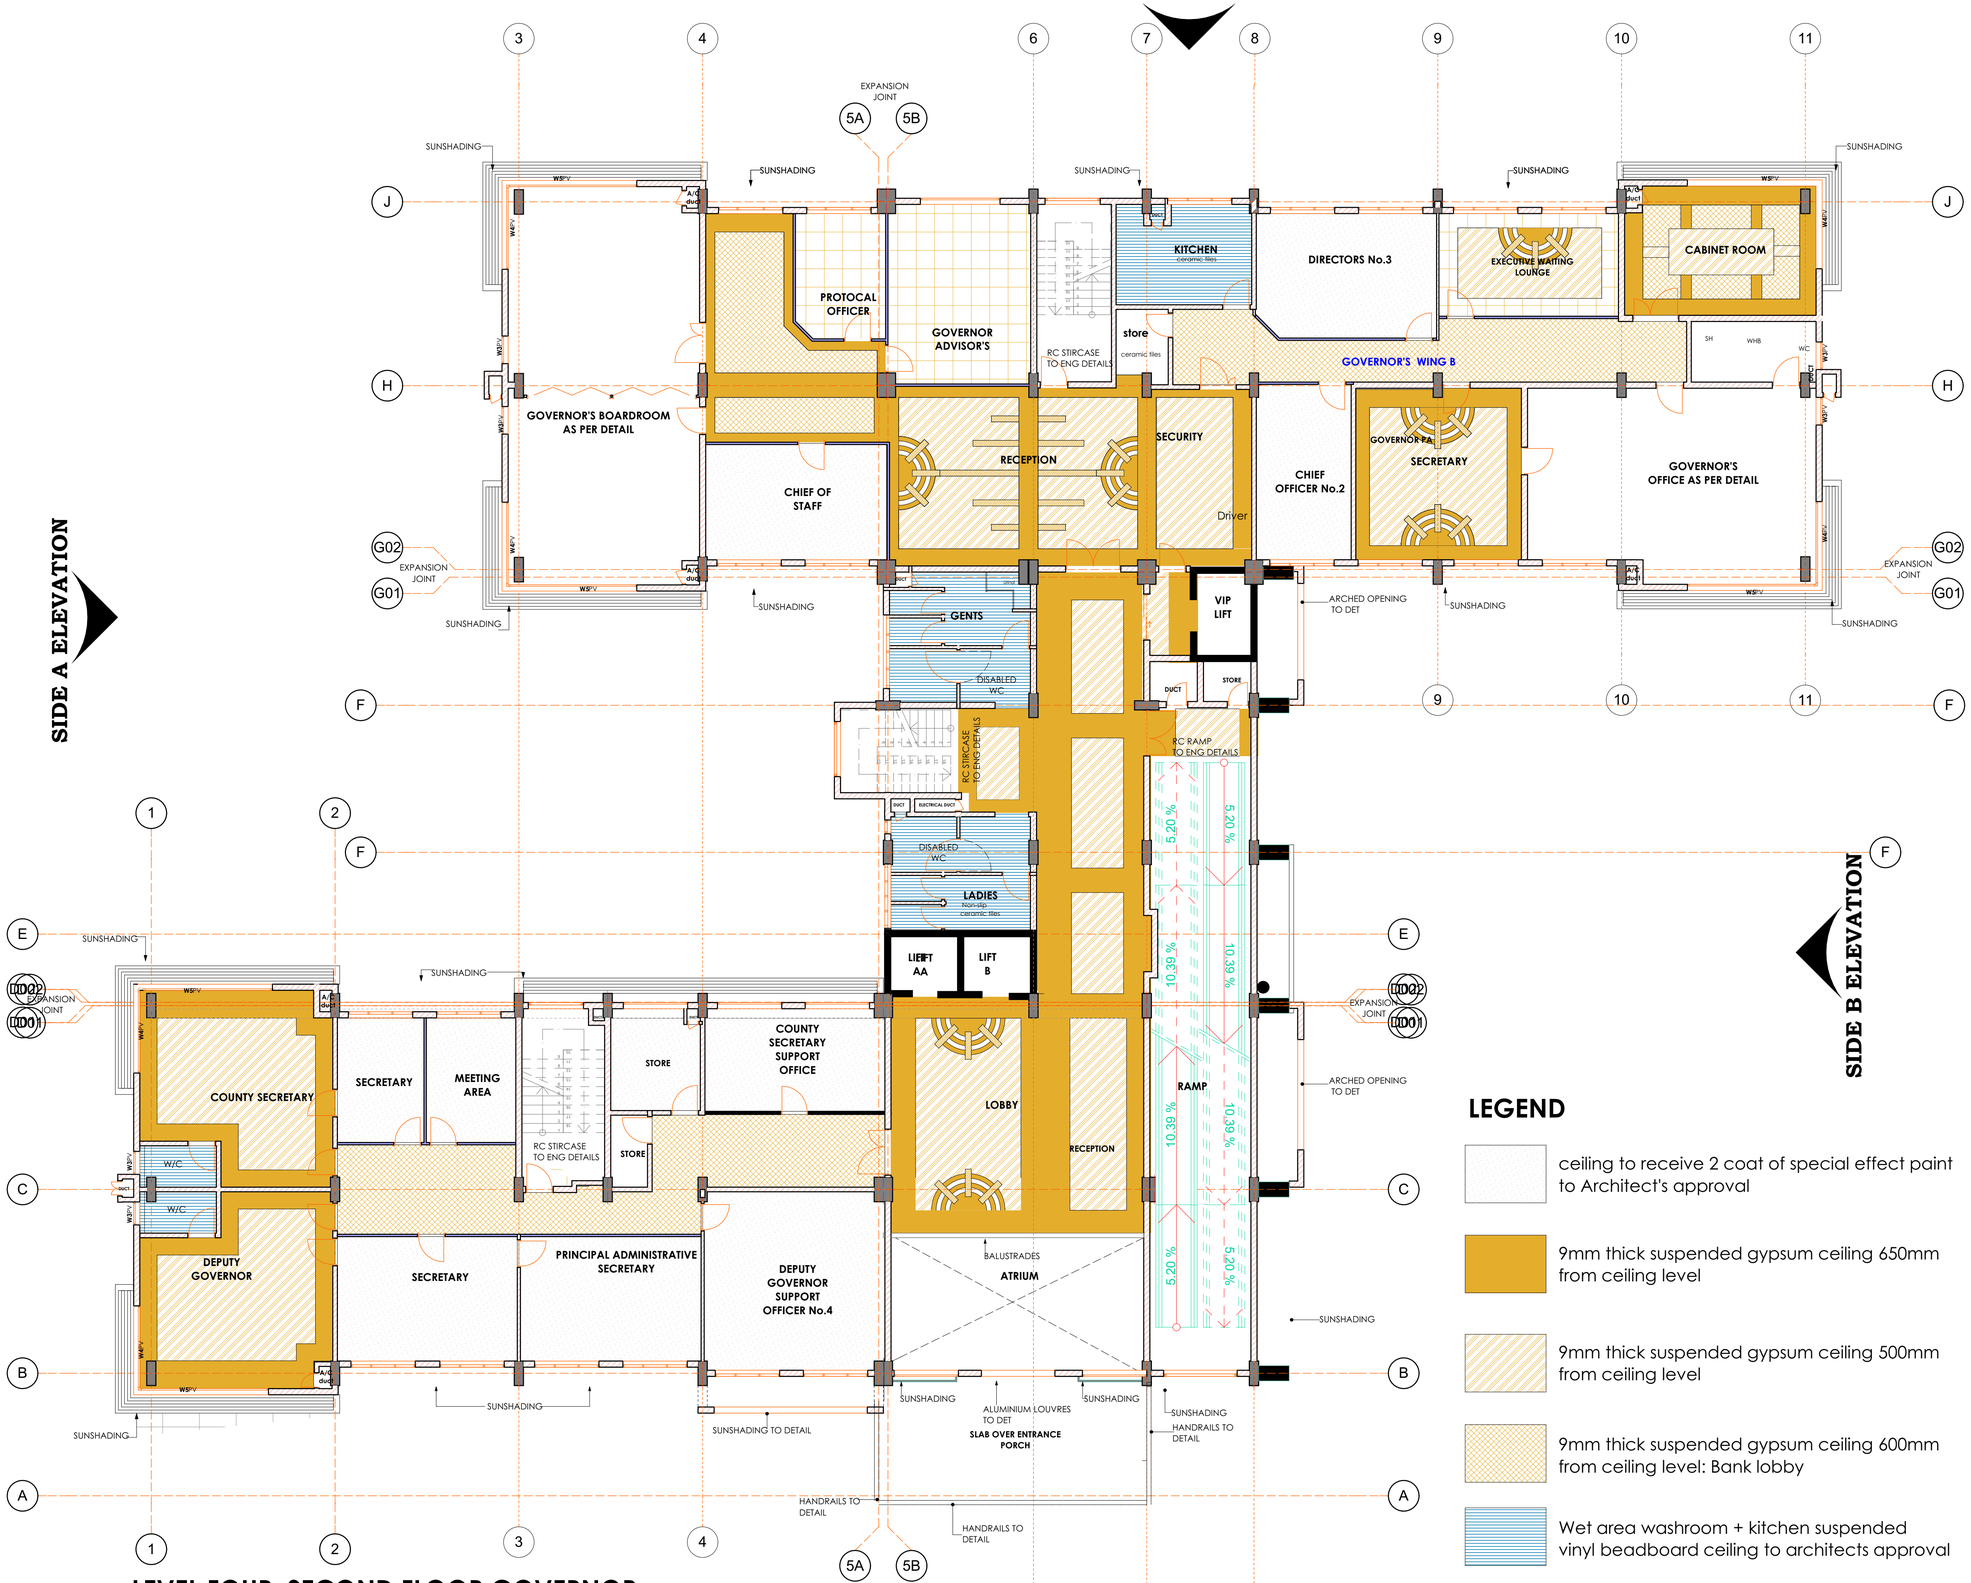

LEVEL FOUR: SECOND FLOOR GOVERNOR REFLECTED CEILING

LEGEND

- ceiling to receive 2 coat of special effect paint to Architect's approval
- 9mm thick suspended gypsum ceiling 650mm from ceiling level
- 9mm thick suspended gypsum ceiling 500mm from ceiling level
- 9mm thick suspended gypsum ceiling 600mm from ceiling level: Bank lobby
- Wet area washroom + kitchen suspended vinyl beadboard ceiling to architects approval

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
SECOND FLOOR LEVEL 4 REFLECTED CEILING

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 1:100; 2; 3

project job no. Job No. 9951 A **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		







APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES: DOOR SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	LOCATION	QUANTITY: PER LEVEL							REMARKS
					1	2	3	4	5	6	TOTAL	
DO1	ROLLER SHUTTER **FINISH**		Provide 60mm tri-circle padlock	SEMI-BASEMENT	2						2	ROLLER SHUTTER GRILL DOOR AS PER MANUFACTURERS DETAIL SUBJECT TO ARCHITECT'S APPROVAL
DO2	STEEL DOOR + GLAZING + GRILLS SINGLE SWING **FINISH**		Steel door Hollow section frame door handle Mortice lock Hinges Signage	STORE	4	3	0	0	2	1	**10**	STEEL CASEMENT DOOR FABRICATED AND FIXED TO ARCHITECT'S DETAILS Standard steel casement door comprising 40x25x3mm stiles, bottom & top rail, & 4 no intermidiate rails all primed with red oxide complete with hinges, stays fasteners, permanent vent with mosquito bet gauze.
DO2A	STEEL DOOR + GLAZING + GRILLS DOUBLE SWING **FINISH**		Steel door Hollow section frame door handle Mortice lock Hinges Signage	SEMIBASEMENT CIRCULATION CORE	4	1	0	0	0	0	**5**	
DO3	50 mm THICK PANELLED HARDWOOD MAHOGANY DOOR MOULDED BEADING **FINISH** CLEAR VANISH		5 Lever Mortice lock automatic deadlocking 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 No. ss Door closer Signage Tower bolt	CIRCULATION AREA	0	3	3	3	3	5	**17**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead
DO4	FLUSH DOOR 50mm THICK SEMI-SOLID CORE Overall plywood finished for painting **FINISH**		2 Lever Mortice lock 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 No ss door closer Signage Tower bolt Kickplate	ENTRANCEVWET AREA KITCHEN	2	2	2	2	2	2	**12**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead Fan light area fix clear glass 6mm thick
DO4A	FLUSH DOOR 50mm THICK SEMI-SOLID CORE Overall plywood finished for painting **FINISH**		2 lever Mortice lock 2 no. Aluminium pull handle Bearing ss hinges with screws 2 No. ss door closer Robe hook Nickel chain Door guard 2 no. Kickplate	DISABLED W/C	2	2	2	2	2	2	**12**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead Fan light area fix clear glass 6mm thick

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete somound. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect. or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extingushers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
DOOR SCHEDULE 01

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A
drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		







APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES: DOOR SCHEDULE

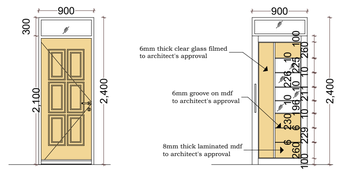SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	LOCATION	QUANTITY: PER LEVEL							
					1	2	3	4	5	6	TOTAL	
DO4B	FLUSH DOOR 50mm THICK SEMI-SOLID CORE **FINISH** Overall plywood finished for oil painting		Bearing ss hinges with screws Robe hook Nickel chain Door guard 2 no. pull handle	W/C	4	4	4	4	4	4	**24**	
DO5	EMERGENCY EXIT DOOR TO SPECIALIST DETAIL AND ARCH. APPROVAL APPROVED FIRE RESISTANT GLASS PANEL WITH POLTCARBONATE FILM **FINISH** Paint		Heavy duty ss hinges Approved ddouble panic bolt including necessary signage	FIRE EXCAPE STAIRS	1	5	2	2	2	2	**14**	Fan light area fix clear glass 6mm thick
DO6	50 mm THICK PANELLED HARDWOOD MAHOGANY DOOR MOULDED BEADING **FINISH** Clear vanish		5 Lever Mortice lock automatic deadlocking 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 no. ss door closer Signage Tower bolt	MAIN ENTRANCE	2	0	0	0	0	0	**2**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead Fan light area fix clear glass 6mm thick
DO7	50 mm THICK PANELLED HARDWOOD MAHOGANY DOOR MOULDED BEADING **FINISH** Clear vanish		3 Lever Mortice lock automatic deadlocking 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 no. ss door closer Signage Tower bolt	SENIOR OFFICES	0	0	0	12	0	2	**14**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead Fan light area fix clear glass 6mm thick
DO8	ALUMINIUM SECTION DOOR TO APPROVED COLOUR **FINISH** Powder coated		Aluminum frame door 2 no. Door closer Cylindrical lock 2 no. Aluminium pull handle Bearing ss hinges with screws Signage	OFFICES	0	8	7	13	13	6	**47**	Fan light area fix clear glass 6mm thick
DO9	ALUMINIUM SECTION DOOR TO APPROVED COLOUR **FINISH** Powder coated		Aluminum frame door 2 no. Door closer Cylindrical lock 2 no. Aluminium pull handle Bearing ss hinges with screws Signage Tower bolt	OFFICES	0	2	1	0	0	0	**3**	

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified, drawings are not to be scaled. Only figured dimensions to to be used. The contractor must check & verify all the dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete smound. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
DOOR SCHEDULE 02

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A
drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW




Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES: DOOR SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	LOCATION	QUANTITY: PER LEVEL							REMARKS
					1	2	3	4	5	6	TOTAL	
D10	50 mm THICK PANELLED HARDWOOD MAHOGANY DOOR MOULDED BEADING **FINISH** Clear vanish	 2,400 100 100 350 700 100 450 900 1,350 300 2,100 2,100 1,200 900 100 100 25 25 25

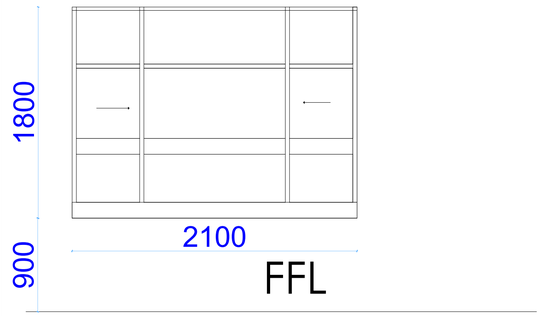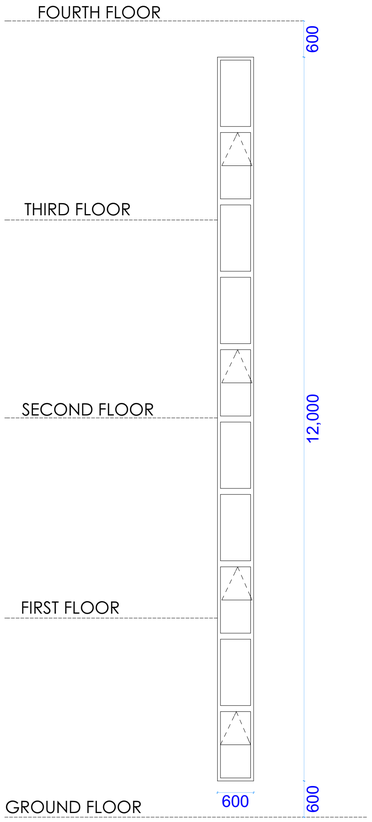ID	TYPE	DESCRIPTION	LOCATION	QUANTITY
W1		powder coated aluminium louvres with all accessories to Architect's approval	Basement	55 
W2		powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval	offices Ground,1st,2nd & third floor	104 
W3		powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval	Sides of the building Ground,1st,2nd 3rd & 4th floor	6

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete surround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass, fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
WINDOW SCHEDULE 01

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 2 3

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

W4

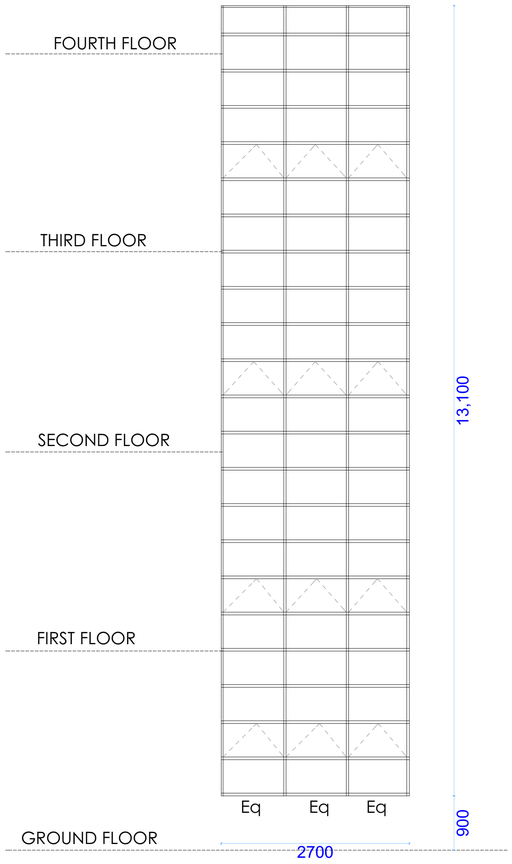


powder coated aluminium
top hung, fixed and projection windows with 6mm thick tinted glass and
with permanent vents complete with all accessories to Architect's approval

First to third floors
Coner window

6



W5

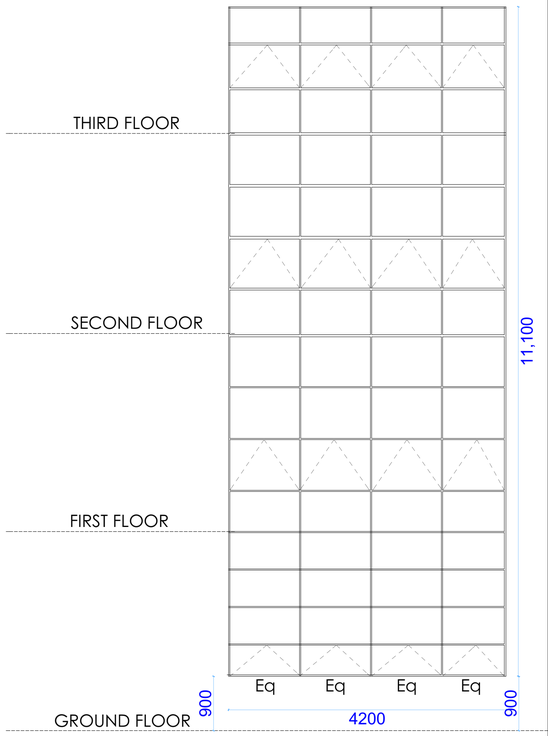

powder coated aluminium
top hung, fixed and projection windows with 6mm thick tinted glass and
with permanent vents complete with all accessories to Architect's approval

First to third floors
Coner window

6



NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete surround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
WINDOW SCHEDULE 02

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**




	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

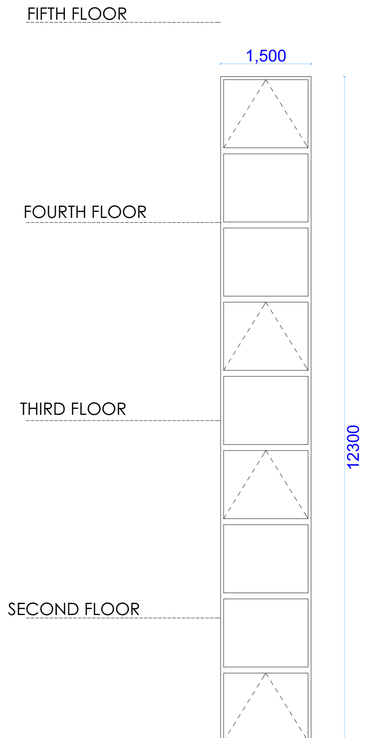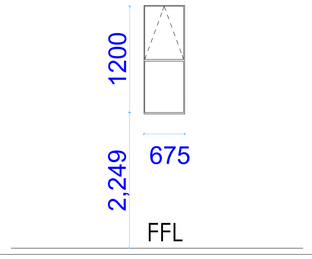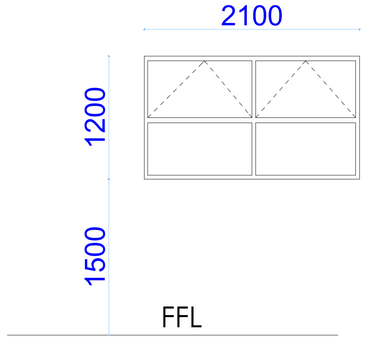W6		powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval	Stair cases	3 
W7			Disabled toilets	10 
W8		powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval	Toilets	10 

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-real, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
WINDOW SCHEDULE 03

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	
	2	
	3	

project job no. | **drawing no.**




	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

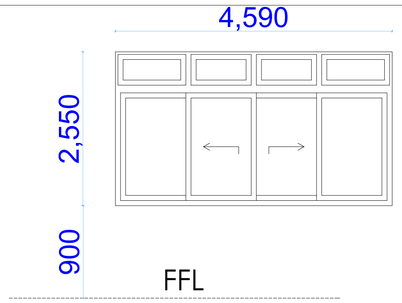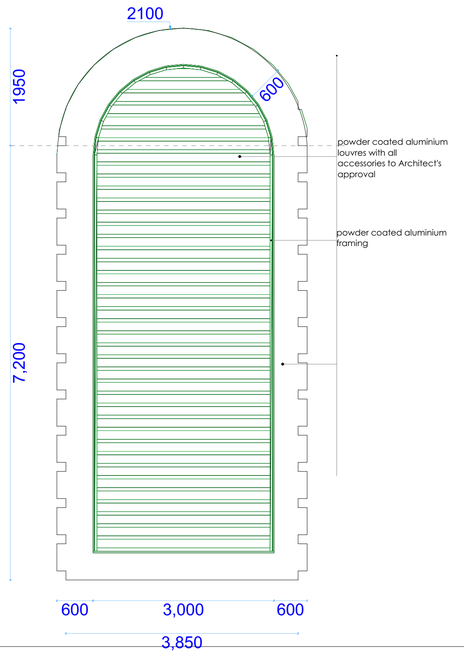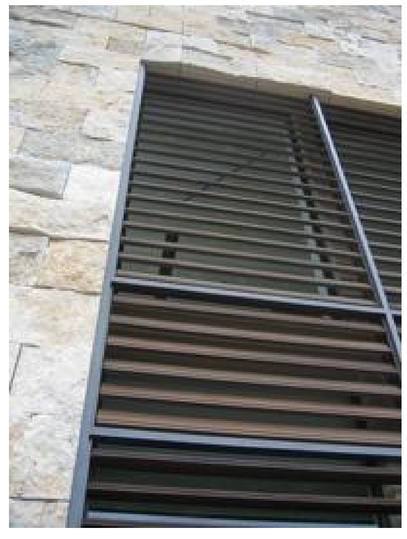W9		powder coated aluminium sliding, fixed and projection windows with 6mm thick tinted glass and with permanent vents complete with all accessories to Architect's approval	offices Fourth floor	22
W		powder coated aluminium louvres, fixed and projected window with permanent vents complete with all accessories to Architect's approval	Louvres front facade	1 

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete surround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extingushers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
WINDOW SCHEDULE 04

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	
	2	
	3	

project job no.			drawing no.


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

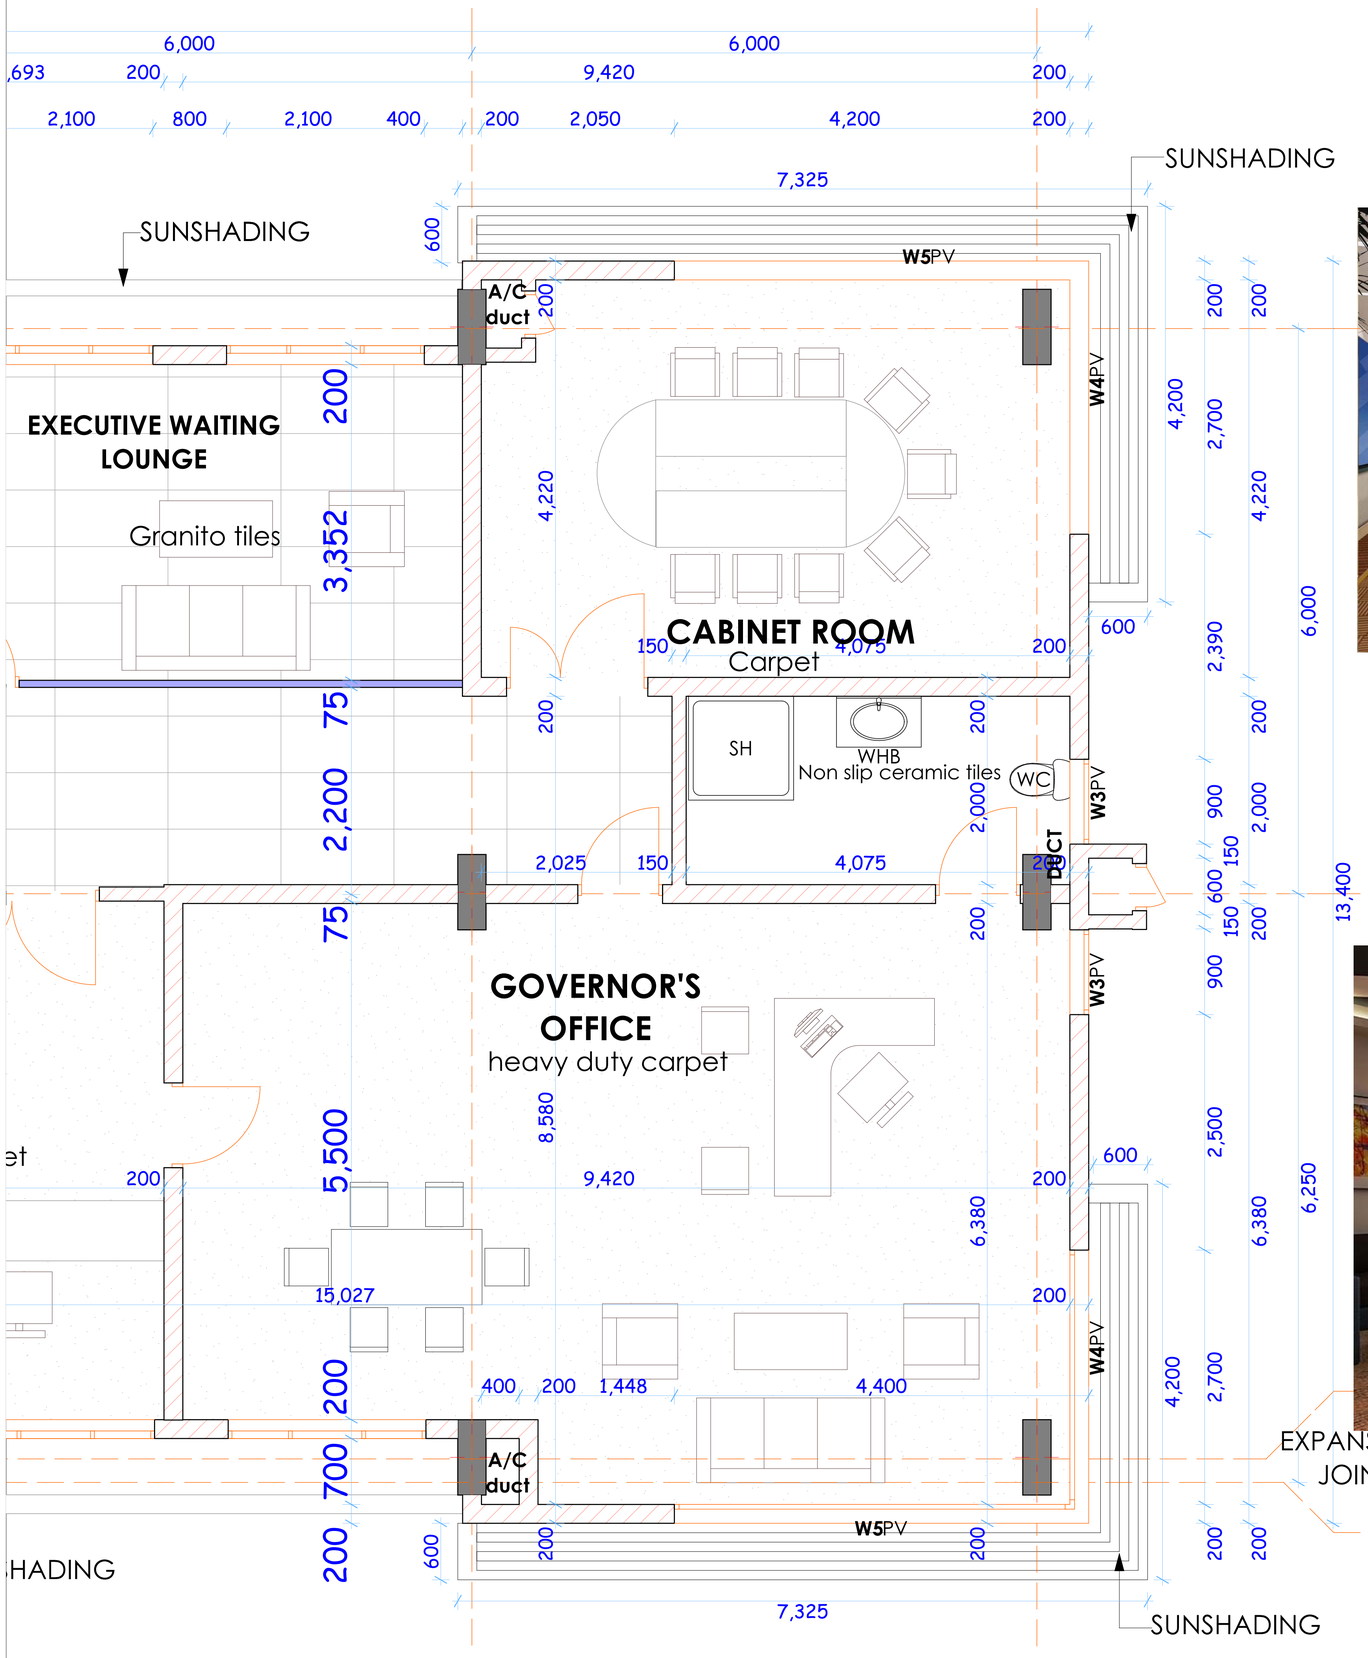



CABINET ROOM

H



GOVERNOR'S OFFICE

G01

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GOVERNOR'S OFFICE

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A
drawing no. A


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

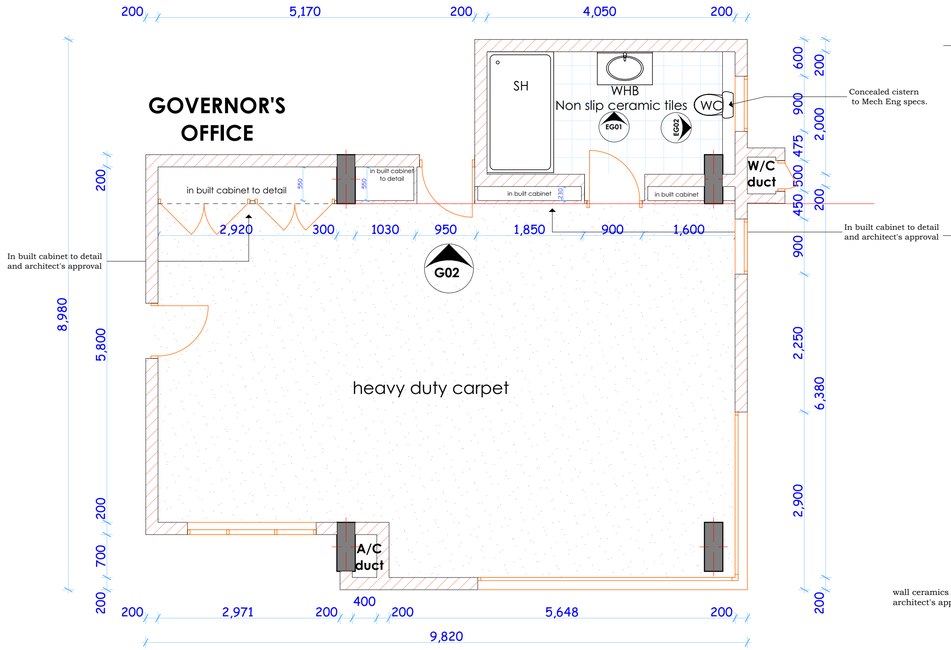


LAYOUT PLAN: FLOOR FINISHES

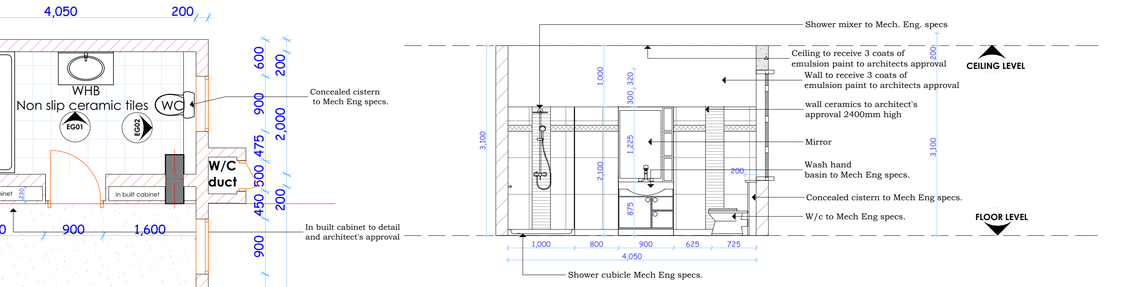

ELEVATION EG01

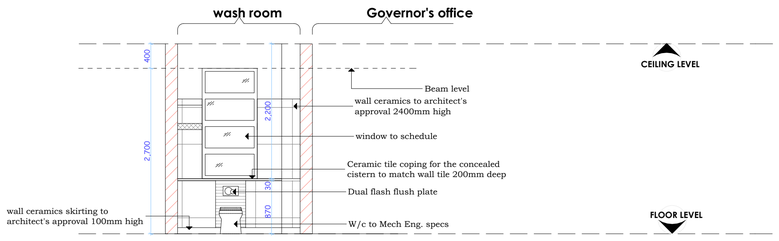


ELEVATION EG02

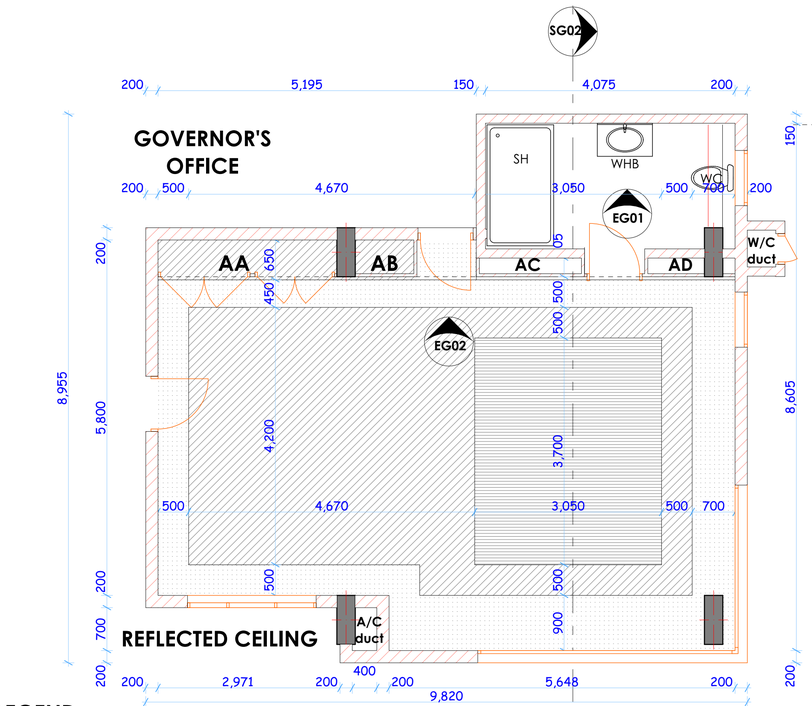


LEGEND

- Gypsum 9mm thick 500mm deep to receive 3 coats of paint to architect's approval
- Gypsum 9mm thick 300mm deep to receive 3 coats of paint to architect's approval
- Gypsum 9mm thick 500mm deep to receive 3 coats of paint to architect's approval
- Washroom to receive 2 coats of paint render to architect's approval

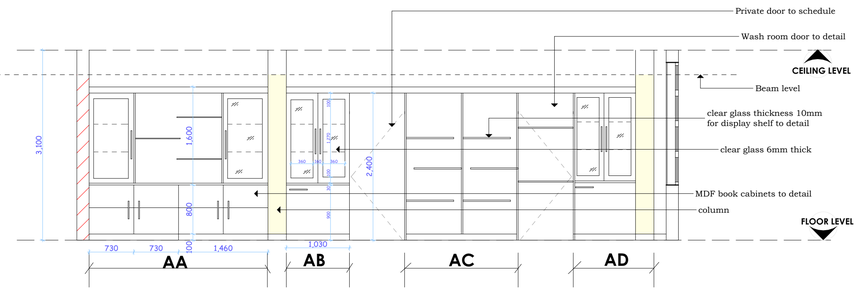

ELEVATION G01

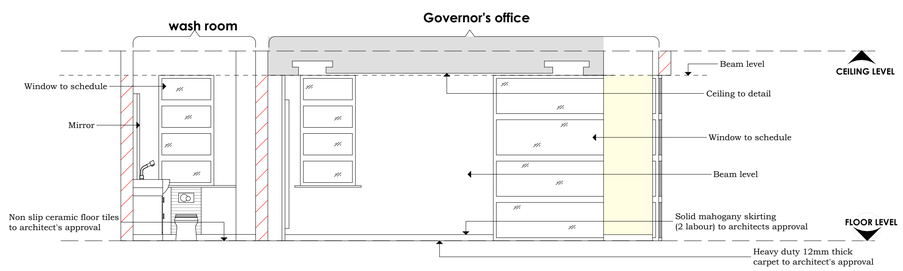

LEGEND

AA Book cabinet + display shelf

AB Book cabinet enclosed

AC Display shelg

AD Book cabinet enclosed

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GOVERNOR'S OFFICE DETAILS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. Job No. 9951 A

drawing no. E(001)

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA


KITCHEN LEVEL FOUR: GOVERNOR'S WING

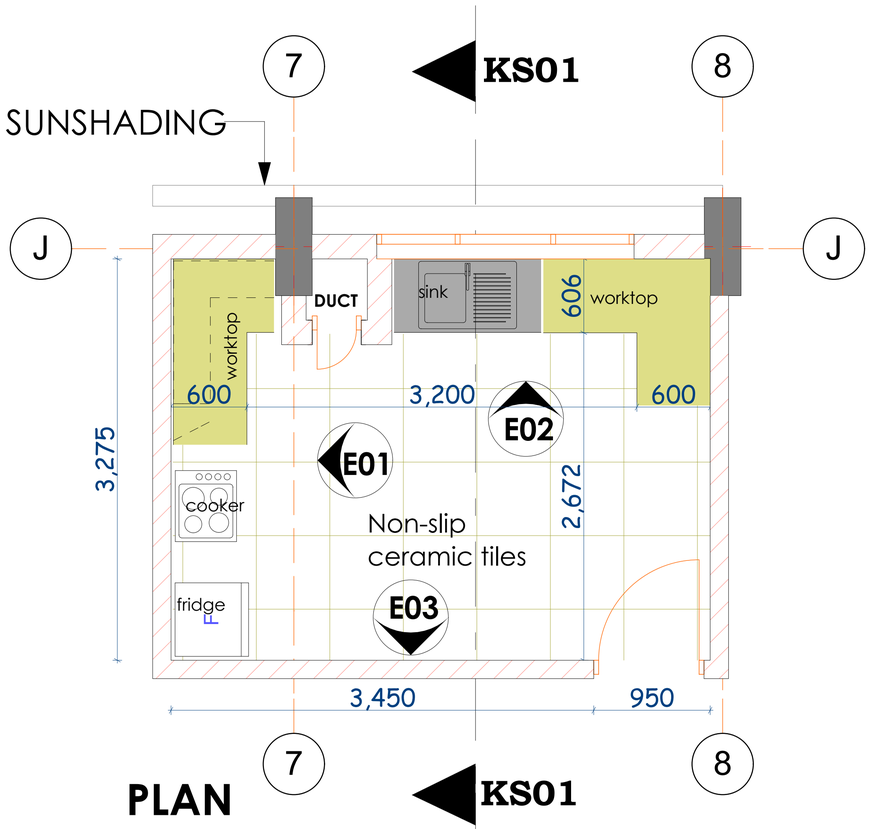


PLAN

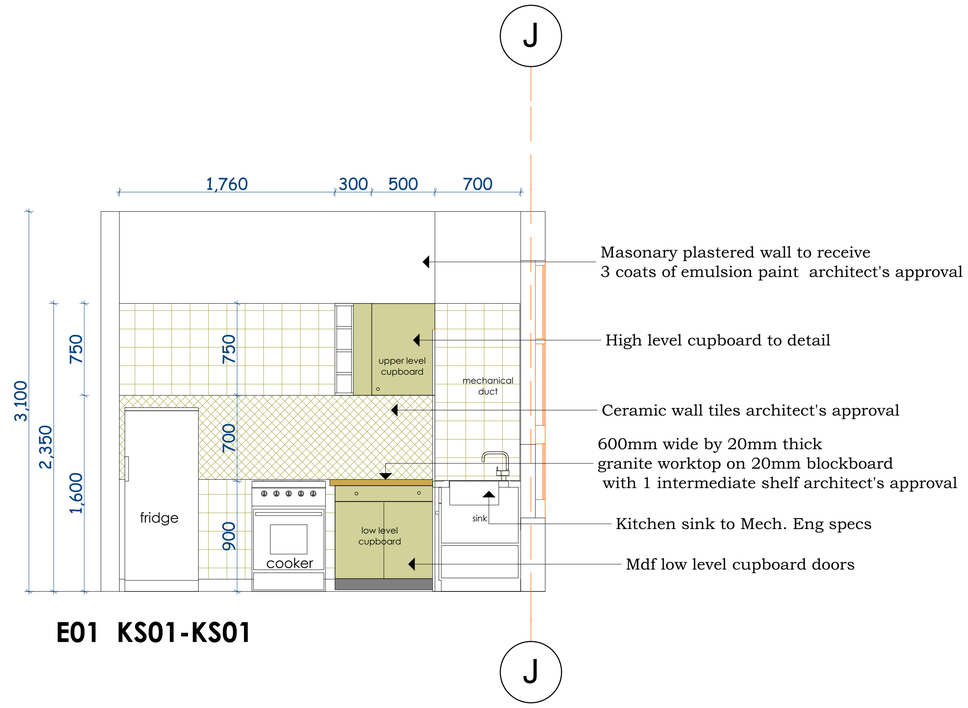

E01 KS01-KS01

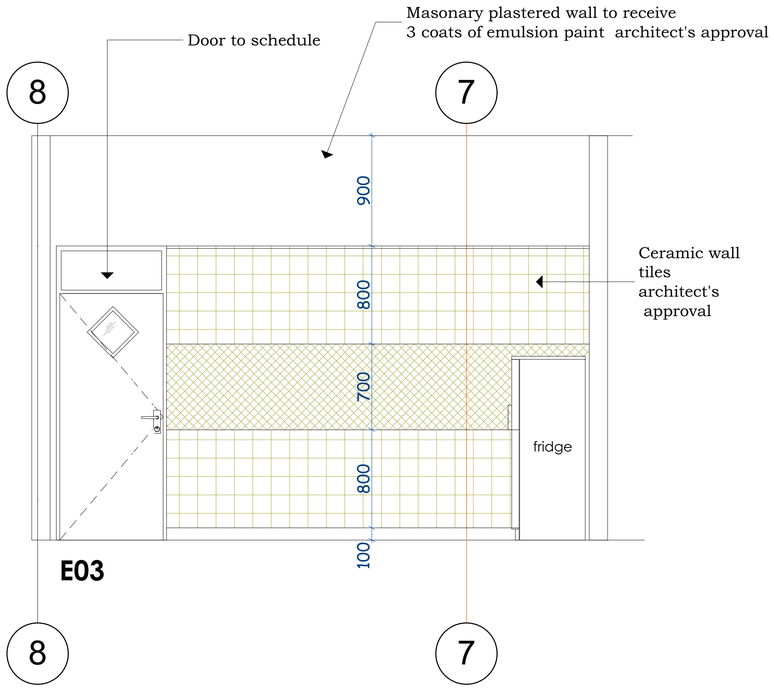

E03

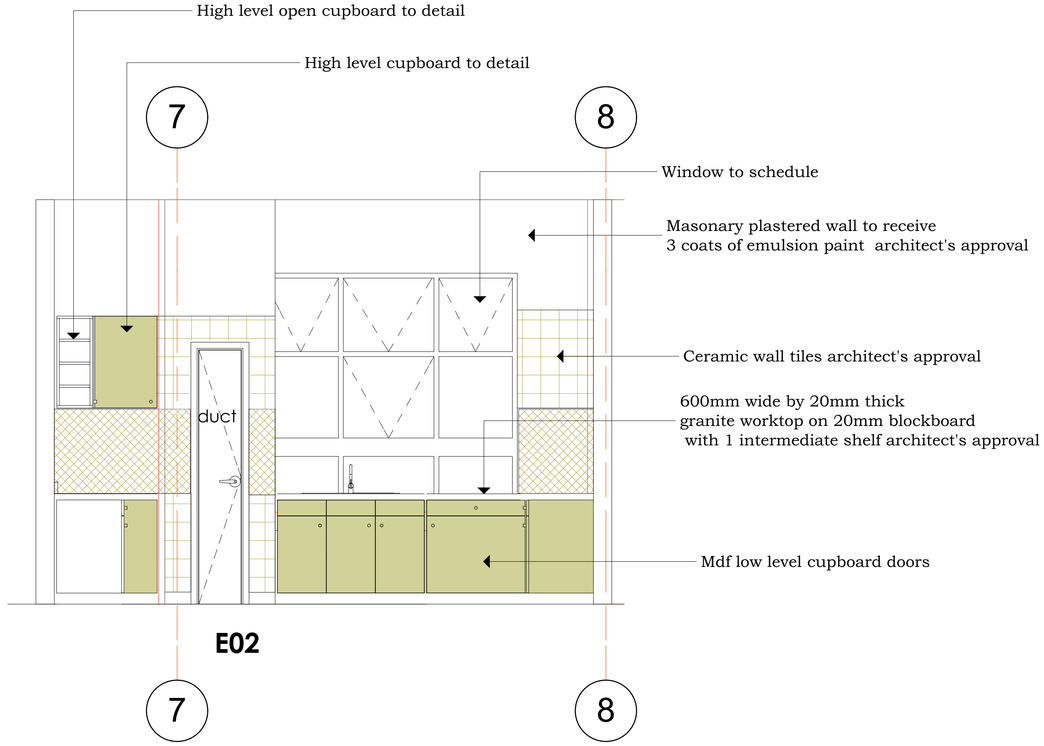

E02

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete surround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GOVERNOR'S KITCHEN DETAILS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale: 1 1:25; 2; 3

project job no. Job No. 9951 A
drawing no. A

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
	Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA


GOVERNOR'S BOARDROOM FLOOR LAYOUT

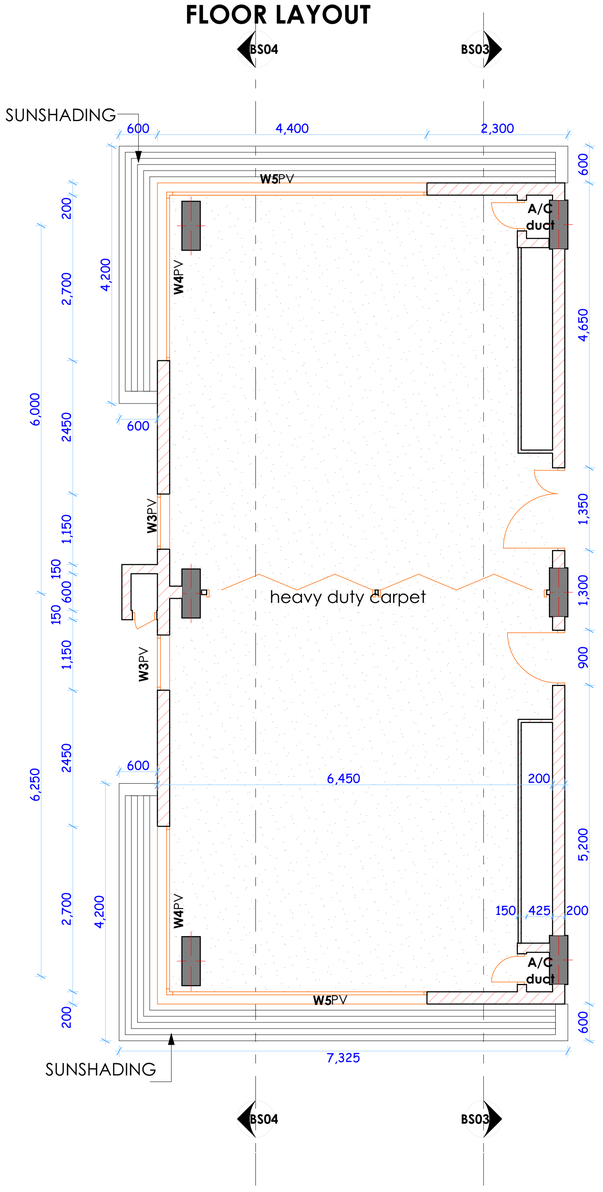


GOVERNOR'S BOARDROOM REFLECTED CEILING LAYOUT

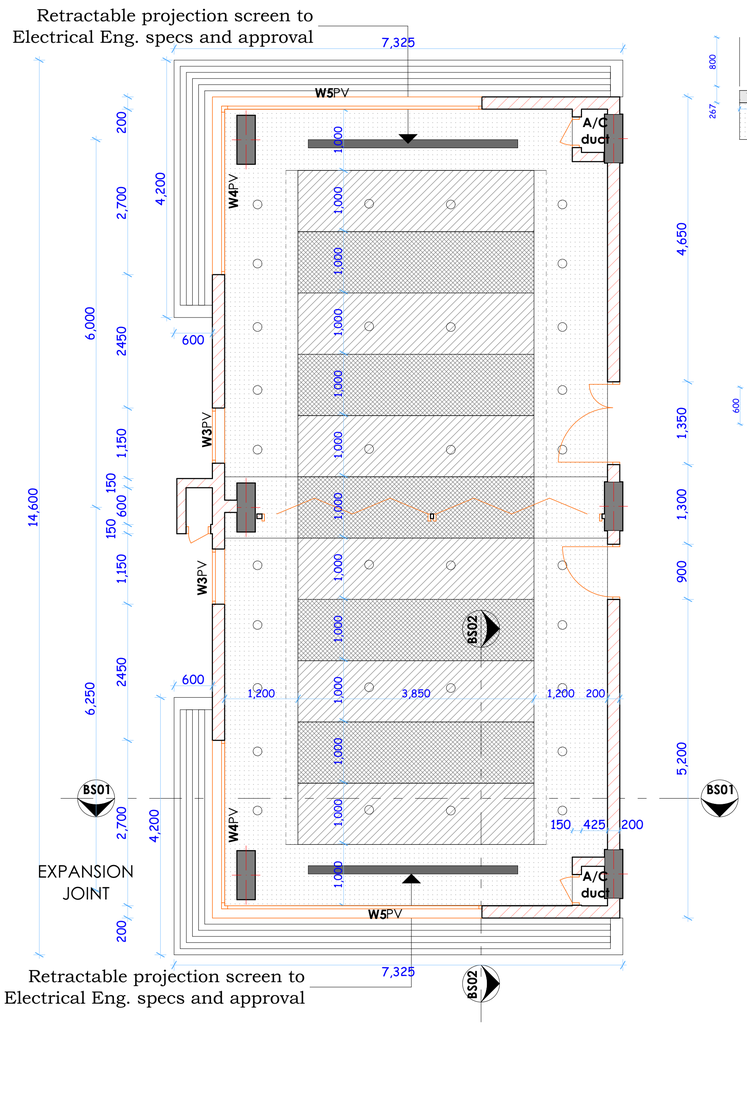

SECTION BS01-BS01

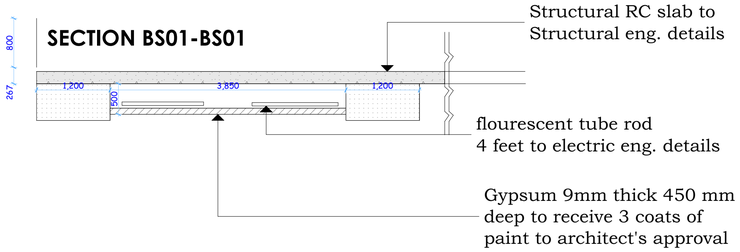

SECTION BS02-BS02

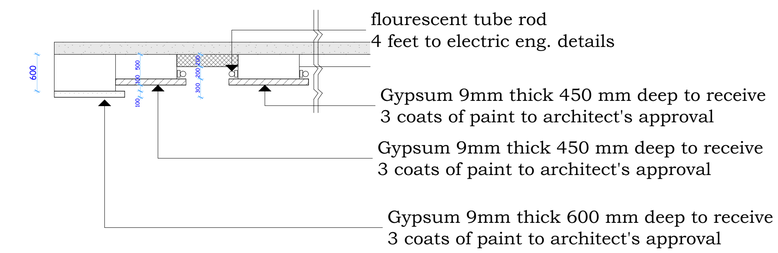

LEGEND

- Gypsum 9mm thick 600mm deep to receive 3 coats of paint to architect's approval
- Gypsum 9mm thick 450mm deep to receive 3 coats of paint to architect's approval
- Gypsum 9mm thick 300mm deep to receive 3 coats of paint to architect's approval
- ○ Downlighter to Electrical Eng. design, specs and approval

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GOVERNOR'S BOARDROOM DETAIL FLOOR & REFLECTED CEILING

Folio no.
D103 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:50
	2	
	3	

project job no. Job No. 9951 A
drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA







GOVERNOR'S BOARDROOM

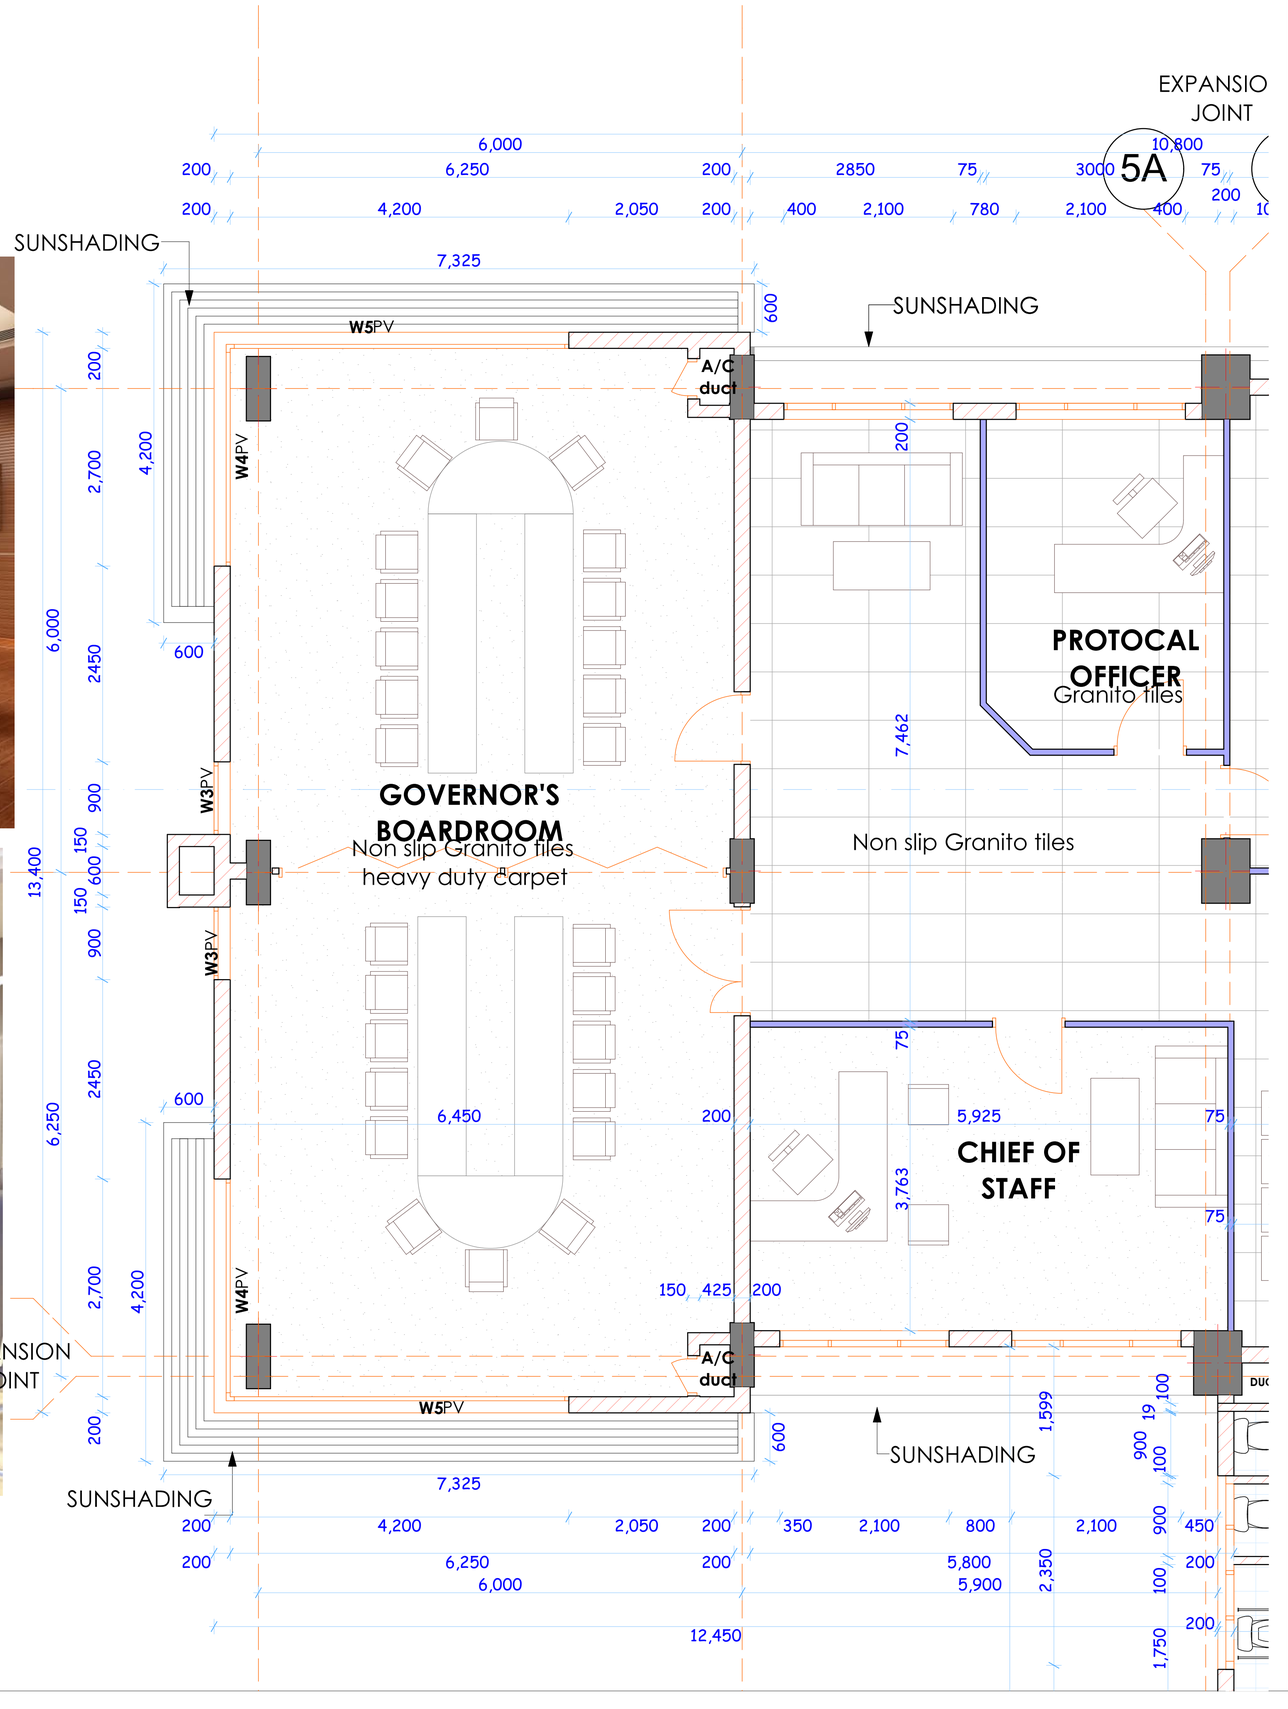

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 / 2 / 3

project job no. Job No. 9951 A — **drawing no.** A

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K E.Ngoi'ngo Arch Wanjala N.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

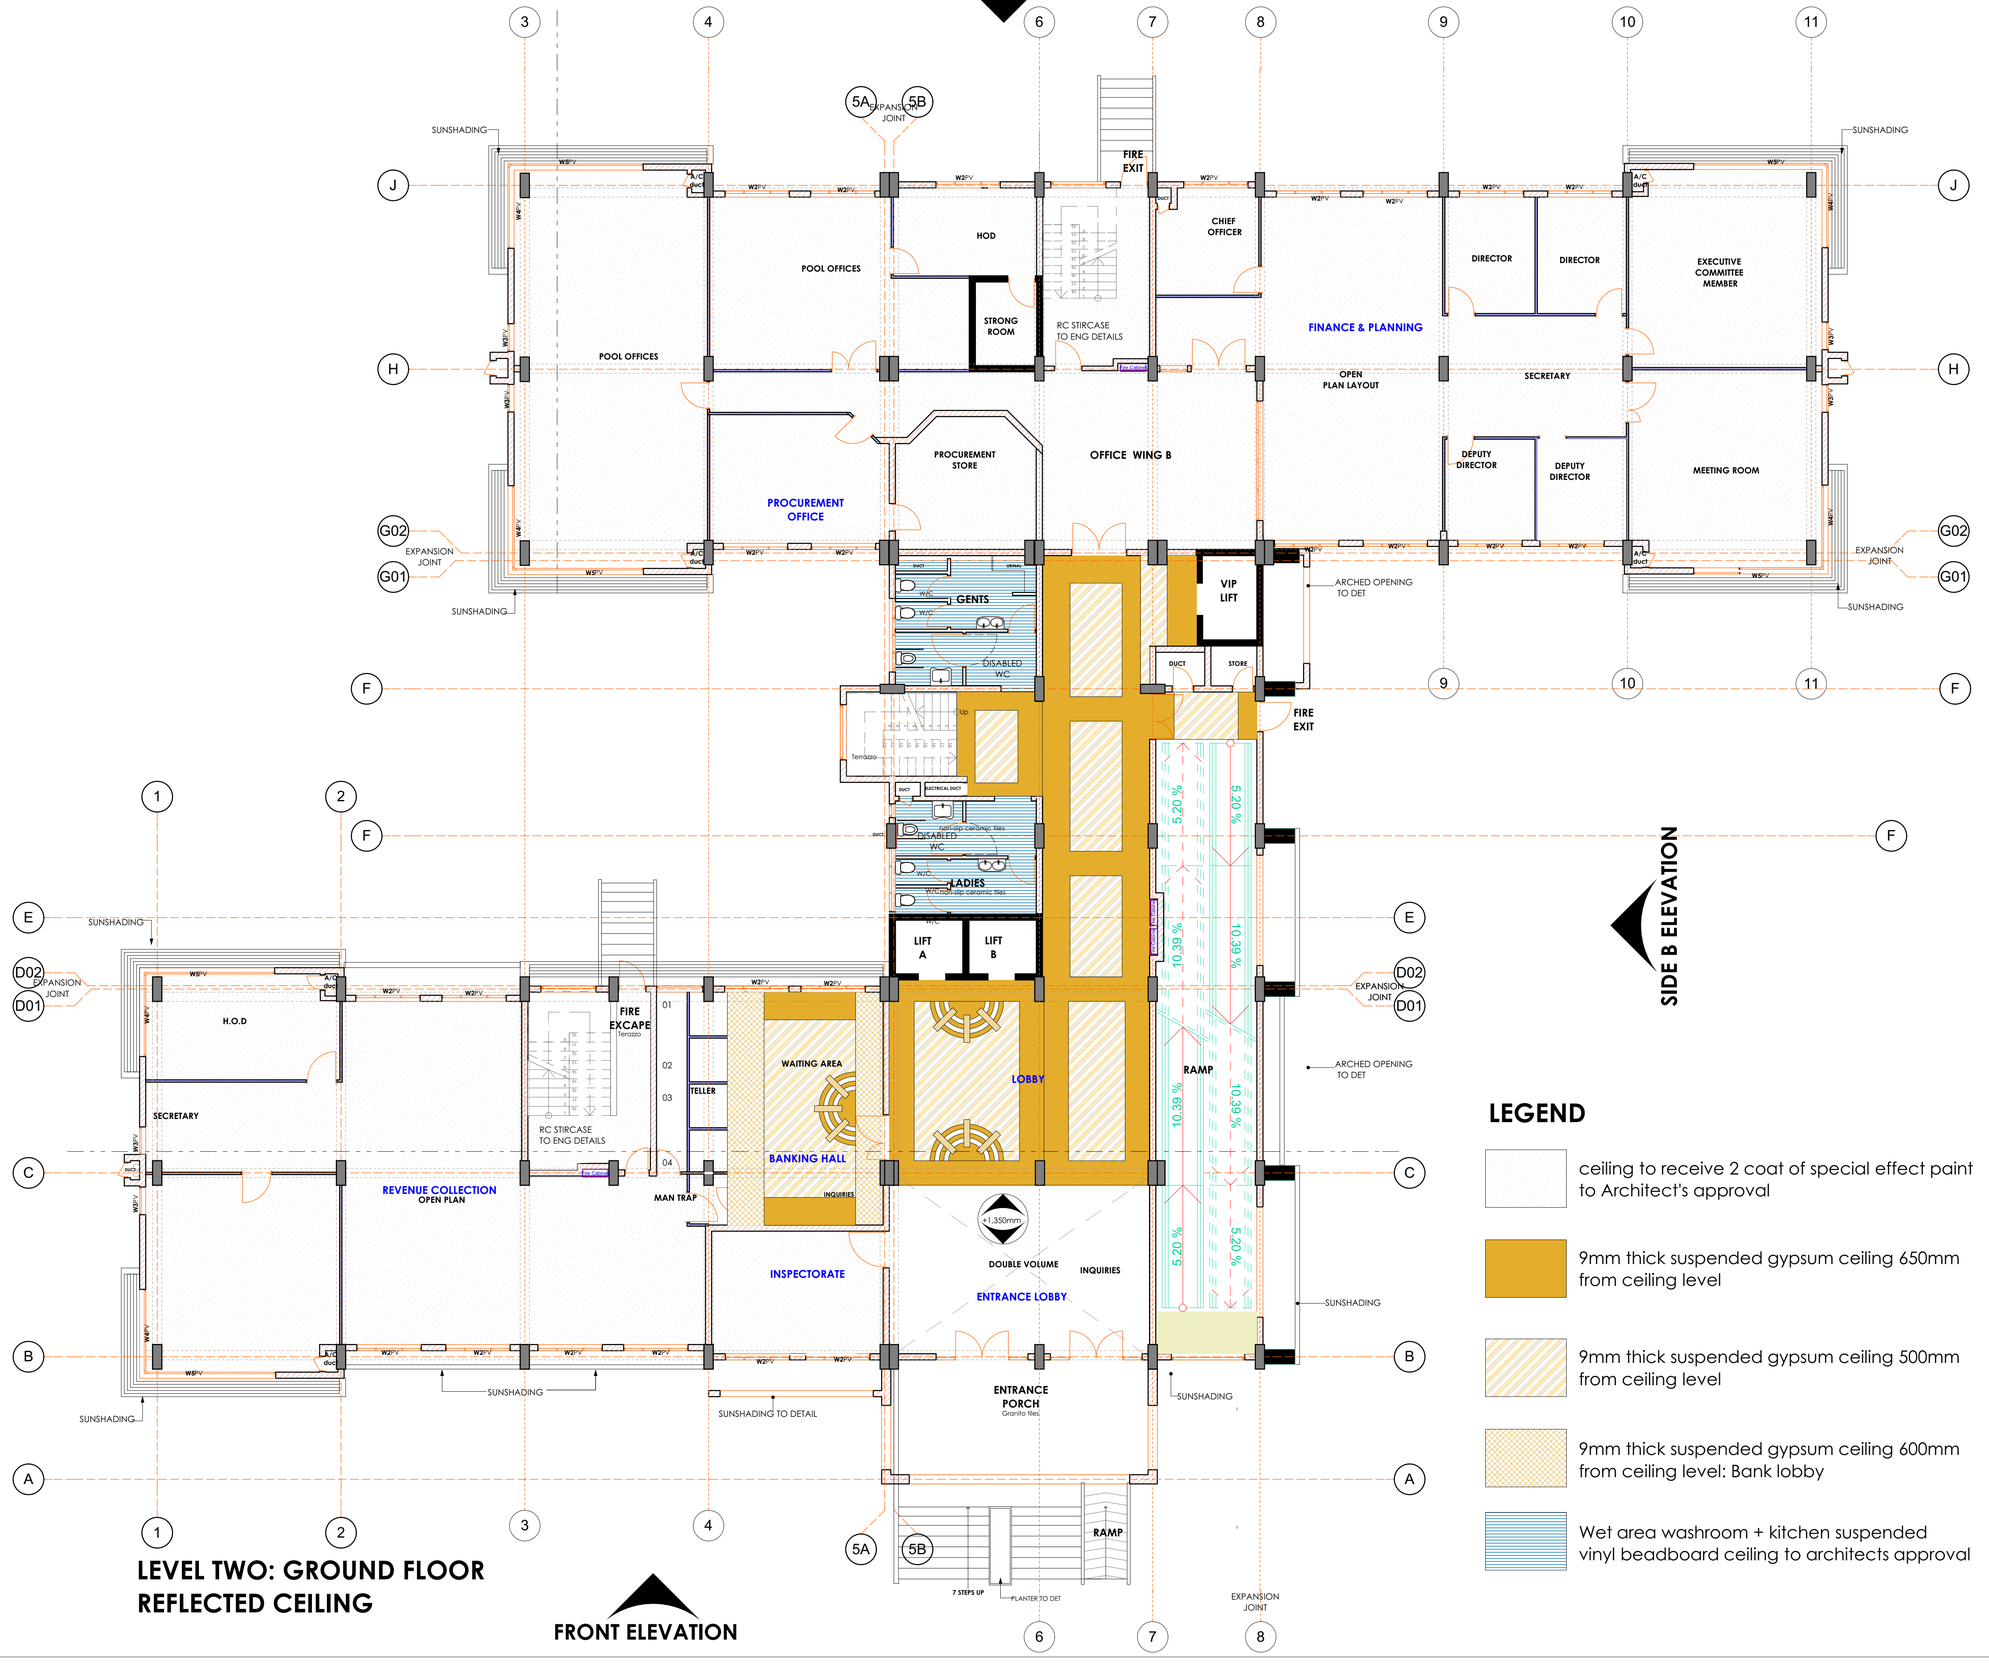

LEVEL TWO: GROUND FLOOR REFLECTED CEILING

FRONT ELEVATION

SIDE B ELEVATION

LEGEND

- ceiling to receive 2 coat of special effect paint to Architect's approval
- 9mm thick suspended gypsum ceiling 650mm from ceiling level
- 9mm thick suspended gypsum ceiling 500mm from ceiling level
- 9mm thick suspended gypsum ceiling 600mm from ceiling level: Bank lobby
- Wet area washroom + kitchen suspended vinyl beadboard ceiling to architects approval

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All hesting of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GROUND FLOOR REFLECTED CEILING

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale: 1 1:100; 2; 3

project job no. Job No. 9951 A
drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

REAR ELEVATION

SIDE A ELEVATION

SIDE B ELEVATION

FRONT ELEVATION

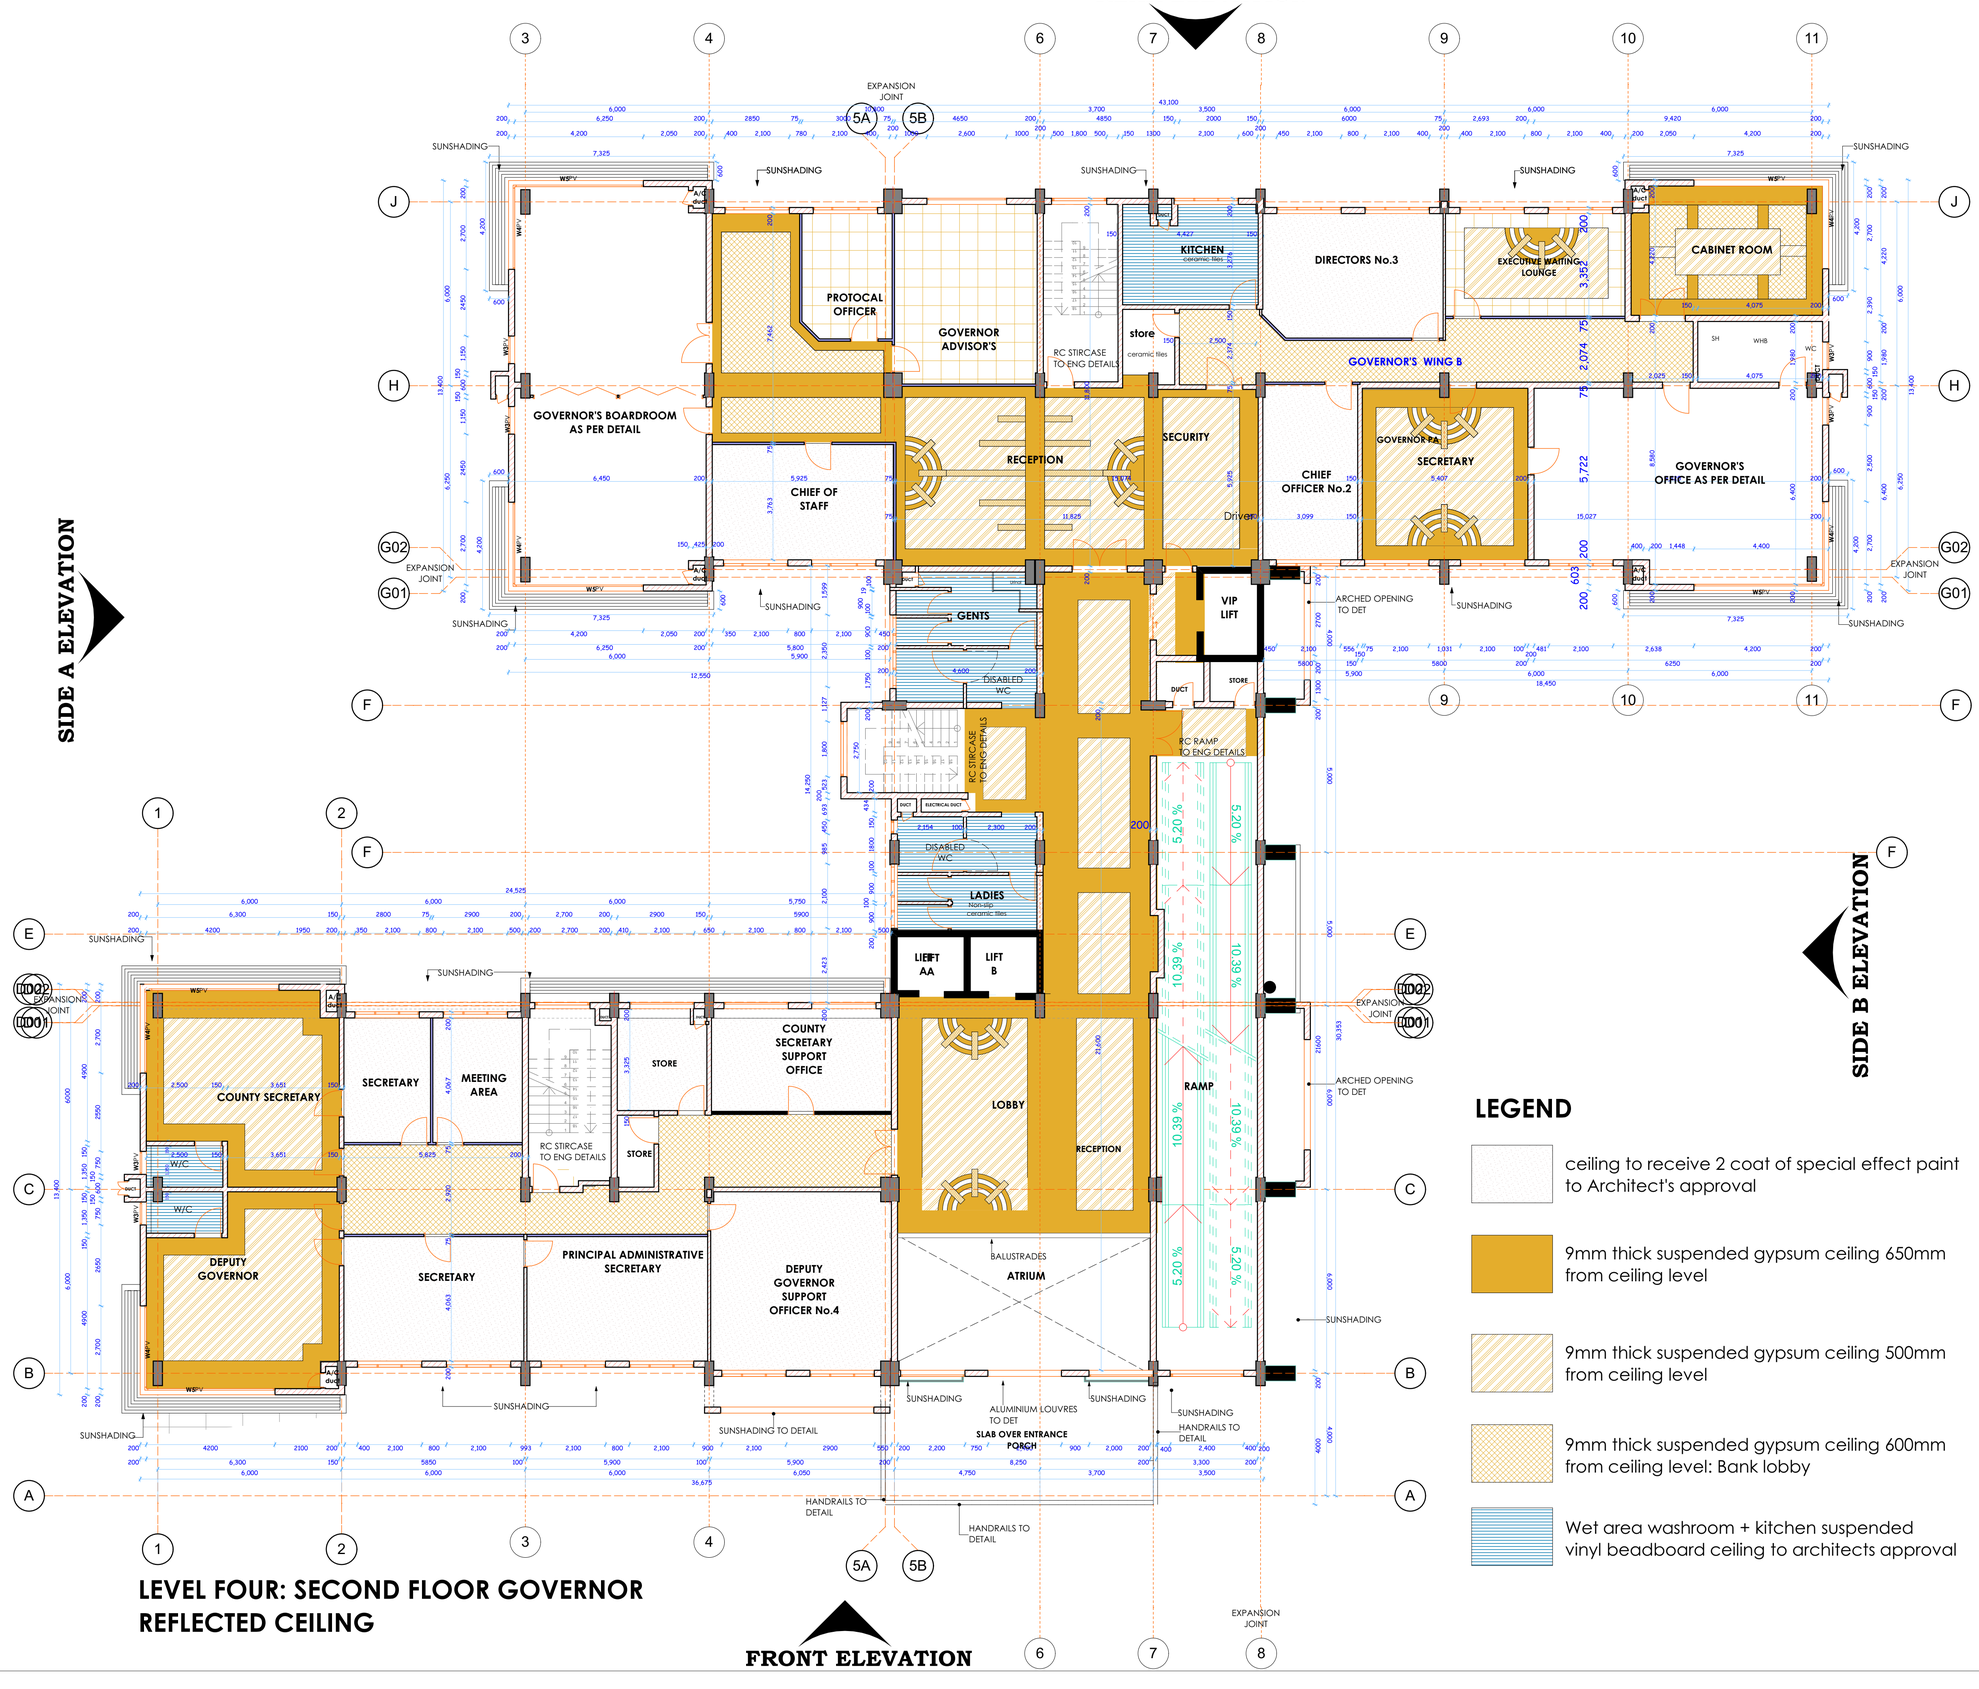

LEVEL FOUR: SECOND FLOOR GOVERNOR REFLECTED CEILING

LEGEND

- ceiling to receive 2 coat of special effect paint to Architect's approval
- 9mm thick suspended gypsum ceiling 650mm from ceiling level
- 9mm thick suspended gypsum ceiling 500mm from ceiling level
- 9mm thick suspended gypsum ceiling 600mm from ceiling level: Bank lobby
- Wet area washroom + kitchen suspended vinyl beadboard ceiling to architects approval

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete surround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
SECOND FLOOR LEVEL 4 REFLECTED CEILING

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1:100

project job no. Job No. 9951 A

drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA


TYPICAL WASHROOM PLAN

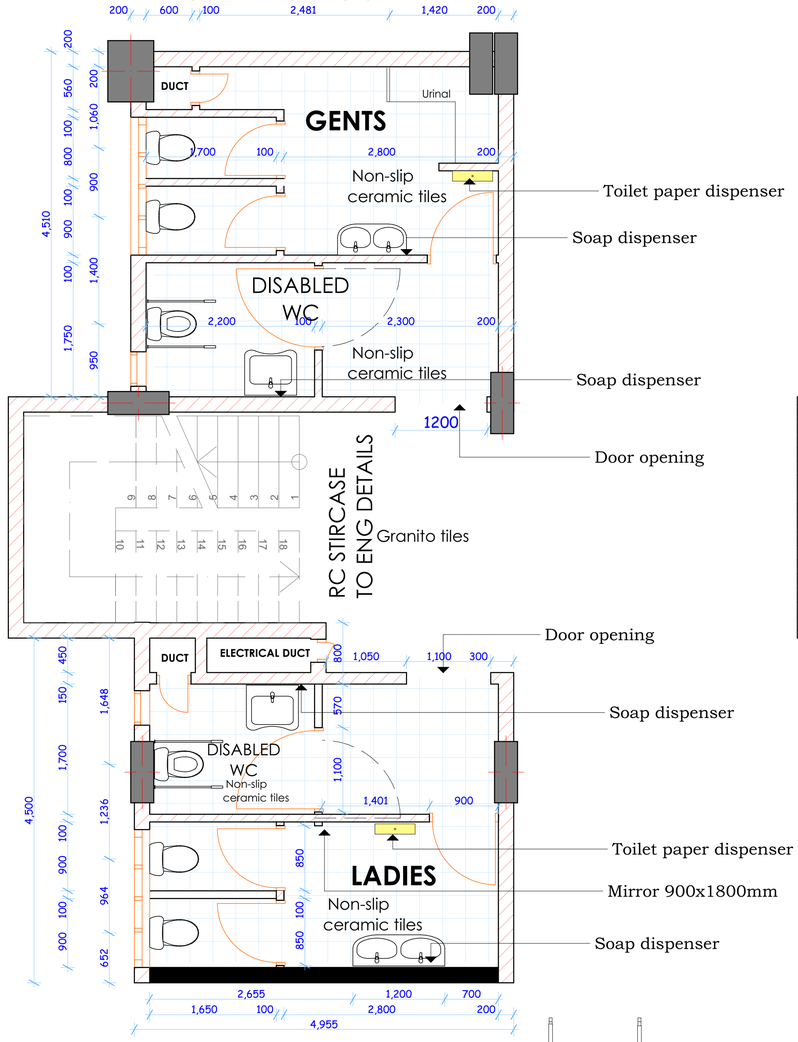



TYPICAL WASHROOM REFLECTED CEILING PLAN

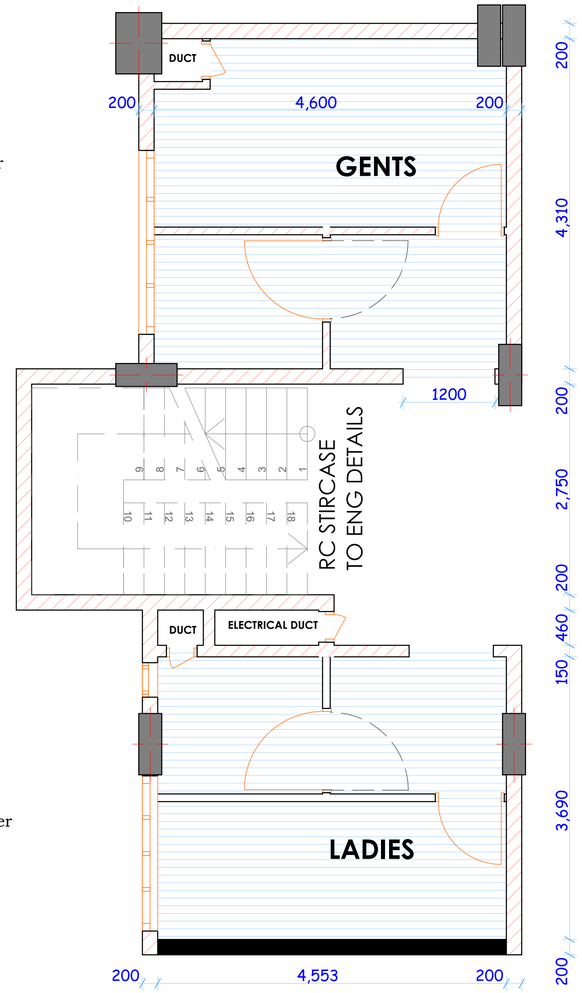

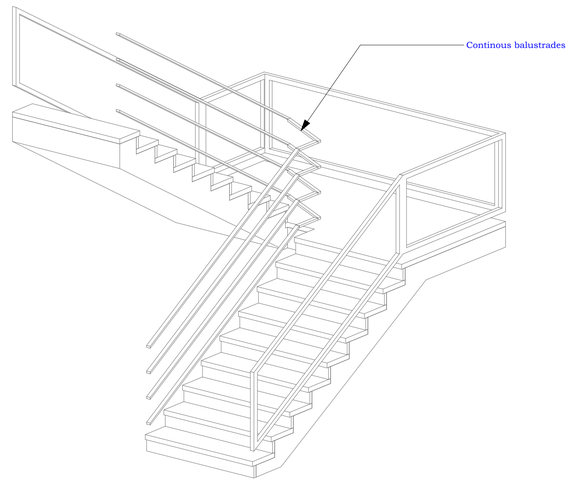

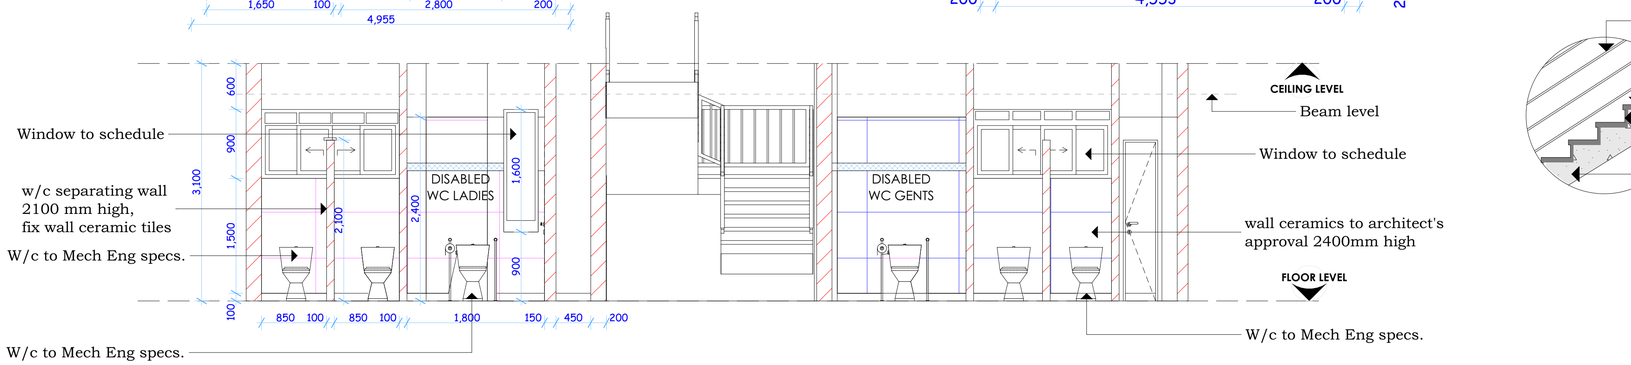

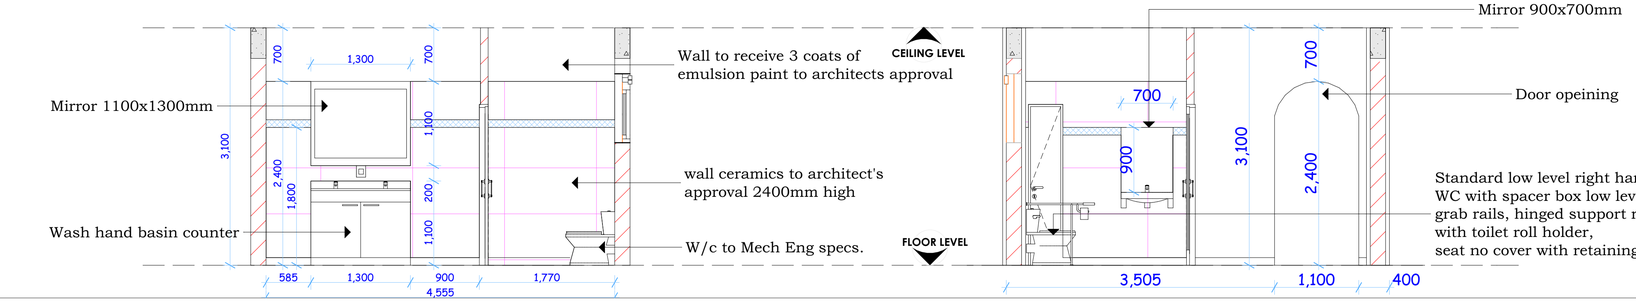

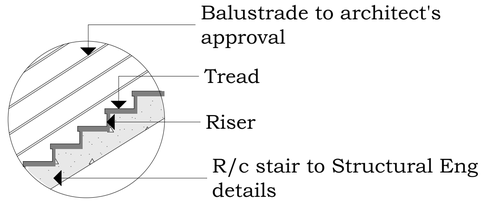

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
WASHROOM: PUBLIC TOILETS DETAILS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 2 3

project job no. Job No. 9951 A
drawing no.

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

COMMON KITCHEN FLOOR PLAN FLOOR LEVEL

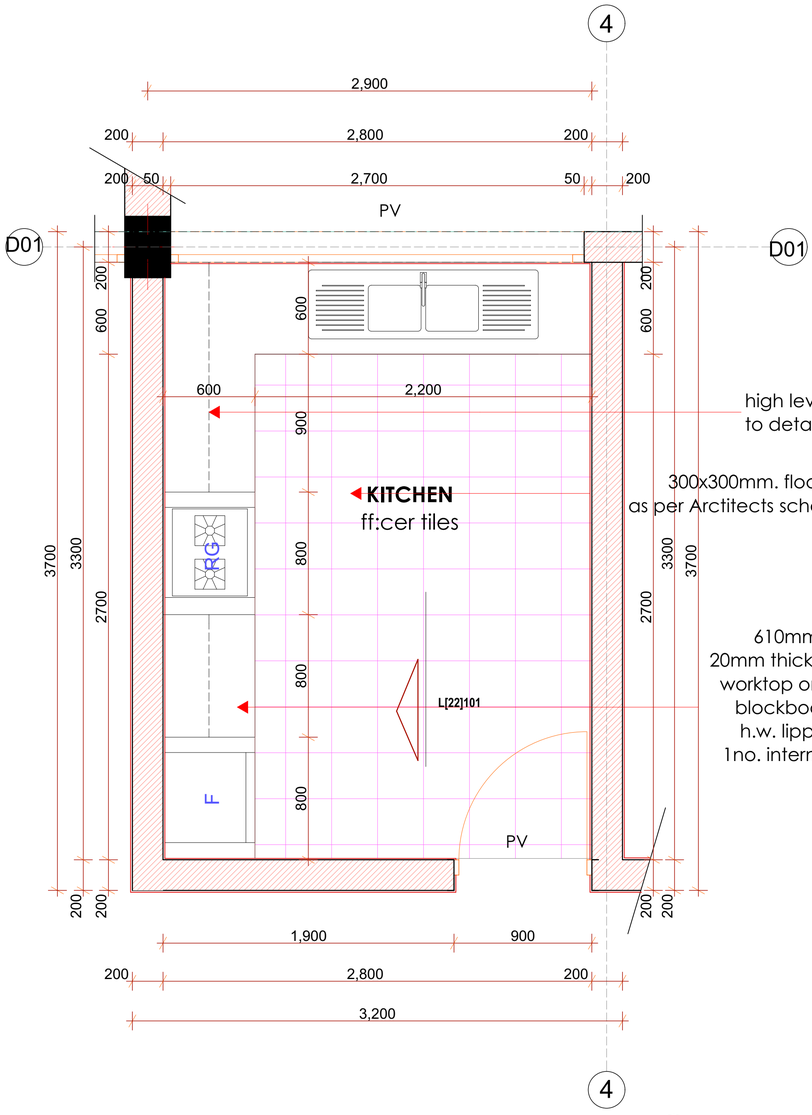


high level cupboard to detail A[73]04

300x300mm. floor tiles as per Arctitects schedule

610mm wide x 20mm thick granite worktop on 20mm blockboard with h.w. lipping plus 1no. intermediate shelf

610mm wide x 20mm thick granite worktop on 20mm blockboard with h.w. lipping plus 1no. intermediate shelf

finished floor level

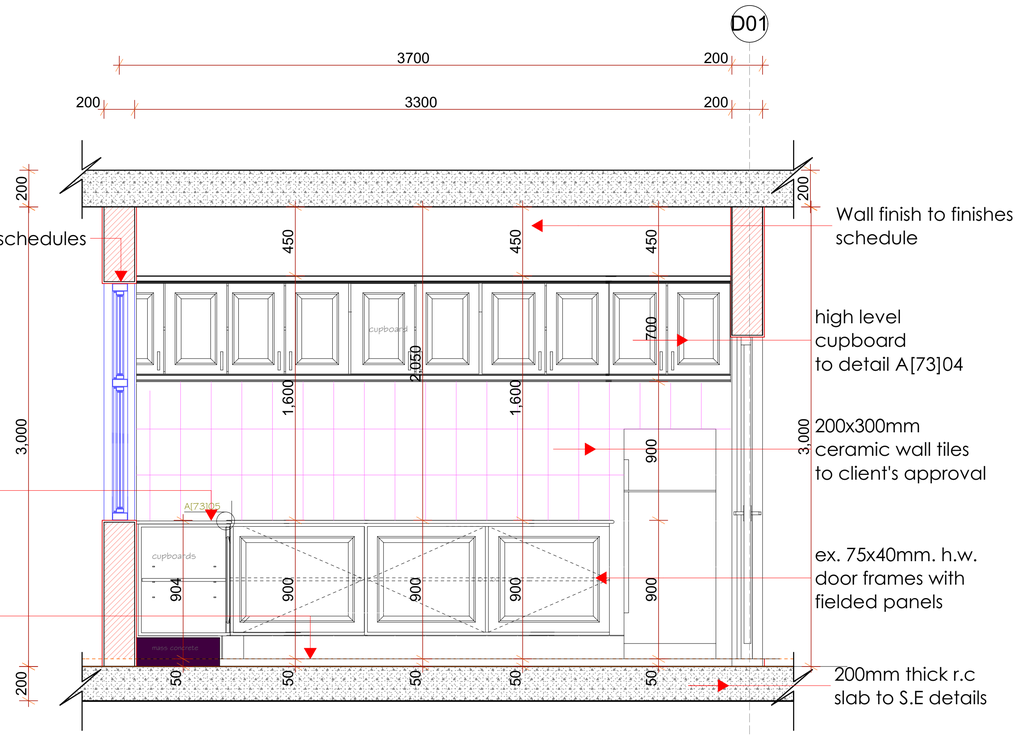

SECTION

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 2 3

project job no. | **drawing no.**


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K Arch Wanjala N.		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

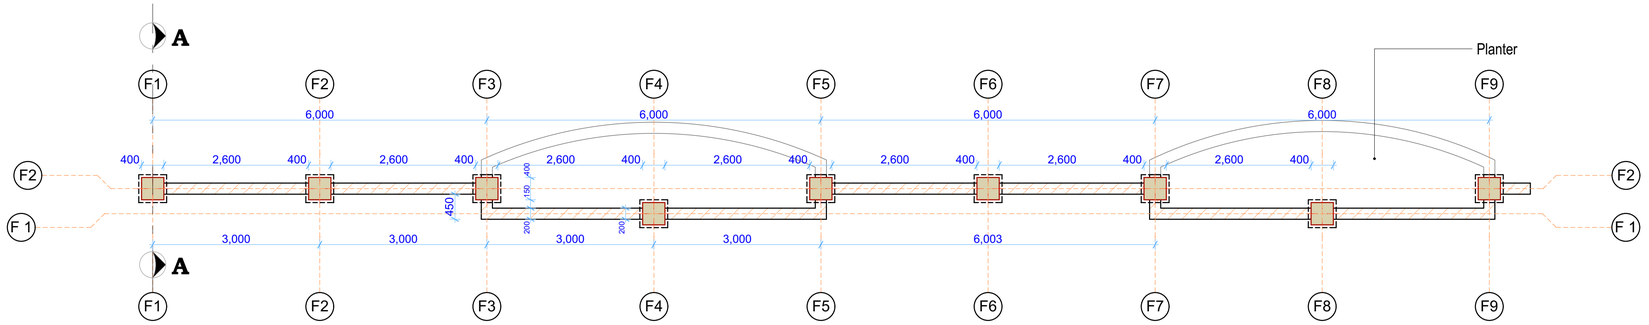


PART PLAN A

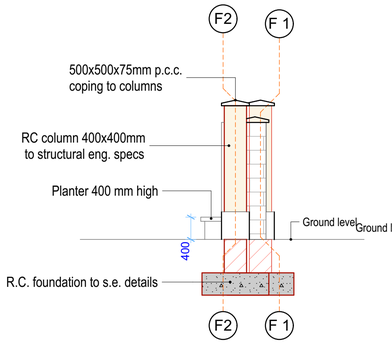


SECTION A-A

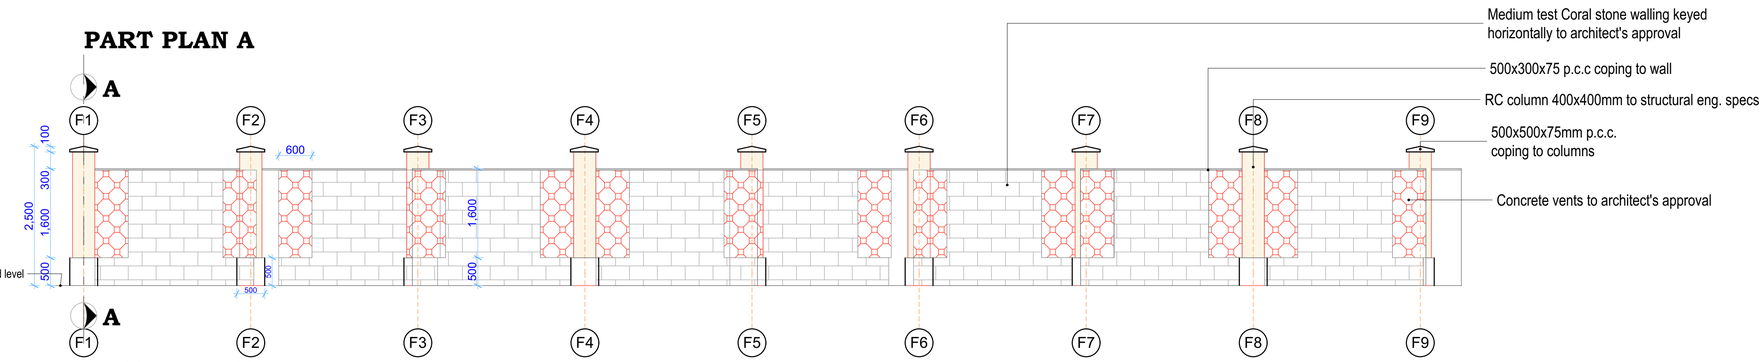


PART ELEVATION A

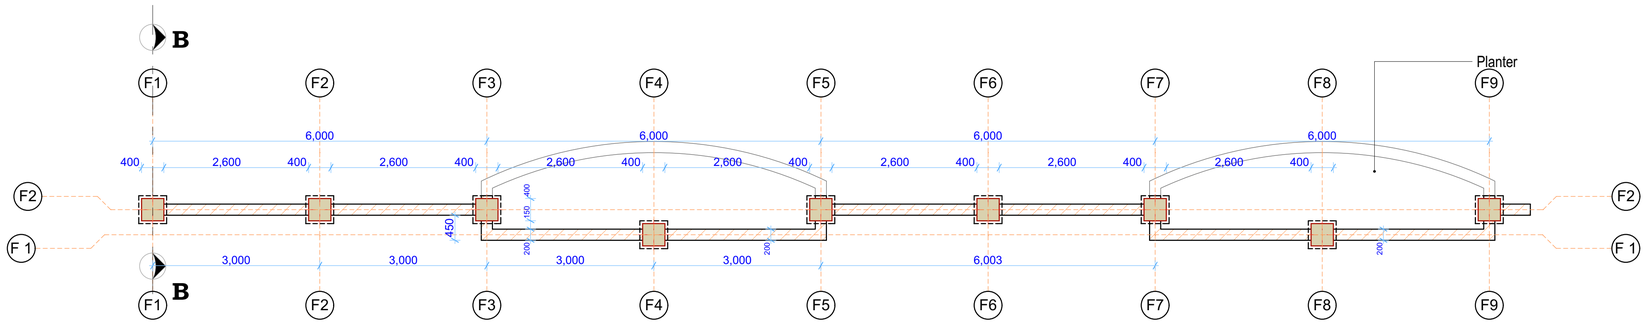

PART PLAN B

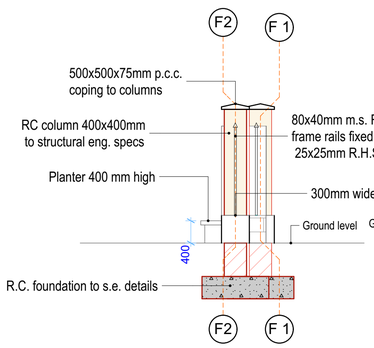

SECTION A-A

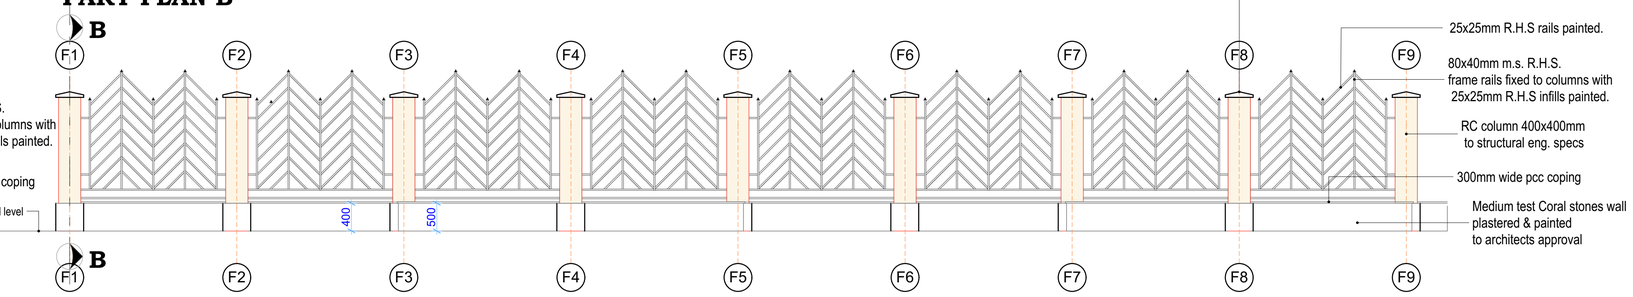

PART ELEVATION B

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete somound. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
BOUNDARY WALL PLAN, ELEVATION & SECTIONS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:50
	2	
	3	

project job no. | **drawing no.**


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

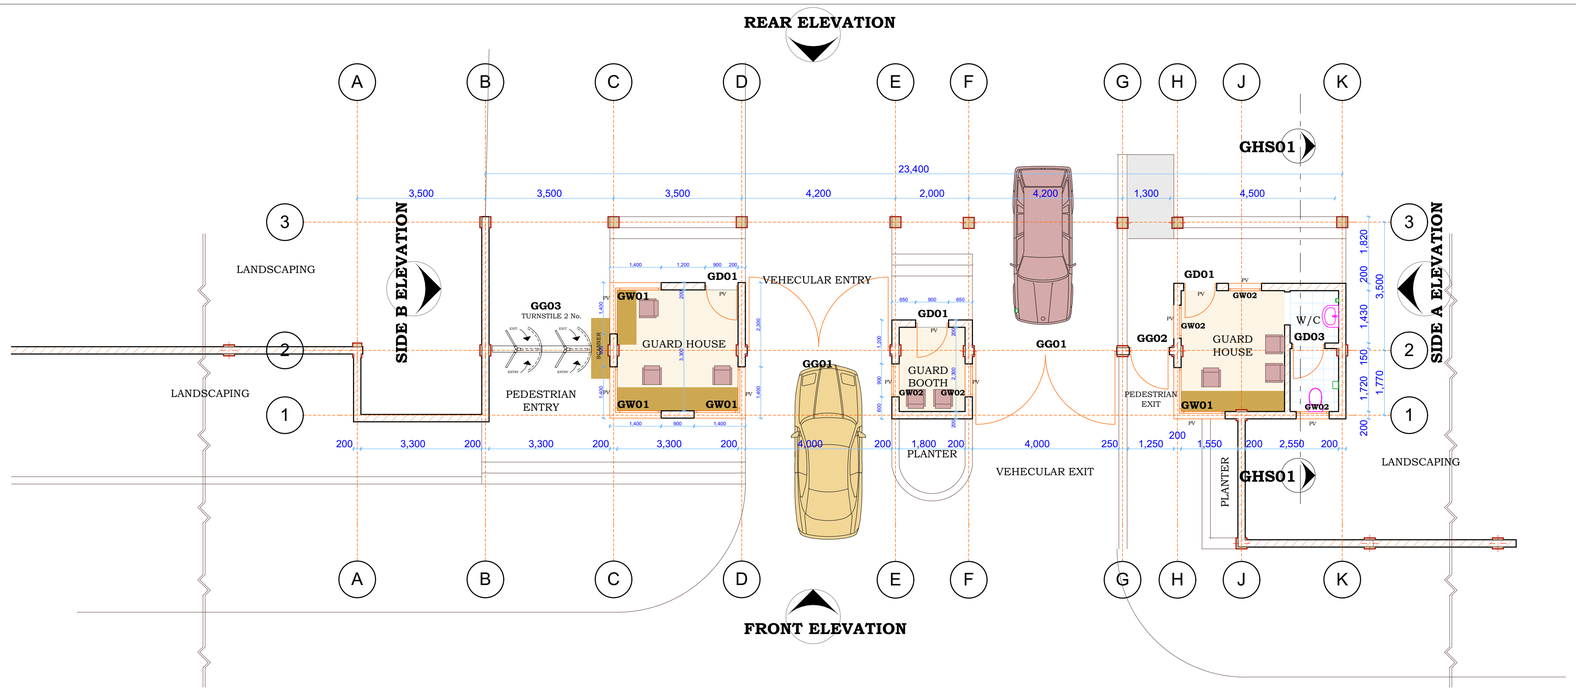

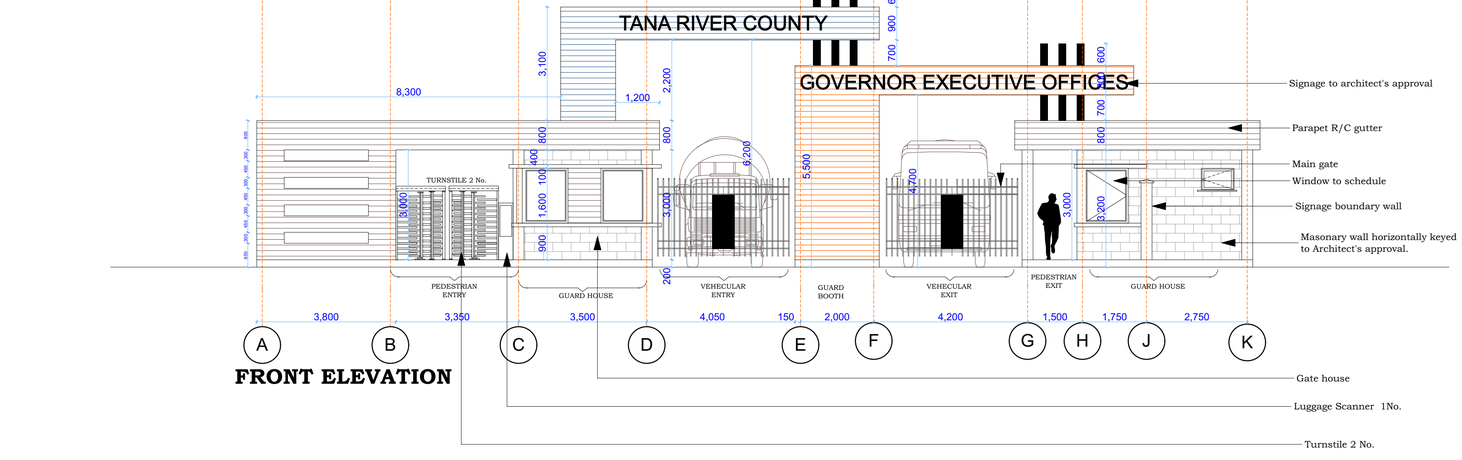

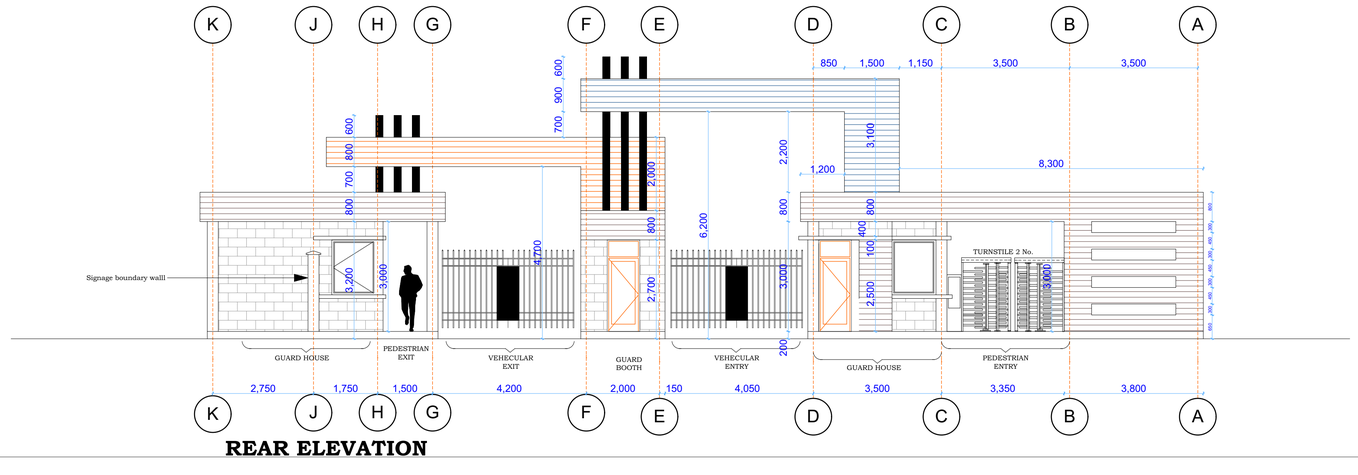

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS3255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break-glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
MAIN GATE HOUSE
PLAN, ELEVATIONS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		






APPROVED
Architect S.K.Muli OGW

Chief Architect Signed



MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES:GATE HOUSE DOOR SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	QUANTITY	REMARKS
GG01	STEEL RHS/ROD GATE		Gate latches Gate hinges heavy duty Gate hook and bands Tee hinges Fieldgaye hinge sets Gate band Throw over loops Gate wheels Gate hooks Gate brackets Spring fasteners Gate stops Gate staples	2	Design and finishing to architect's approval
GG02				1	
GG03	TURNSTILE.		Electronic operated control head. 2 solenoids To manufacture's specification	2	To manufacture's specification
GD01	FLUSH DOOR 50mm THICK SEMI-SOLID CORE **FINISH** Overall plywood finished for painting		3 Lever Mortice lock 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 No ss door closer Signage Tower bolt Kickplate	2	Wrot prime grade mahogany door frame -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead Fan light area fix clear glass 6mm thick
GD02	FLUSH DOOR 50mm THICK SEMI-SOLID CORE **FINISH** Overall plywood finished for painting		2 Lever Mortice lock 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 No ss door closer Tower bolt Kickplate	1	

TANA RIVER COUNTY EXECUTIVE OFFICES:GATE HOUSE WINDOW SCHEDULE

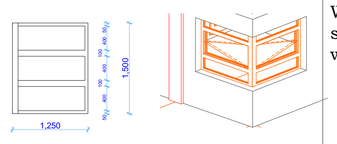SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	QUANTITY	REMARKS
GW01	ALUMINIUM CORNER CASEMENT		Window handle sash fastner stainless steel window friction hinges top hung 210mm	4	Powder coated aluminium projected windows with 6 mm thick tinted glass and permanent vents complete with all accessories to Architect's approval
GW02	ALUMINIUM CASEMENT			5	

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
DOOR & WINDOW SCHEDULE

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

GAZEBO/PRAYER ROOM

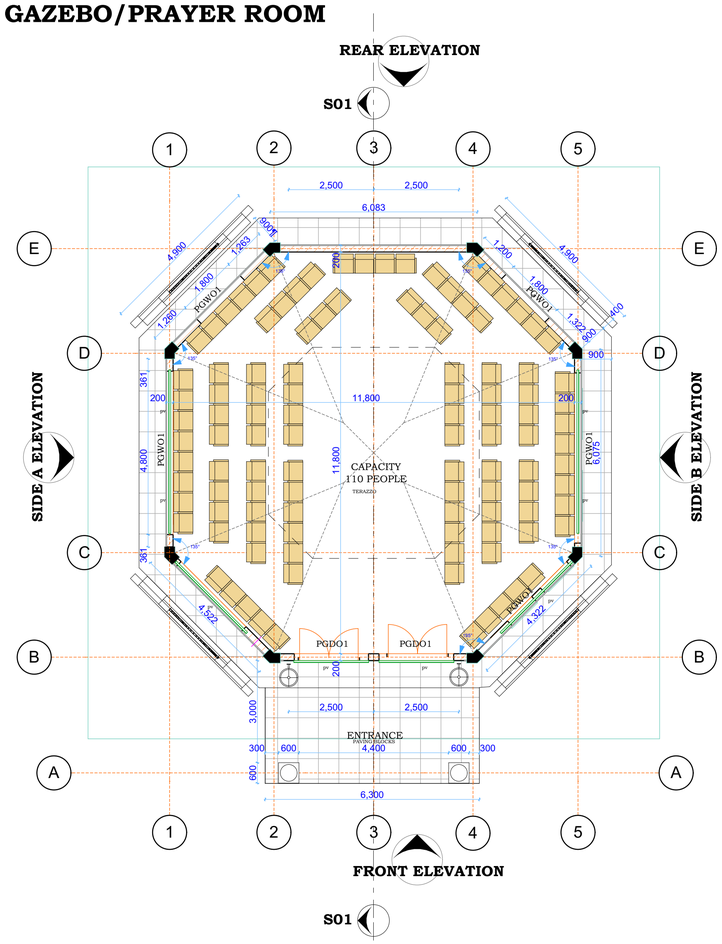

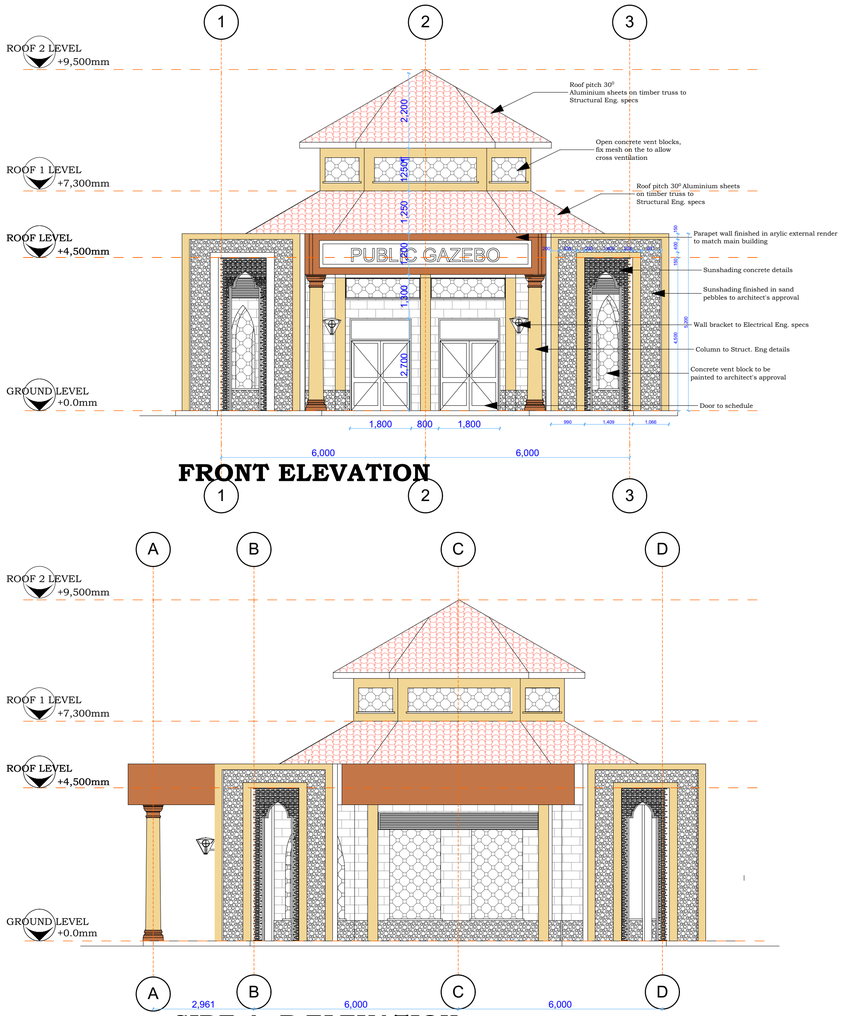

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
PUBLIC GAZEBO
FLOOR LAYOUT PLAN
ELEVATIONS
SECTION

Folio no.
D103 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	
	2	
	3	

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW

Chief Architect Signed






MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES: PUBLIC GAZEBO DOOR SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	QUANTITY	REMARKS
PGDO1	STEEL LOURVES DOUBLE SWING DOOR		Steel door Hollow section frame door handle Mortice lock Hinges Signage	**2**	STEEL CASEMENT DOOR FABRICATED AND FIXED TO ARCHITECT'S DETAILS Standard steel casement door comprising 40x25x3mm stiles, bottom & top rail, & 4 no intermidiate rails all primed with red oxide complete with hinges, stays fasteners, permanent vent with mosquito bet gauze.

TANA RIVER COUNTY EXECUTIVE OFFICES: PUBLIC GAZEBO WINDOW SCHEDULE

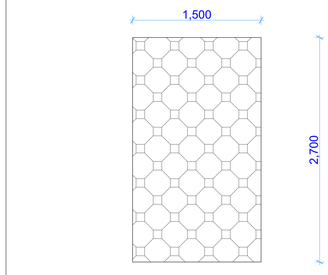PGW00	CONCRETE VENT BLOCKS			**8**	To receive 2 coats of gloss paint to architect's approval. Fix concrete sill
				**4**	
				**4**	
				**6**	
				**4**	

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without expres approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-real, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extingushers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
PUBLIC GAZEBO DOOR & WINDOW SCHEDULE

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale: 1 | 2 | 3

project job no. | **drawing no.**


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		


APPROVED
Architect S.K.Muli OGW


Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

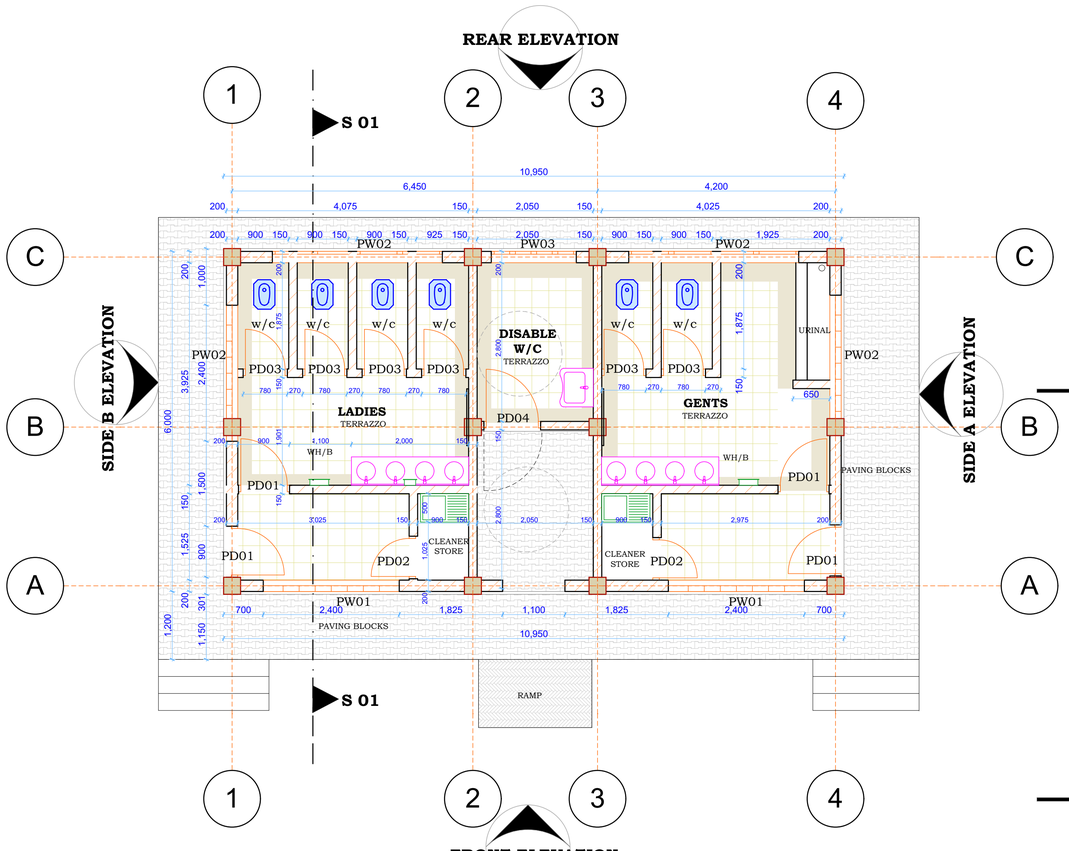

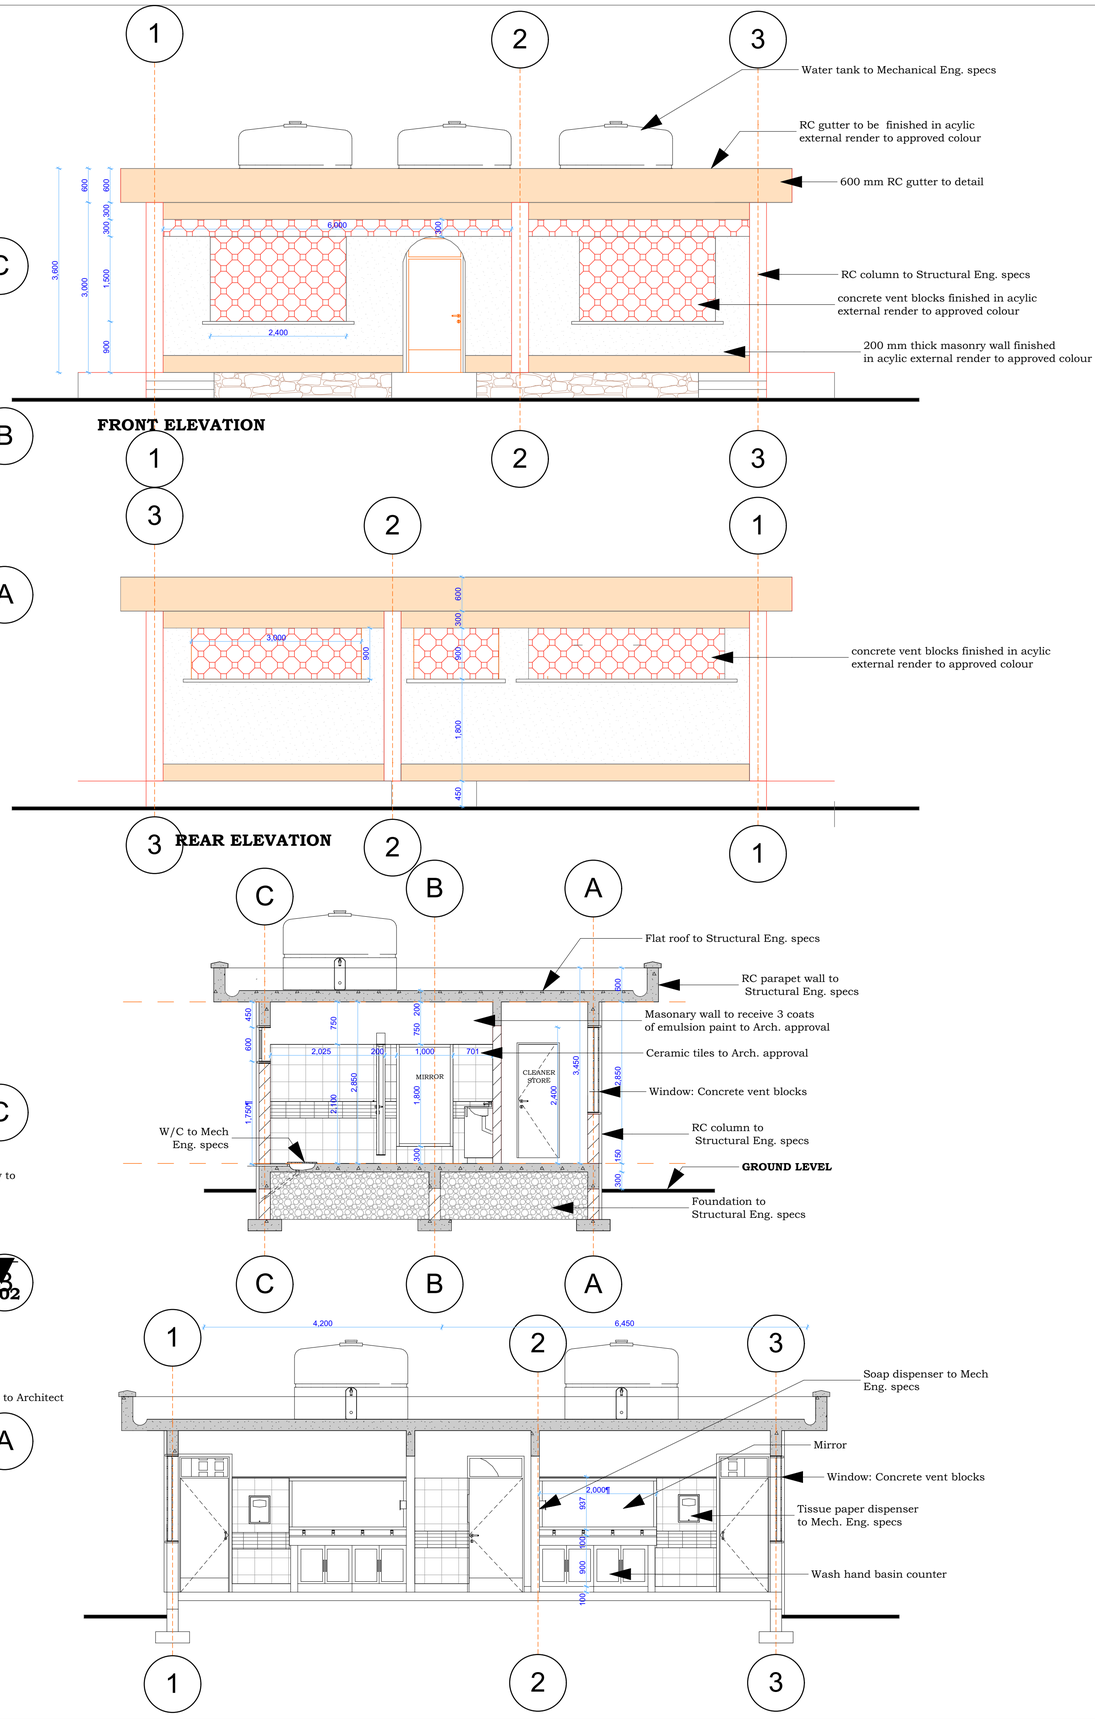

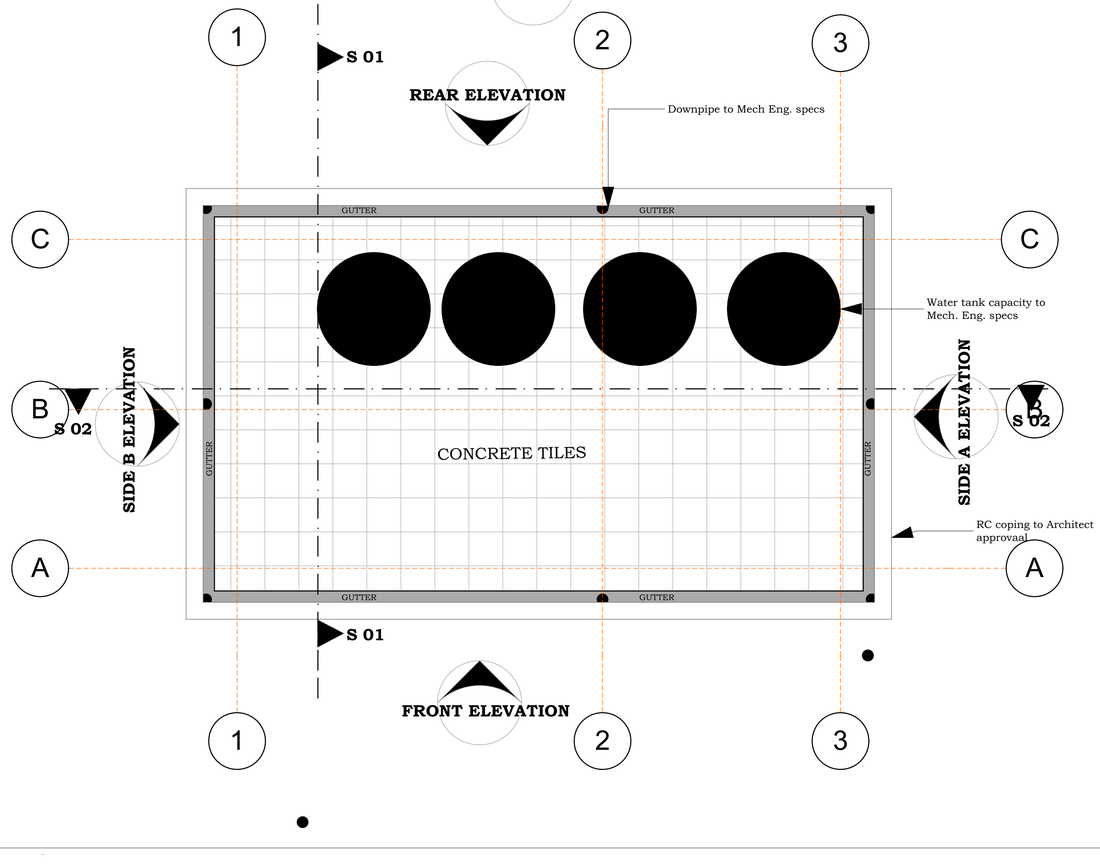

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
PUBLIC TOILET BLOCK LAYOUT PLAN, ROOF PLAN, ELEVATION SECTIONS

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		





APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

TANA RIVER COUNTY EXECUTIVE OFFICES: PUBLIC TOILET SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	QUANTITY	REMARKS
PDO1	FLUSH DOOR 50mm THICK SOLID CORE Overall plywood finished for painting		2 Lever Mortice lock 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt 2 No ss door closer Signage Tower bolt Kickplate	**3**	**Wrot prime grade mahogany door frame** -200x75mm transome with four labours -100x50mm door frame with two labour plugged -100x20mm Architrave -25mm Quadrant -20x20mm glazing bead
PDO2	FLUSH DOOR 50mm THICK SEMI-SOLID CORE Overall plywood finished for painting		2 Lever Mortice lock Bearing ss hinges with screws Door stop complete with 38mm rawl bolt Tower bolt	**2**	
PDO3	FLUSH DOOR 50mm THICK SEMI-SOLID CORE Overall plywood finished for painting		Bearing ss hinges with screws Robe hook Nickel chain Door guard 2 no. pull handle	**6** **3**	
PDO4	FLUSH DOOR 50mm THICK SOLID CORE Overall plywood finished for painting		2 Lever Mortice lock 2 no. Aluminium pull handles Bearing ss hinges with screws Door stop complete with 38mm rawl bolt Signage Tower bolt Kickplate		

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified.
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge
polythene sheeting on 50mm thick murram blinding on
well compacted hardcore. All soils under slabs & around
external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all
building & paved surfaces. All paved surfaces to be
clear of black cotton soil to a distance of 500m
outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE
approval. All walls less than 200mm thick to be reinforced
with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied
with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of
the drainage. Drains passing beneath buildings and driveways
to be encased in 150mm concrete sorround. All underground
foul & waste drain pipes shall be of PVC. to comply with BS5255.
All inspection chambers covers and framing shall be cast iron
to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect,
or SE. All testing of pipes must be cordinated with electrical
& any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-reel, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA
TANA RIVER COUNTY

drawing title
PUBLIC TOILET BLOCK
DOOR SCHEDULE

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale 1 | 2 | 3

project job no. | **drawing no.**


	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed


MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT


FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA

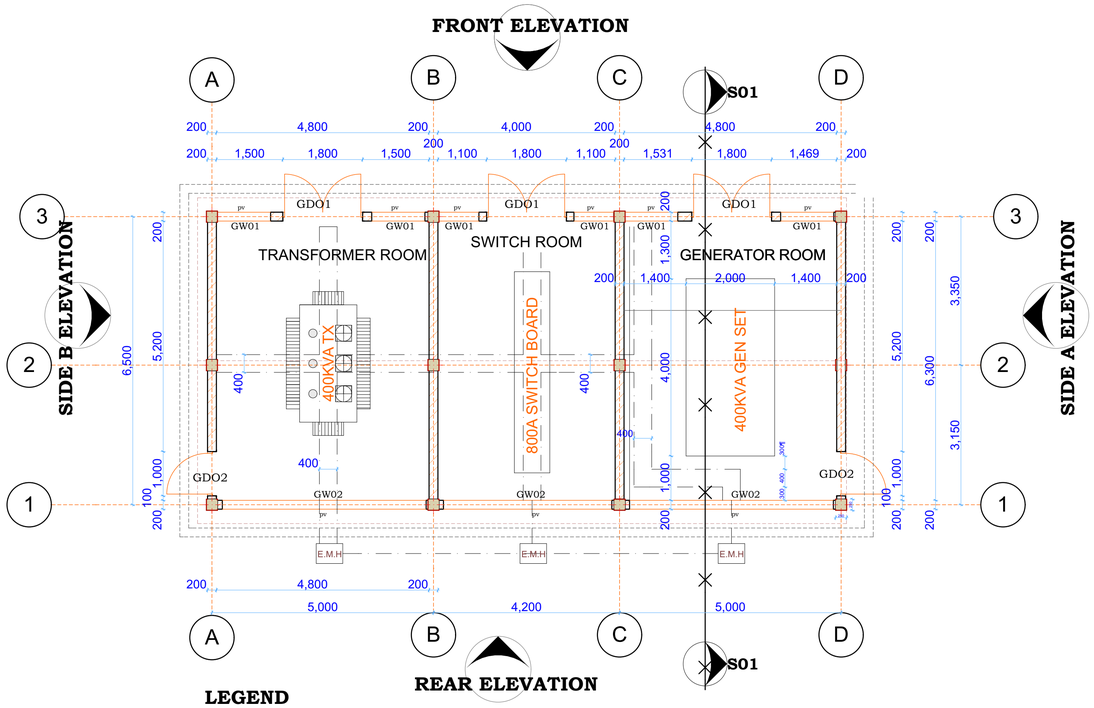


LEGEND




400 CABLE TRENCHES WIDTH 400mm, DEPTH 200mm

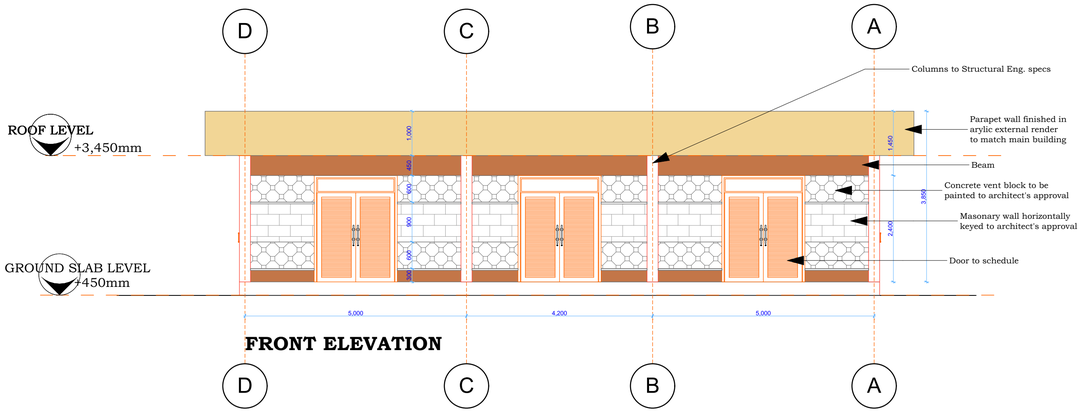

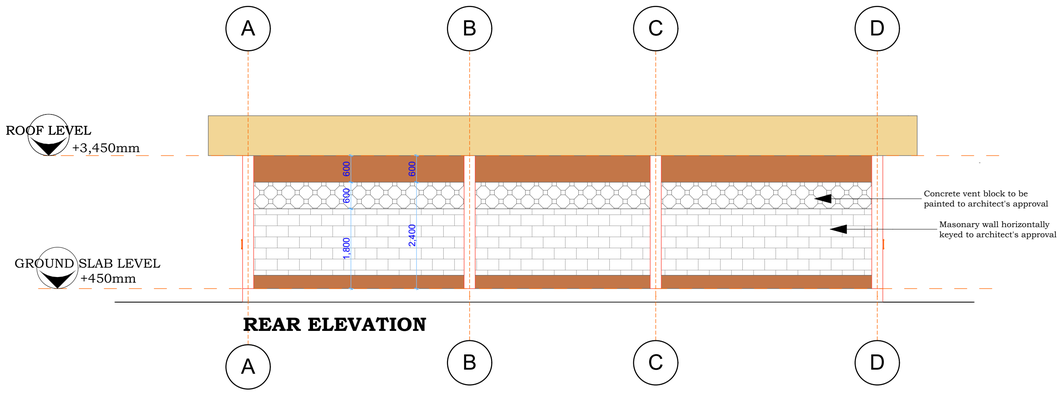

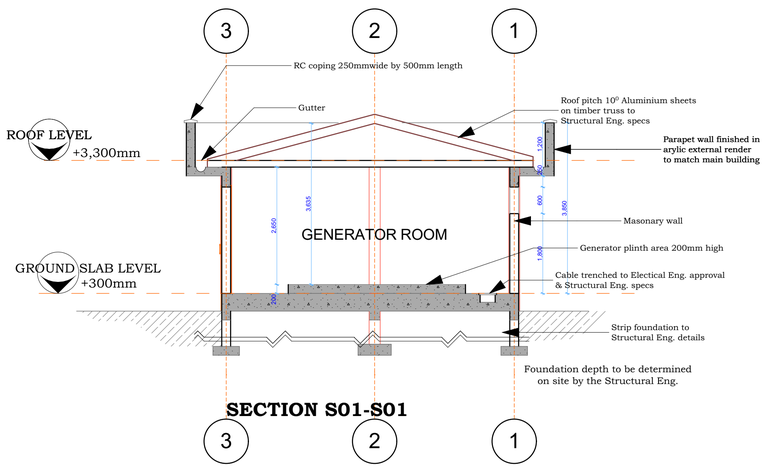

TANA RIVER COUNTY EXECUTIVE OFFICES: GENERATOR HOUSE SCHEDULE

SYMBOL	DESCRIPTION &TYPE	PROFILE& SIZE	IRON MONGERY	QUANTITY	REMARKS
GDO1	STEEL LOURVES DOUBLE SWING DOOR		Steel door Hollow section frame door handle Mortice steel lock Hinges Signage	3	STEEL CASEMENT DOOR FABRICATED AND FIXED TO ARCHITECT'S DETAILS
GDO2	STEEL LOURVES SINGLE SWING DOOR		Steel door Hollow section frame door handle Mortice steel lock Hinges Signage	2	
GW01	CONCRETE VENT BLOCKS		Concrete vent block	6	To receive 2 coat of gloss paint to architect's approval
GW02	CONCRETE VENT BLOCKS			3	

NOTES

general

This drawing is to be read in conjuction with engineers' drawings
All dimensions are in mm unless otherwise specified,
drawings are not to be scaled. Only figured dimensions to
to be used. The contractor must check & verify all the
dimensions before commencement of the work.

construction

All slabs at ground level to be layed over 1000 gauge polythene sheeting on 50mm thick murram blinding on well compacted hardcore. All soils under slabs & around external foundation to be poised for the termites control.

structural

All black cotton soil to be removed from below all building & paved surfaces. All paved surfaces to be clear of black cotton soil to a distance of 500m outside the edge of the surface.

For all R.C works, refer to SE's details.
Foundation depths to be determined on site to the SE approval. All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
All adjacent R.C work and masonry walls to be tied with strap irons at every course.

mechanical

All plumbing & drainage work to comply with P.H specifications.
All surface ducts to be accessible from all floors.
S.V.P denotes soil vent pipe and to be provided at the head of the drainage. Drains passing beneath buildings and driveways to be encased in 150mm concrete sorround. All underground foul & waste drain pipes shall be of PVC. to comply with BS3255.
All inspection chambers covers and framing shall be cast iron to comply with BS.497 Table 2 Grade A.
The storm water drain pipes to comply with BS. 556.
Minimum slope in the drain pipes to be 1%
No chases for pipes will be allowed in the slabs.
Sleeves will be allowed with written approval from the SE
No cutting of concrete without express approval of the Architect, or SE. All testing of pipes must be cordinated with electrical & any conflicts must be clarified before works begins.
P.V denotes permanent vents.

electrical

All conduits must be laid before plastering.

fire fighting

Provide a 1130 litres reserve tank with a booster pump
Dry risers
Provide a 1x30m hydraulic Hose-real, on every floor.
\Provide manual/ electric break glass fire alarm system.
Provide 4x9kg litres water CO2 fire extinguishers on every floor

revisions

project
PROPOSED COUNTY EXECUTIVE HEADQUARTER'S OFFICE, AT HOLA TANA RIVER COUNTY

drawing title
GENERATOR HOUSE

Folio no.
D1O3 CO/TNA/1601 Job No. 9951 A

client ministry/department
TANA RIVER COUNTY

client signature

code

scale		
	1	1:50
	2	
	3	

project job no. | **drawing no.**

	name	signed	date
Drawn & Designed by	Arch Hellen .M.K		
Checked by	Arch. P. Karumi		
Team leader	Arch. M. Nguuri		

APPROVED
Architect S.K.Muli OGW

Chief Architect Signed

MINISTRY OF TRANSPORT, INFRASTRUCTURE, HOUSING AND URBAN DEVELOPMENT
STATE DEPARTMENT OF PUBLIC WORKS
ARCHITECTURAL DEPARTMENT

FOR THE GOVERNMENT OF THE REPUBLIC OF KENYA