

Certificate

FOXESS CO.,LTD.
No.939. Jinhai Third Road, New Airport Industry Area,
Longwen District. Wenzhou, Zhejiang,
China

Type of unit	Energy storage system	
Description of unit	TM215kWh-100kW-2hF, GM215kWh-100kW-2hF	
Technical data	Detail see the ANNEX	
Certification scheme	P30VA01 Rev. 09/11.24	TÜV NORD: Certification Process for Grid Integration Certification
Standard	CEI 0-21: 2022-03 CEI 0-21; V1:2022-11 CEI 0-21; V2:2024-01 CEI 0-21; V2/EC:2024-03 CEI 0-21; V2/EC2:2025-02	Reference technical rules for the connection of active and passive users to the LV networks of electrical distribution companies

Certificate Registration No. 44 876 23053402
Audit Report No. 3542 0991

Valid from 2026-03-27
Type 1a Certificate

The generating unit complies with the requirements contained in the certification programmes and standards and directives listed above, with restrictions. Further details and technical data can be found in the annex 1, consisting of 4 pages.

Essen, 2026-03-27
Rev. 1.0



Certification Body at TÜV NORD CERT GmbH

TÜV NORD CERT GmbH
Am TÜV 1, 45307 Essen, Germany
www.tuev-nord-cert.com

TÜV®



Annex

to Certificate Registration No. 44 876 23053402


Rev.1.0

CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21; V2/EC2:2024-03, CEI 0-21; V2/EC:2025-02

FOXESS CO.,LTD.

**No.939. Jinhai Third Road, New Airport Industry Area,
Longwen District. Wenzhou, Zhejiang,
China**

Schematic structure

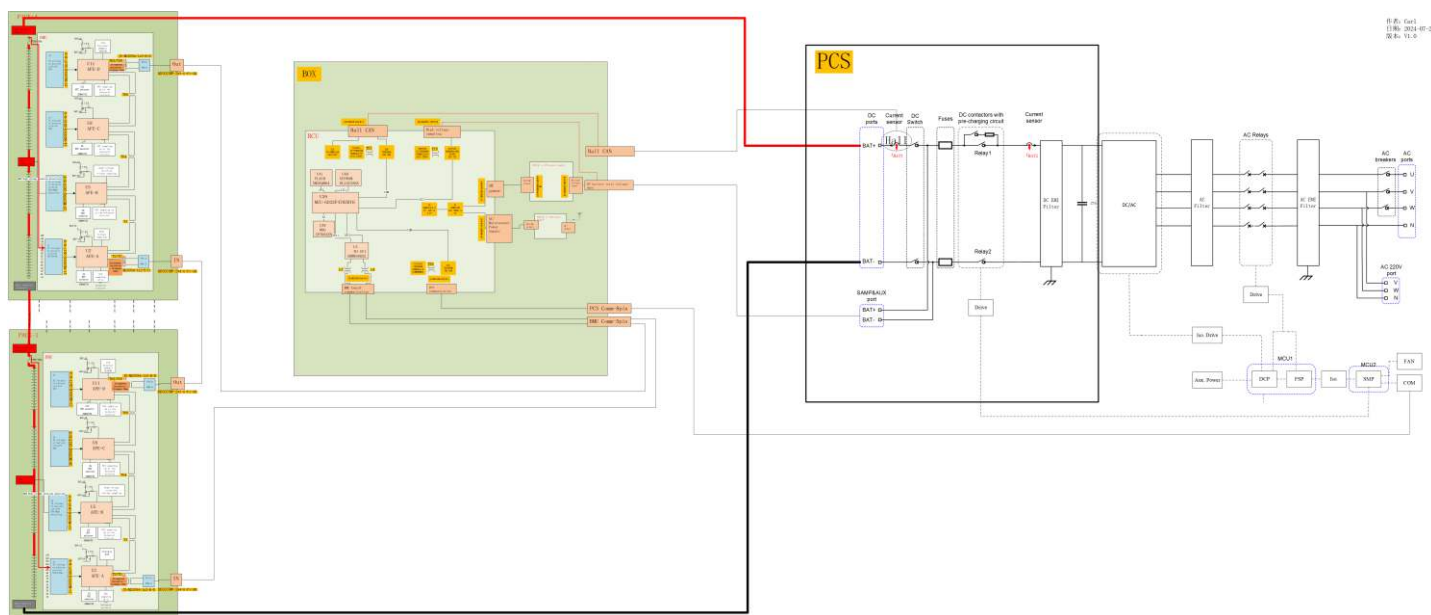

Annex

to Certificate Registration No. 44 876 23053402

Rev.1.0

**CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21;
V2/EC2:2024-03, CEI 0-21; V2/EC:2025-02**

Technical Data

General information

General	
Type of EZE	Energy Storage System
Designation	TM215kWh-100kW-2hF, GM215kWh-100kW-2hF
On-grid variables	
Rated apparent power	100000 VA 110000 VA (max)
Rated effective power	100000 W 110000 W (max)
Rated voltage	230/400 V, 3L/N/PE
Max. AC Current	167 A
Reactive power adjustment range $\cos \varphi$	0.8 lagging – 0.8 leading
Rated frequency f_n	50/60 Hz
Overvoltage-category	III
Battery – Input Variables	
Battery Type	LFP
DC Voltage range	672 ~ 876 V
Max. Charge/Discharge Current	140 A
Overvoltage-category	II
PCS	
Manufacturer	FOXESS CO., LTD.
Model	M-PCS-100
Generation unit Control	
Manufacturer	FOXESS CO., LTD.
Software version	PCS: DSP V6.02.4; ARM V1.02.9; CPLD V1.00.2 Battery: V1.2

Annex

to Certificate Registration No. 44 876 23053402

Rev.1.0

**CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21;
V2/EC2:2024-03, CEI 0-21; V2/EC:2025-02**

Remark: The inverters listed above may be installed with the following batteries:

	FOXESS CO., LTD.
BMS Version	Firmware version of BCU: R1.003_V1.3.03 Firmware version of BMU: V1.1 Software Version: V1.2
Accumulator Model / Battery Model	GM-PACK-54
Capacity of each battery module	53.76 kWh
Number(s) of battery modules recommended by the manufacturer	4
Battery module working voltage range	168.0 V-219.0 V

Notes

The manufacturer has proven for the manufacturing facility of the Unit a certification of its quality management system according to ISO 9001. The manufacturer confirmed in a manufacturer declaration that the certification of the management system will be valid parallel to the period of this unit certification.

The use of other firmware and software version numbers is allowed if the differences are proved and confirmed by TÜV NORD CERT GmbH beforehand. Validity of a new software version is attested by written confirmation and becomes part of the certificate.

This product is suitable for:

- ☒ Interface device
- ☒ Interface protection
- ☒ Static conversion device
- ☐ Rotary generation device

Remark: The device is for plants of greater than 11.08kW.

Annex

to Certificate Registration No. 44 876 23053402

Rev.1.0

**CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21;
V2/EC2:2024-03, CEI 0-21; V2/EC:2025-02**

Testing laboratory:

Suzhou Tuzhe Technology Co.,Ltd.

1/F., Plant 5, No. 118, Shengpu Road, Suzhou Industrial Park, Suzhou, Jiangsu, China

Accredited by CNAS according to ISO/IEC 17025:2017, certificate no. CNAS L24324

Conclusion:

After verifying the following documents, it is concluded that the product is in compliance with the requirements of CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21; V2/EC:2024-03, CEI 0-21; V2/EC2:2025-02:

☒ ISO 9001 certificate:

Certificate no. 201838, issued by DCI Certification Ltd

☒ Test report of CEI 0-21: 2022-03, CEI 0-21; V1:2022-11, CEI 0-21; V2:2024-01, CEI 0-21; V2/EC:2024-03, CEI 0-21; V2/EC2:2025-02:

Report no. TZ-20260100002-1, issued by Suzhou Tuzhe Technology Co.,Ltd., accredited by CNAS according to ISO/IEC 17025:2017, certificate no. CNAS L24324

☒ Test report of EN IEC 61000-6-2:2019, EN IEC 61000-6-4:2019.

Report no. SET-20251223G34452 issued by CCIC Southern Testing CO., Ltd. accredited by CNAS according to ISO/IEC 17025:2017, certificate no. CNAS L1659

Test report of IEC 61000-4-16:2015, IEC 61000-4-18:2019, IEC 61000-4-29:2000. Report no. (2026)SJSXW-WT00120 issued by Jiangsu Product Quality Testing & Inspection Institute accredited by CNAS according to ISO/IEC 17025:2017, certificate no. CNAS L1000

Restrictions

None

Appendix to the certificate

A1 Assessment report no. 35420991 version V1.0

A2 Manufacturer declaration for TM215kWh-100kW-2hF, GM215kWh-100kW-2hF from Mar.11.2026

End of the List

Essen, 2026-03-27

Certification Body at TÜV NORD CERT GmbH