



Load Rating ^(A)	Min Top Cover/ Max. Burial Depth (SC) ^(B)	Min Top Cover/ Max. Burial Depth (EX) ^(C)	Soil Compaction (SP) Minimum ^(D)	Compacted Backfill Lifts Min. / Max. ^(E)
Light Duty < 2,500 lbs	12 inches / 14.4 feet	12 inches / 26.2 feet	90% SP (Standard Proctor)	6 in. /12 in.
H-10 Traffic Loading	12 inches / 14.4 feet	12 inches / 26.2 feet	95% SP (Standard Proctor)	6 in. /12 in.
HS-20 Traffic Loading	18 inches ¹ / 14.4 feet	16 inches ² / 26.2 feet	95% SP (Standard Proctor)	6 in. /12 in.
HS-25 Traffic Loading	30 inches / 14.1 feet	22 inches / 26.1 feet	98% SP (Standard Proctor)	6 in. /12 in.

Additional Notes	¹ 18 inches based on 10" x 10" contact area	² 16 inches based on 9" x 9" contact area	Each project must conduct a stress analysis to ensure the system's stability based on the actual loads, soil type and water table involved. Wavin recommends a minimum cover of 12 inches over the top of the tank. For details on use in the standard (SC) or extra strong (EX) versions, or if you need further information, contact your local Wavin representative directly.
------------------	--	--	--

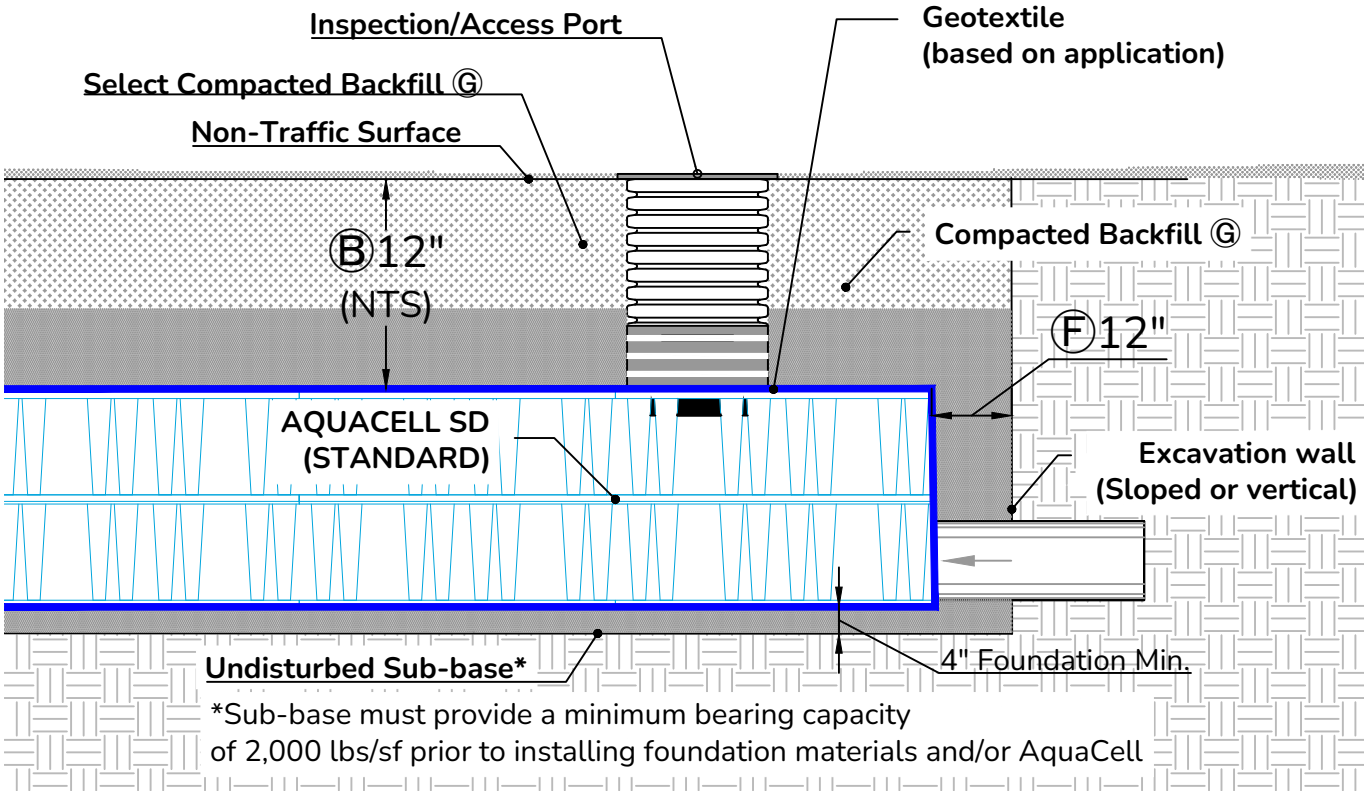

- Notes:
- A. AASHTO ratings follow standard classification of truck axle loading weights for live loads.
 - B. Reference **Cover and Burial Depths by Configuration (AQ-100-08)** and **AquaCell Installation Guide** for further information and instructions related to installation depths.
 - C. **AquaCell Extra Strong (EX)** consists of two base units inset within each other. Reference **TB101 & TB102 Load Capacity Testing Results** for additional information.
 - D. On-site soil compaction minimum percentage of **Standard Proctor Density (SP)** per **ASTM D698** and **ASTM D1557** as applicable.
 - E. Reference **Construction Loads over AquaCell System (AQ-100-20)** and **AquaCell Installation Guide** for guidelines on compaction and machinery used during installation.
 - F. The minimum width of sidewall backfill is **12 inches** or large enough to accommodate selected compaction equipment, whichever is greater.
 - G. Reference **Backfill Materials Table (AQ-100-01)** for recommended materials, AASHTO designations.

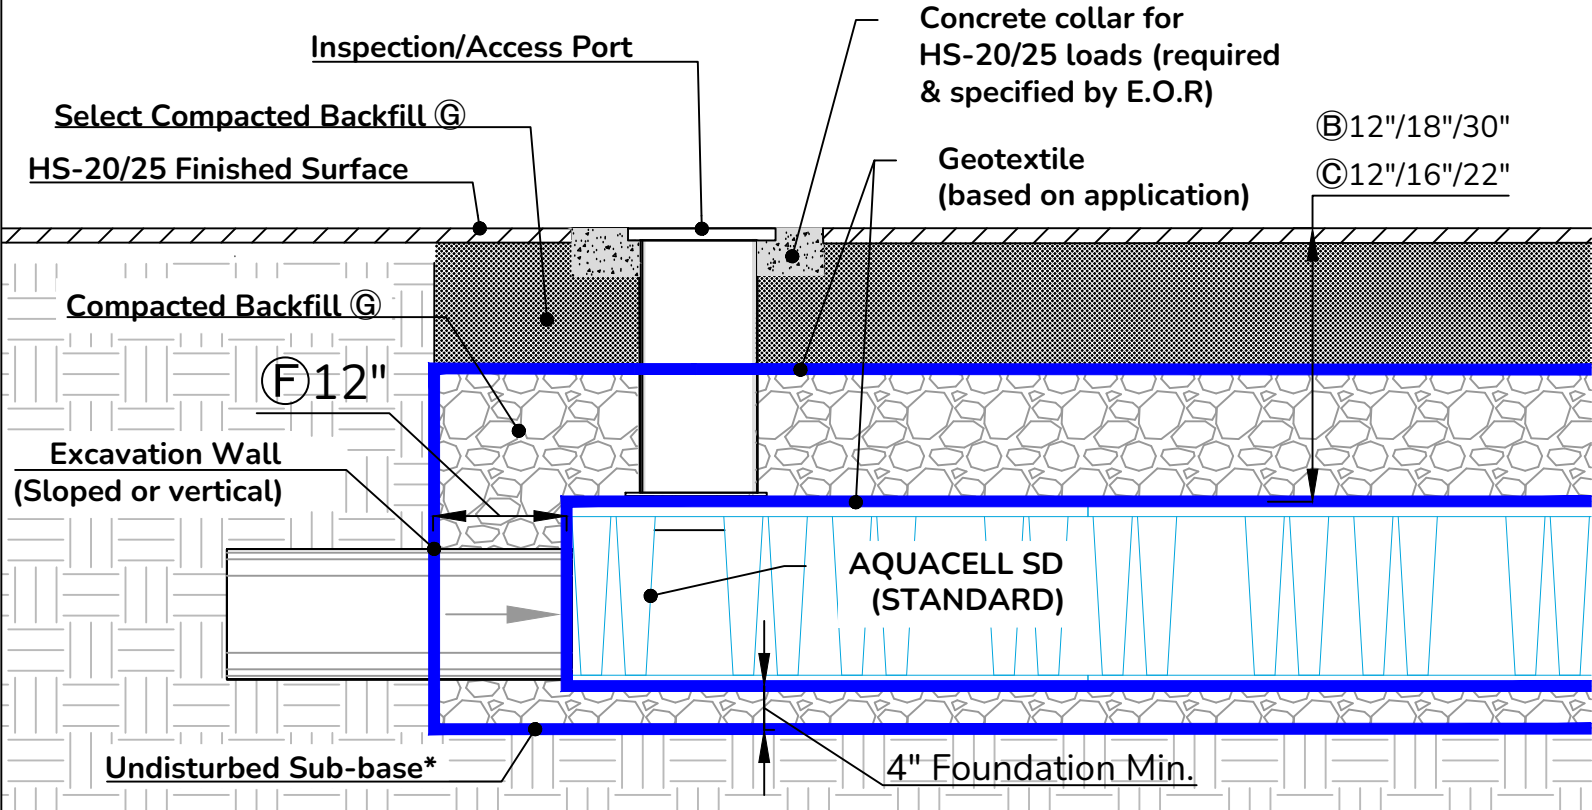

Managing water better since 1955.
950 Winter Street
Waltham, MA 02451
wavin.us
wavintechsupport@orbia.com



The design details/specifications presented in this document are for informational purposes only and are subject to change without notice. Responsibility for design of any AquaCell system rests solely with the original design engineer of record. For questions, contact: wavintechsupport@orbia.com			
Title: AquaCell Installation Min. Loading & Depth Requirements			
Date: 10/28/2025	Scale: NTS	Drawing: AQ-100-02	Rev: 4
Drawn: HJD	Approved: JS	Sheet: 1 of 1	