




Notes

1. For HS-20 applications, a minimum of 24" from top of permeable block surface to top of **AquaCell** tank is required⁹.
2. For side and cover backfill clean stone $\leq 1.5"$ in size or soil classified as GW, GP, SW, or SP according to the USCS should be used.
3. Ensure there is a minimum of 18" between the top of the **AquaCell** and the bottom of the permeable blocks
 - 3.1. For backfill laid directly below the permeable pavers, provide a minimum 6" of free-draining backfill.
 - 3.2. For backfill directly over the AquaCell tank, provide a minimum of 12" free-draining backfill.
4. Distribute the backfill evenly to prevent any movement of the **AquaCell** tank.
 - 4.1. Compact the side backfill in 12" lifts when using permeable block system.
5. Install two (2) layers of an integrally formed biaxial geogrid directly **below** the permeable blocks **and** 12" above the **AquaCell** tank.
6. Adjacent panels of geogrid should overlap by a minimum of 18". The geogrid must extend at least 3 ft. beyond the excavation footprint.
7. Always maintain at least 12" of cover between backfill equipment (reference AQ-100-20) and the top of the **AquaCell** tank. For optimal results, extend the cover to 14" to ensure the minimum 12" protection is kept.
8. The total height of the top backfill should not exceed 7 ft. If a backfill height > 7 ft. or $< 18"$ is needed, contact: wavintechsupport@orbia.com.
9. Reference **AquaCell Installation Guide** for instructions specific to installing the **AquaCell** Tank system.

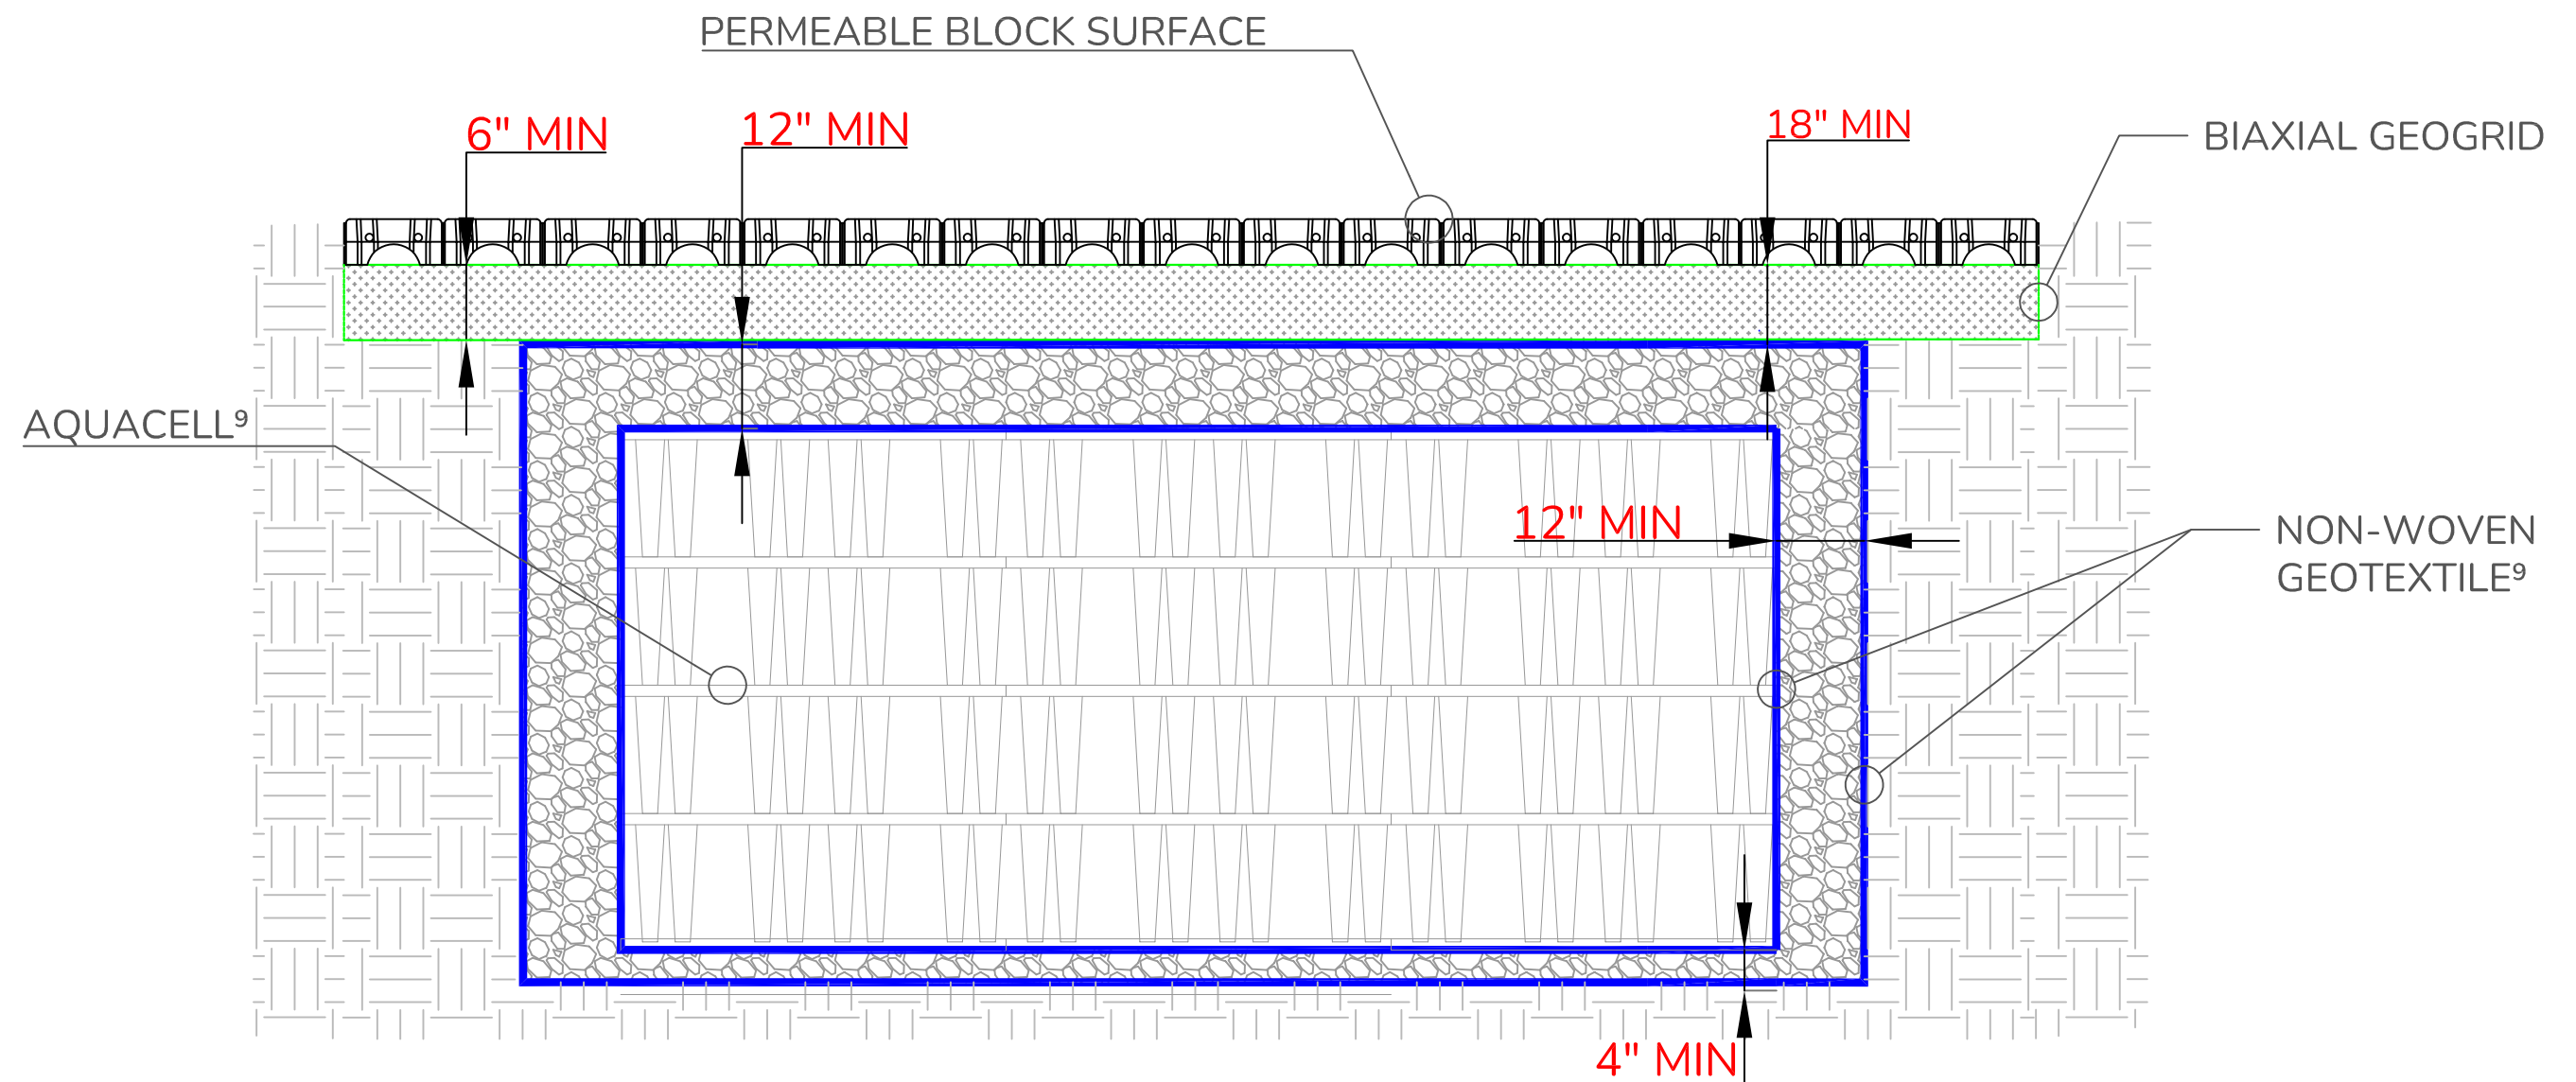

Managing water better since 1955.

950 Winter Street
Waltham, MA 02451

wavin.us
wavintechsupport@orbia.com



The design details/specifications presented in this document are for informational purposes only and are subject to change without notice. Responsibility for design of any AquaCell system rests solely with the original design engineer of record. For questions, contact: wavintechsupport@orbia.com

Title: **AquaCell with Permeable Block Surface**

Date: **2/18/2025**

Scale: **NTS**

Rev: **2**

Drawn: **HJD**

Approved: **JS**

Drawing: **AQ-100-21**