




**Notes:**

- 1. Minimum linear distance required between structure and AquaCell crate must be a minimum of 12 inches OR half the diameter of the pipe, whichever is greater.
- 2. Reference **AQ-100-04 AquaCell Adapter & Pipe Connection Detail** for methods of connecting pipe to AquaCell crate.
- 3. Reference **AquaCell Installation Guide** for further information and instruction on vertical & horizontal pipe connections.

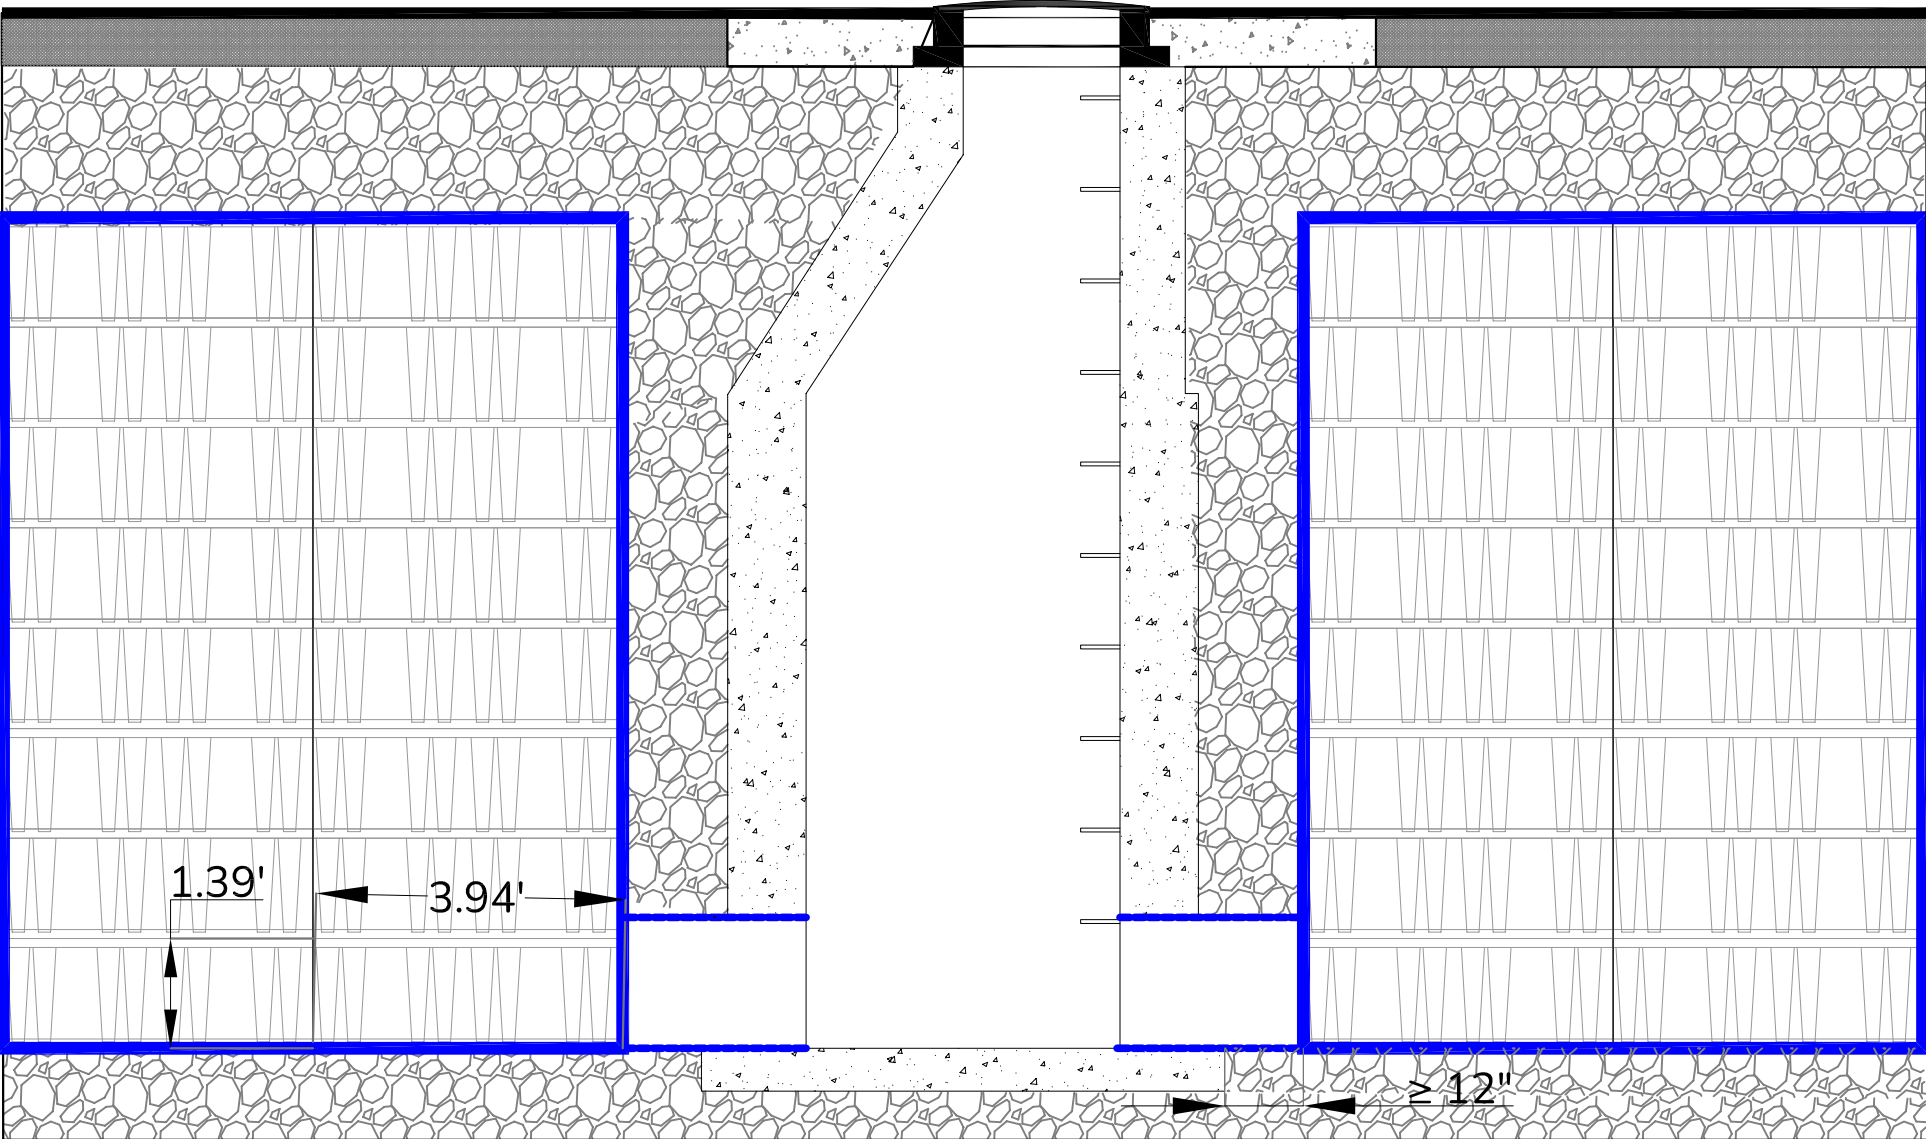

**Managing water better since 1955.**

950 Winter Street  
Waltham, MA 02451  
wavin.us  
wavintechsupport@orbia.com

The design details/specifications presented in this document are for informational purposes only and are subject to change without notice. Responsibility for design of any AquaCell system rests solely with the original design engineer of record. For questions, contact: wavintechsupport@orbia.com

|                                                                    |            |                    |        |
|--------------------------------------------------------------------|------------|--------------------|--------|
| Title: AquaCell Min. Pipe Installation Distance from Inlet/Manhole |            |                    |        |
| Date: 3/21/2025                                                    | Scale: NTS | Drawing: AQ-100-24 | Rev: 0 |
| Drawn: HJD                                                         | Approved:  | Sheet: 1 of 1      |        |