

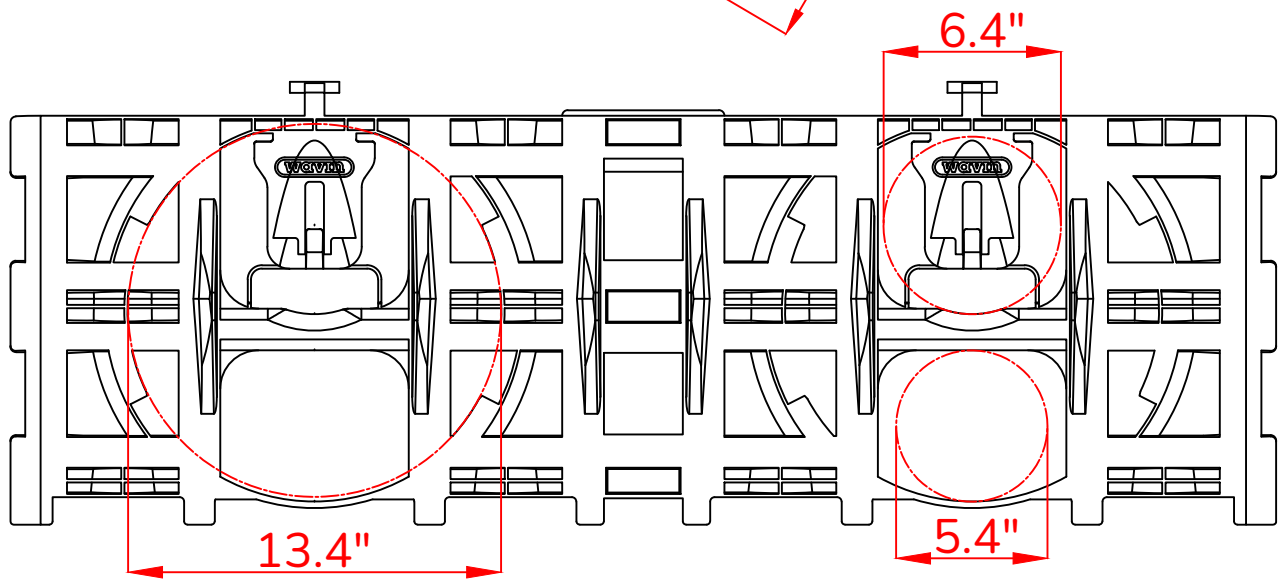


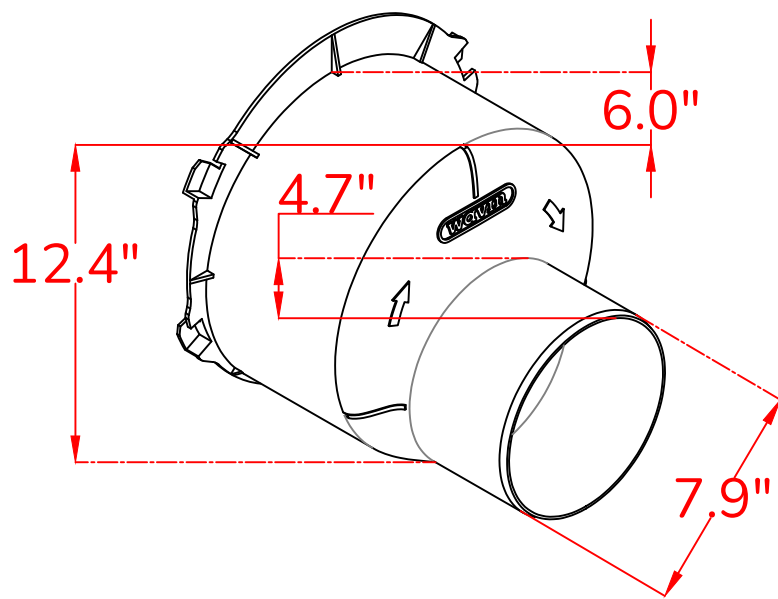

Notes

1. **AquaCell Side Plate (2476600003)** contains two integrated 6" pipe inlets (6.4" OD) with stoppers. Use 6" PVC SDR-26/35 (ASTM D3034) for connection to **AquaCell** tank⁵.
2. **AquaCell 8-12" Pipe Connector (2476631200)**
 - 2.1. To connect 8" pipe to **8-12" Pipe Connector** spigot (7.9" OD), use PVC SDR-26/35, SCH. 40, or HDPE pipe. Additional coupler / pipe solvent may be needed (provided by others).
3. To connect 12" pipe to the 12" spigot (12.4" OD) connection on **8-12" Pipe Connector**:
 - 3.1. Existing 8" eccentric spigot end on adapter should be cut and removed entirely, creating a 12" spigot end ready to connect 12" pipe to the **AquaCell Side Plate**.
 - 3.2. Use gasketed bell end of 12" PVC SDR/26-35 pipe or adapter and install directly over the 12" spigot (provided by others).
 - 3.3. For 12" connections having dissimilar material, use a 12.5" flexible rubber coupler or corrosion-resistant mastic tape to weld pipe to **8-12" Pipe Connector** (provided by others).
4. Reference **AQ-200-02 AquaCell Compatible Pipe Connections** detail for information regarding compatible pipe types to **8-12" Pipe Connector**.
5. Reference **AQ-100-22 Six-inch PVC Pipe to AquaCell Side Panel Detail** (Note 1)
6. Reference **AquaCell Installation Brochure** for further information regarding pipe connections to **AquaCell** system.

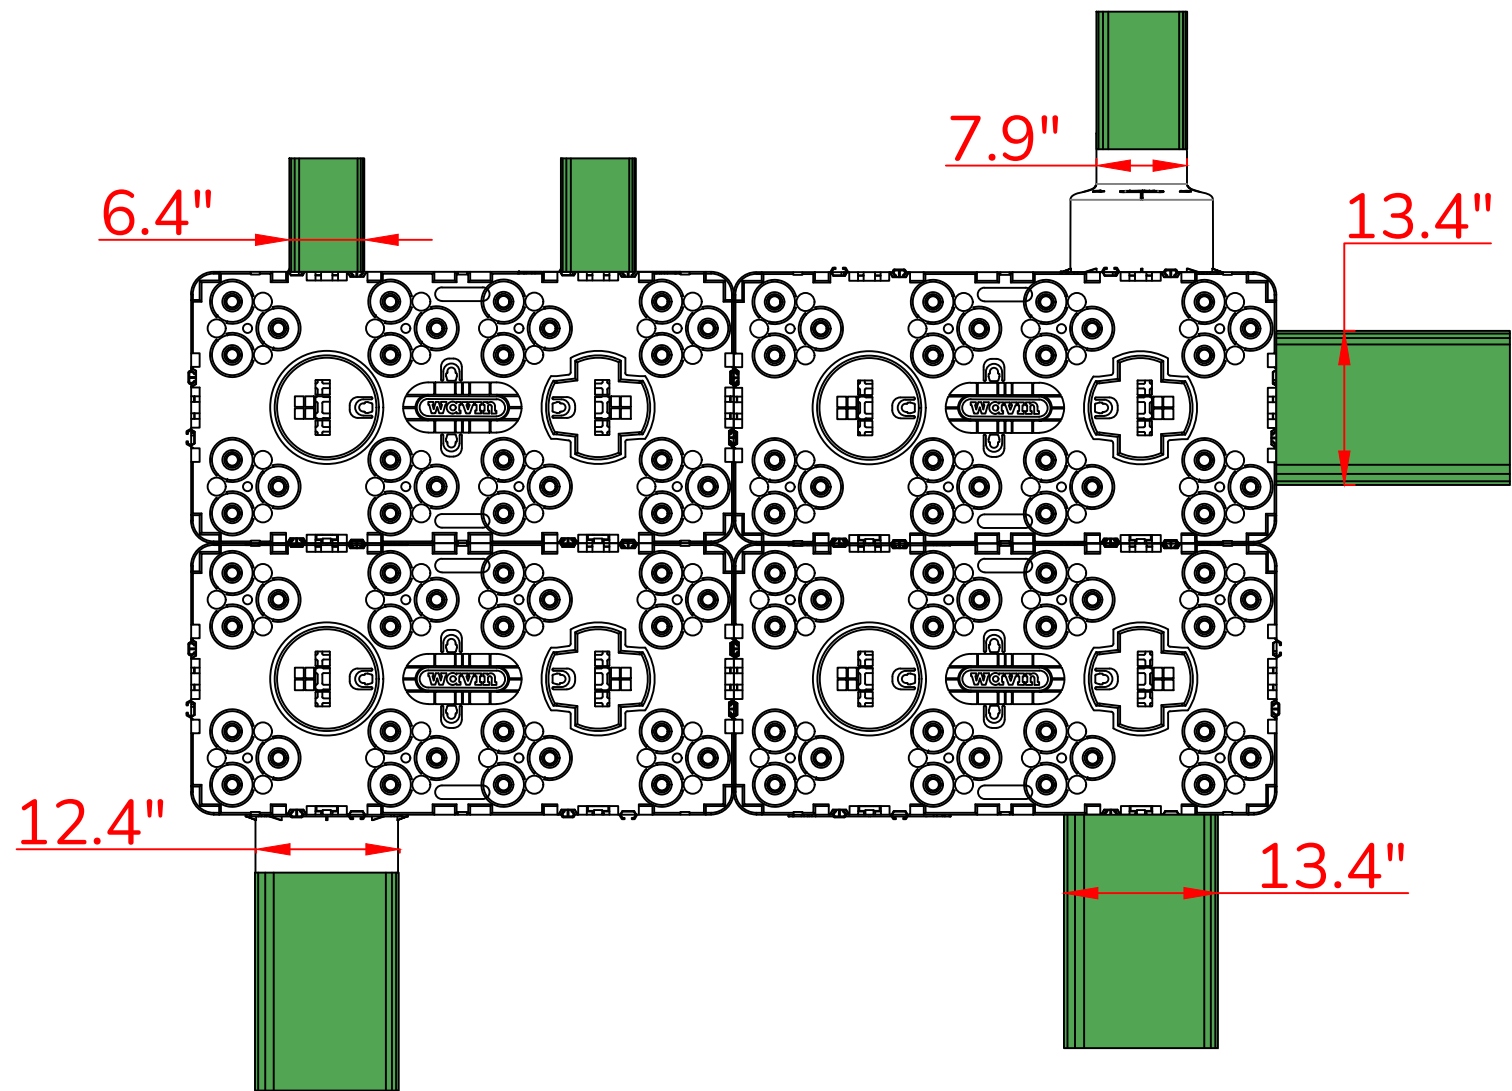

Managing water better since 1955.
950 Winter Street
Waltham, MA 02451
wavin.us
wavintechsupport@orbia.com



The design details/specifications presented in this document are for informational purposes only and are subject to change without notice. Responsibility for design of any AquaCell system rests solely with the original design engineer of record. For questions, contact:
wavintechsupport@orbia.com

Title: **AquaCell Connections by Pipe Type**

Date: 8/5/2025	Scale: NTS	Rev: 2
Drawn: HJD	Approved: JS	Drawing: AQ-100-07