



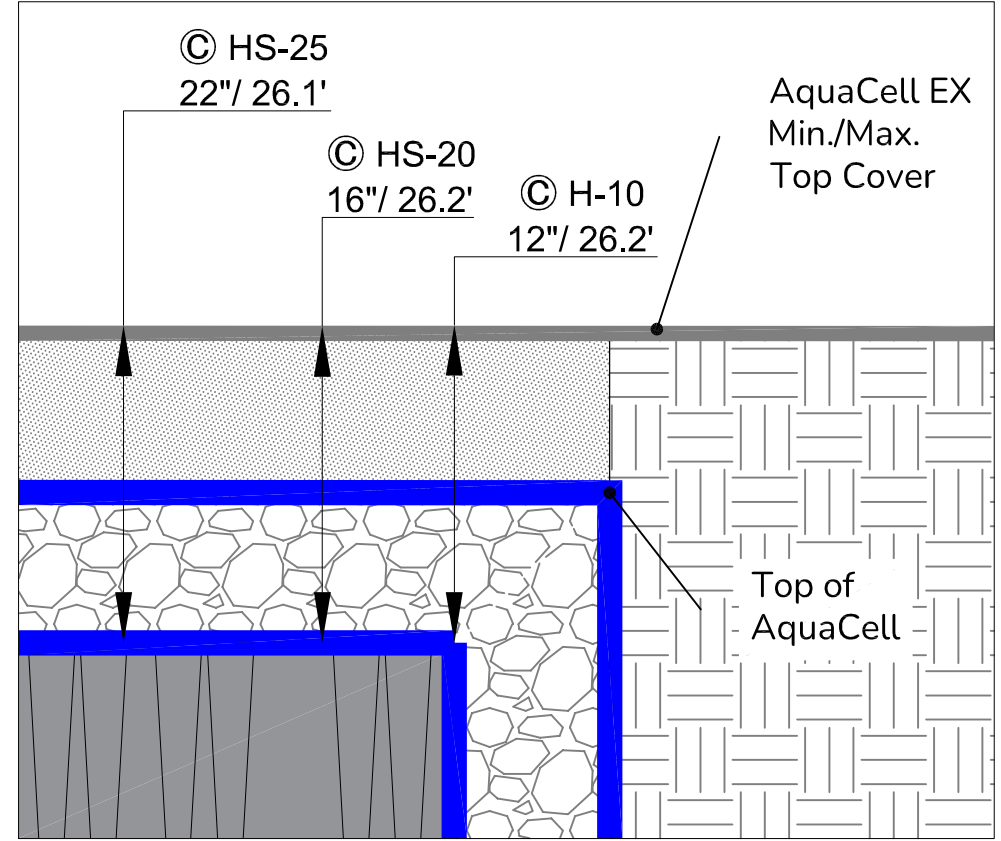

Notes - Window of Application*

- A. AquaCell units can be stacked to a maximum of eight (8) layers for an underground stormwater retention/detention system
- B. For a single (1) AquaCell Standard (SC) unit meeting AASHTO H10, HS-20, maximum cover depth above top of tank is 14.4' below finished surface level.
 - B.A. For a single SC unit meeting AASHTO HS-25, maximum cover depth above top of tank is 14.1' below finished surface level.
- C. For a single (1) AquaCell Extra Strong (EX) unit meeting AASHTO H10, HS-20, maximum cover depth above top of tank is 26.2' below finished surface level.
 - C.A. For a single EX unit meeting AASHTO HS-25, maximum cover depth above top of tank is 26.1' below finished surface level.
- D. *General indication for installation above groundwater level, according to instructions for single layer tanks. For multi-layer tanks, the window of application may be limited.
- D.A. Wavin always recommends a minimum cover of 12 inches (0.3m). For specific projects, seek advice from Wavin.
- E. Reference AquaCell Installation Guide for further information and instructions related to installation depths.

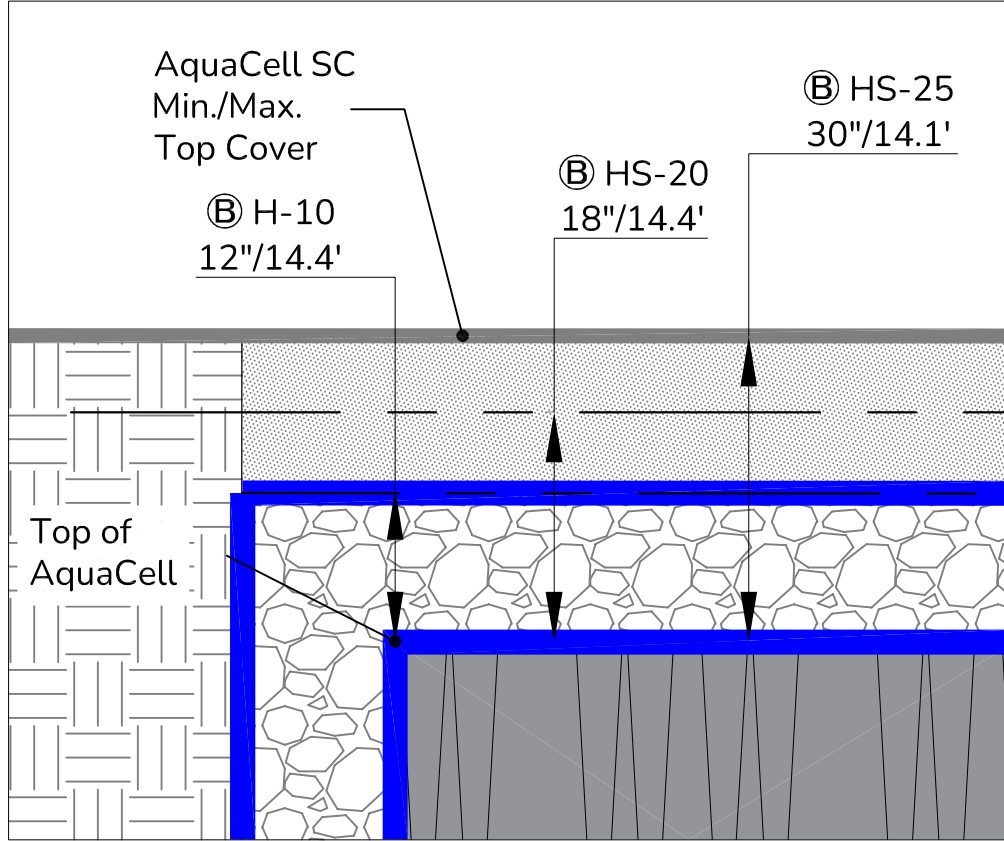

Managing water better since 1955.
 950 Winter Street
 Waltham, MA 02451
 wavin.us
 wavintechsupport@orbia.com



The design details/specifications presented in this document are for informational purposes only and are subject to change without notice. Responsibility for design of any AquaCell system rests solely with the original design engineer of record. For questions, contact: wavintechsupport@orbia.com			
Title: AquaCell Cover & Burial Depths-Standard & EX Models			
Date: 4/1/2026	Scale: NTS	Drawing: AQ-100-08	Rev: 2
Drawn: HJD	Approved: JS	Sheet: Sheet 1 of 2	