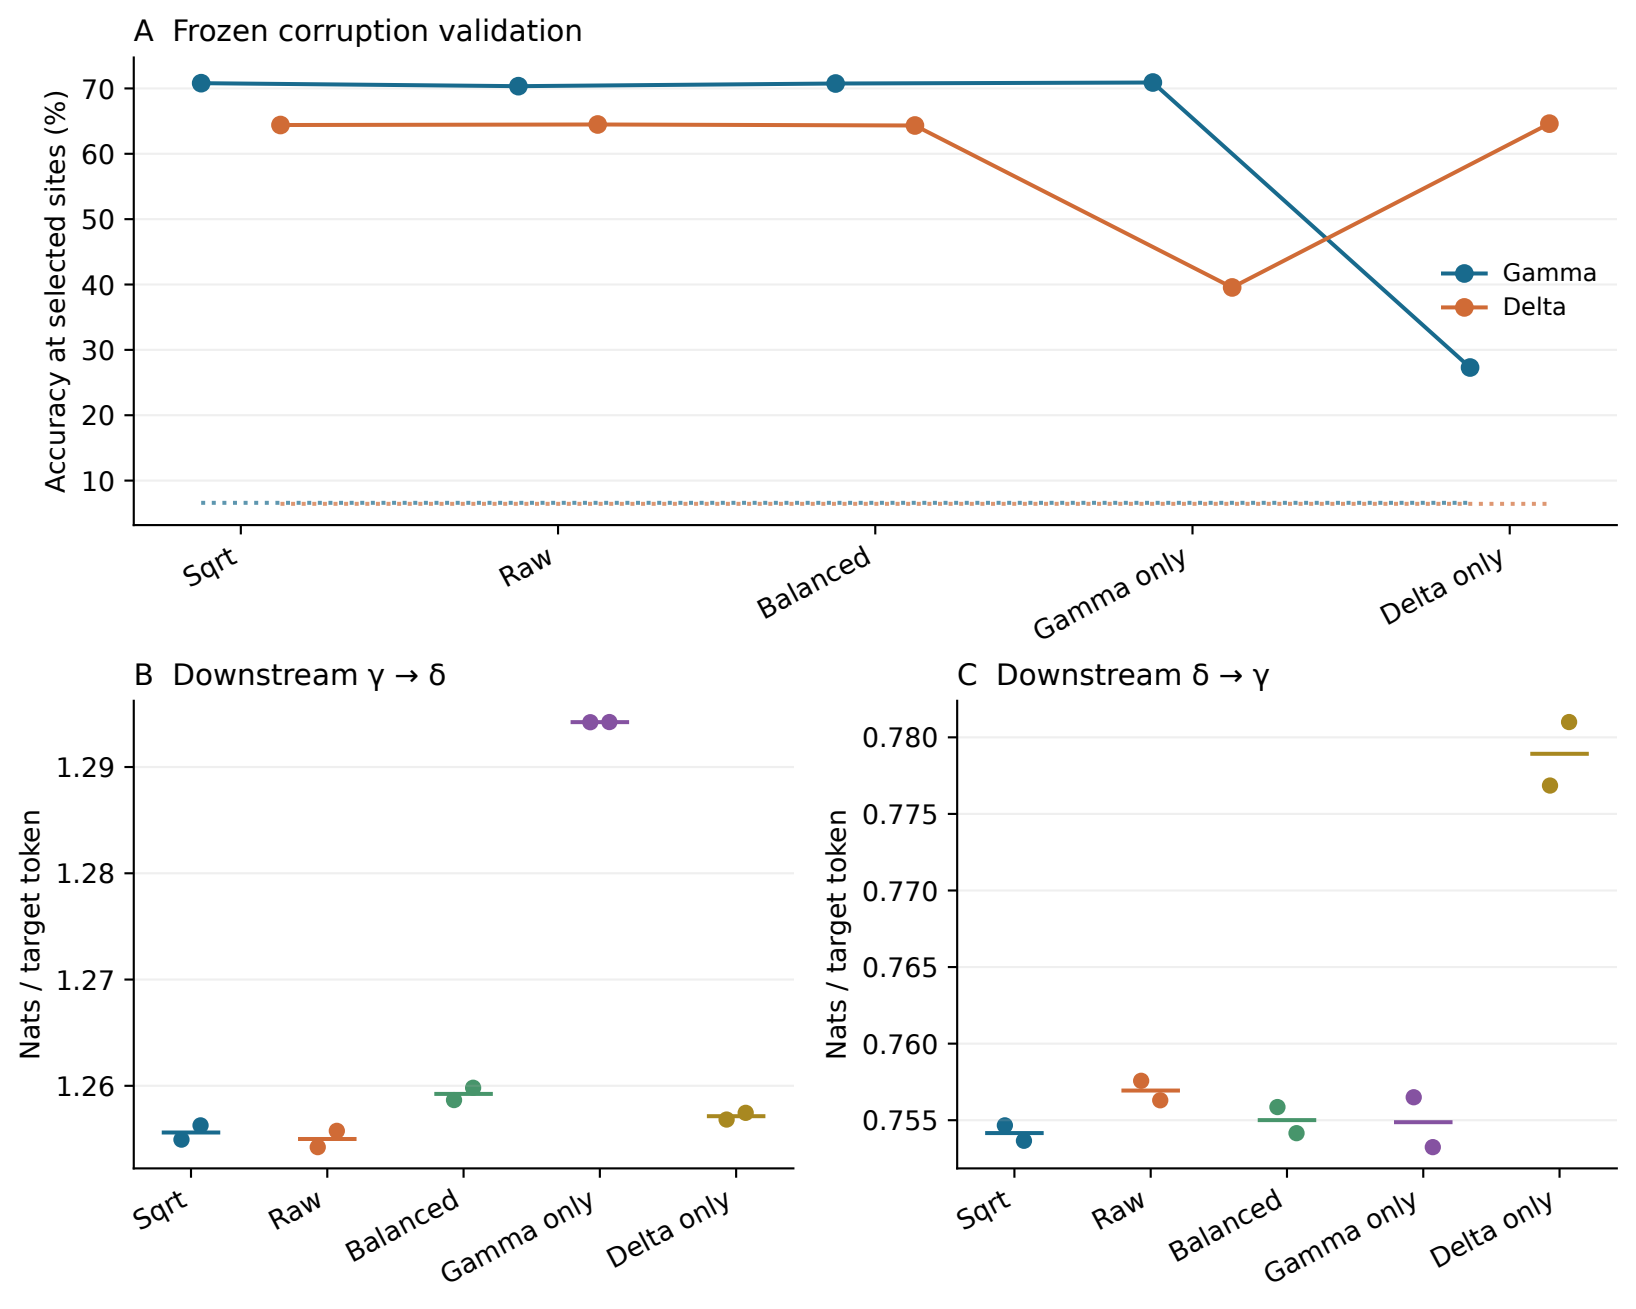
A Frozen corruption validation
Accuracy at selected sites (%)
70
60
50
40
30
20
10
Gamma
Delta
Sqrt
Raw
Balanced
Gamma only
Delta only
B Downstream γ → δ
Nats / target token
1.29
1.28
1.27
1.26
Sqrt
Raw
Balanced
Gamma only
Delta only
C Downstream δ → γ
Nats / target token
0.780
0.775
0.770
0.765
0.760
0.755
Sqrt
Raw
Balanced
Gamma only
Delta only