



PLAN
(ITEM 3 & SURROUND OMITTED)

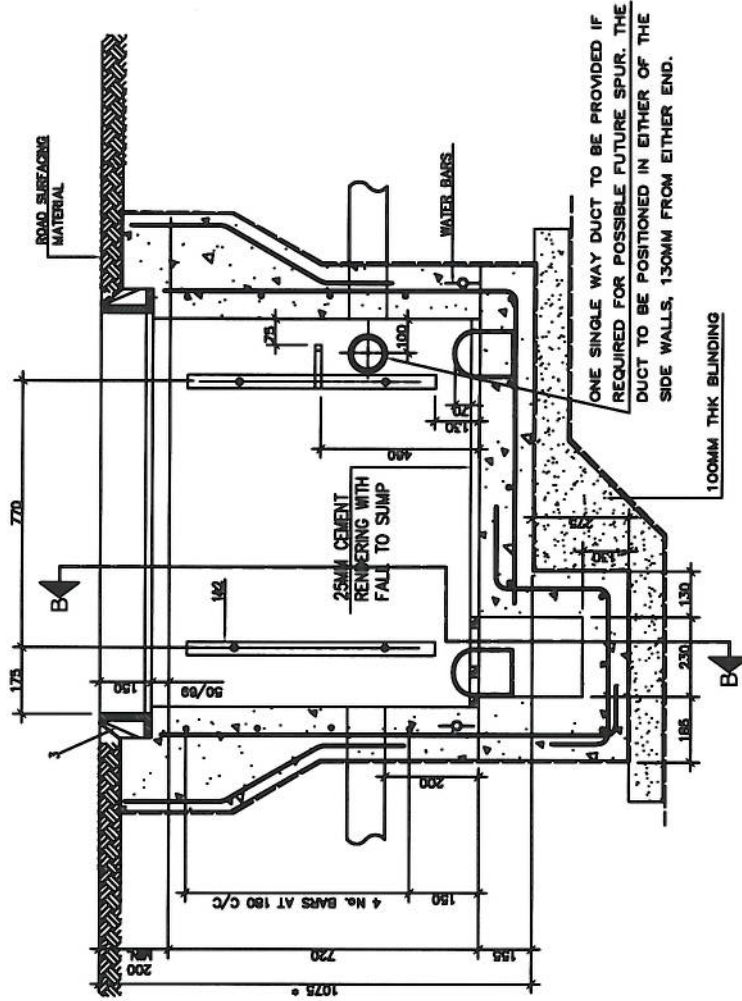

SECTION 'A-A'

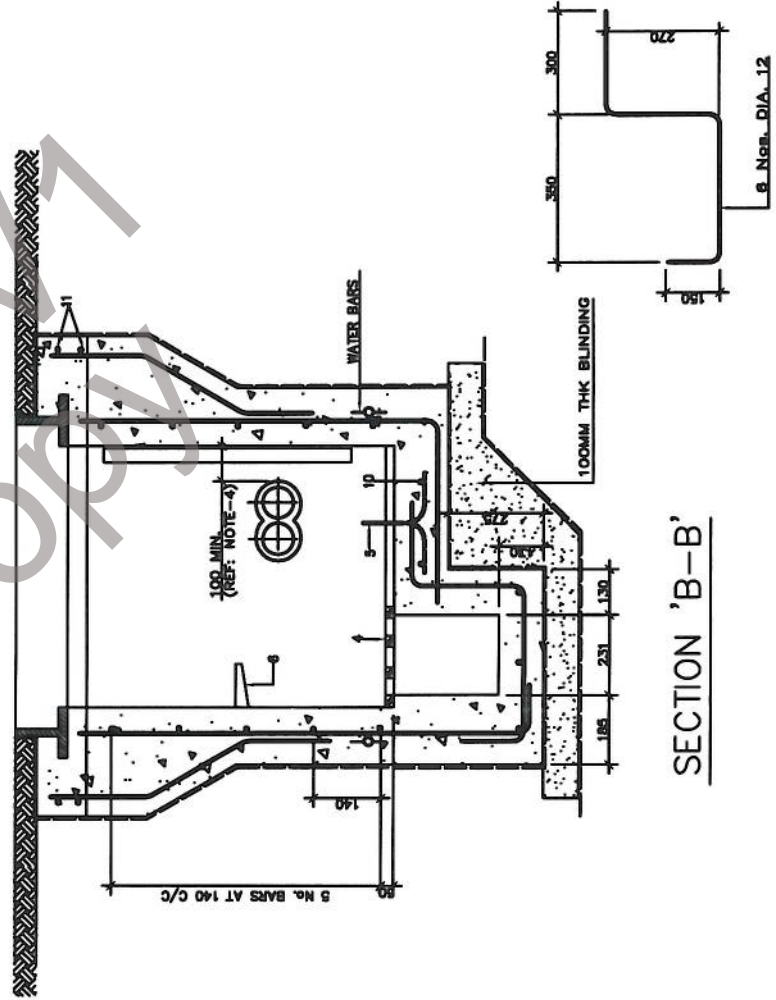

SECTION 'B-B'

SCHEDULE OF FURNITURE			
ITEM	DESCRIPTION	DRG No.	No. OFF
1	BOLTS, FOUNDATION, INDENTED No. 2	EP 1022	4
2	CABLE BEARERS WALL TYPE No. 3	EP 1010	2
3	FRAME & COVER CARRIAGEWAY TYPE No. 2	EP 1004,	1
4	GRATING, SUMP No. 2A	EP 1014	1
5	IRONS, ANCHOR No. 4	EP 1013	2
6	STEP, MANHOLE No. 1	EP 1011	1
7	REINFORCEMENT BAR 10 DIA. x 200		18
8	REINFORCEMENT BAR 10 DIA. x 795		14
9	REINFORCEMENT BAR 10 DIA. x 845		8
10	REINFORCEMENT BAR 10 DIA. x 1330		12
11	REINFORCEMENT BAR 10 DIA. x 1680		4
11a	BRACKET, CABLE BEARER No: 5	EP 1110	4
11b	PIN LOCKING, CABLE BEARER	EP 1018	4
11c	SAFETY GRIDS- FRAMES & COVERS No: 2	EP 1023	2

* FOR REFERENCE ONLY


NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES.
- DO NOT SCALE FROM THE DRAWING.
- FOR METHOD OF FIXING ITEMS 3, 5 & 6 SEE DRG. CN 19612.
- END DUCTS MUST BE IN LINE.
- REINFORCEMENT MAY BE REPOSITIONED SLIGHTLY TO CLEAR DUCTS WHEN NECESSARY.
- 50MM. MIN. COVER IN ALL REINFORCEMENT.
- ITEM 7 SPACED AT 250MM PITCH IN SIDE WALLS & 380MM PITCH IN END WALLS.
- EXACT LOCATION OF WATER BAR TO SUIT KICKER DETAIL.
- THE SCHEDULE OF REINFORCEMENT IS FOR GUIDANCE ONLY. THE CONTRACTOR IS TO FABRICATE ALL STEEL TO MEET THE SITE OR ANY OTHER REQUIREMENTS.
- ADDITIONAL REINFORCEMENT IS TO BE PROVIDED AROUND CUT OUTS, OPENINGS OR ANY OTHER SECTION AS DIRECTED BY THE ENGINEER.
- RE-BARS TO BE SUITABLY CURTAILED AT SUMP LOCATIONS.
- FURNITURE ITEMS 11a, 11b & 11c ARE NOT SHOWN ON DWG.

NOTES FOR PROTECTION OF UNDERGROUND CONCRETE

- IT IS MANDATORY TO PROTECT ALL UNDERGROUND CONCRETE STRUCTURES WHICH INCLUDES THE FOLLOWING WITH ONE LAYER OF SELF ADHESIVE MEMBRANE BITUTHENE 1000 X Hc OR PREMSEAL 100 WITH PROTECTION BOARD 'SERVPAK' 3mm OR 'APOC' 3mm THICK OR EQUAL APPROVED.
- OUTER SURFACE OF WALLS OF ALL JOINT BOXES AND MANHOLES.
 - BOTTOM SURFACE OF BASES OF ALL JOINT BOXES/MANHOLES
 - OUTER SURROUNDING SURFACES OF ALL CABINET/ KIOSK BASES INCLUDING BOTTOM.
 - OUTER SURFACES OF SHAFTS AND UPPER SURFACE OF ROOF OF ALL MANHOLES.
 - OR -ANY OTHER CONCRETE STRUCTURE WHICH ARE IN CONTACT WITH EARTH AROUND.

F	DWG. QUALITY IMPROVED.	MA	23-4-08
E	ITEMS 11a, 11b, 11c INCLUDED IN SCH. NOTE 13 ADDED.	MKT	23-2-04
D	REVISED	MKT	19-10-01
C	REINFORCEMENT DETAILS REVISED	MKT	4-4-89
B	REVISIONS	DRN	DATE
A	DATE	APPD	



ETISALAT
EMIRATES TELECOMMUNICATIONS CORPORATION
HEAD OFFICE-ABU DHABI

JOINT BOX JRC 12

SCALE: 1 : 20

SHEET: 1 OF 1

DRWING No. CN 1709Z

REV. F