
D.9 – Typical roof / ground tank connection arrangement.

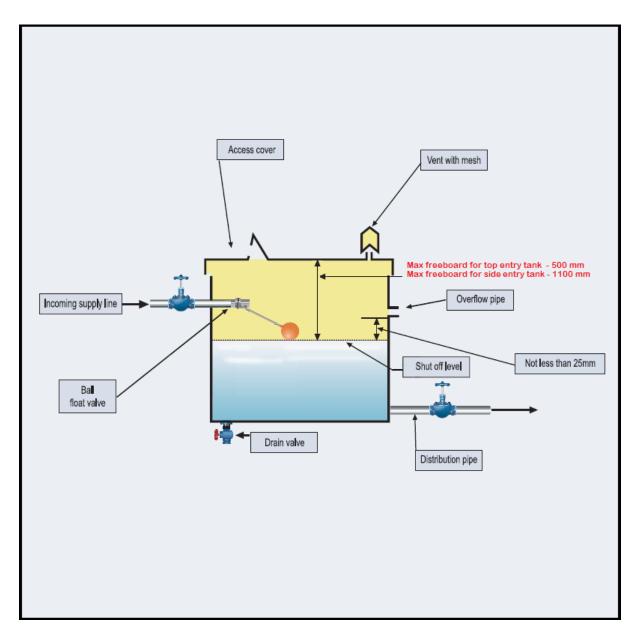

The above drawing is for illustration purposes only. General requirements for tank connection, fittings and accessories are dependent on the tank location, volume, height and material of construction as prescribed in this Guide. However, the standard requirements for a tank are that it should be provided with a flow-control device (float-operated valve), an overflow pipe, access/ an access cover, service valves, a vent and drain connection (as necessary).

The air gap between the shut-off level and overflow pipe can vary according to the overflow control device and the end use of the water.

Guide to Water Supply Regulations 2017				
Author	Document	Version	Issue date	Approved by
KR/MSH	ER/P04/100	Issue 3	15 Dec. 2016	SSQ
		Page 84 of 8	36	