


D.11 - Typical connection arrangement for a water tanker filling station together with water tanker main features.

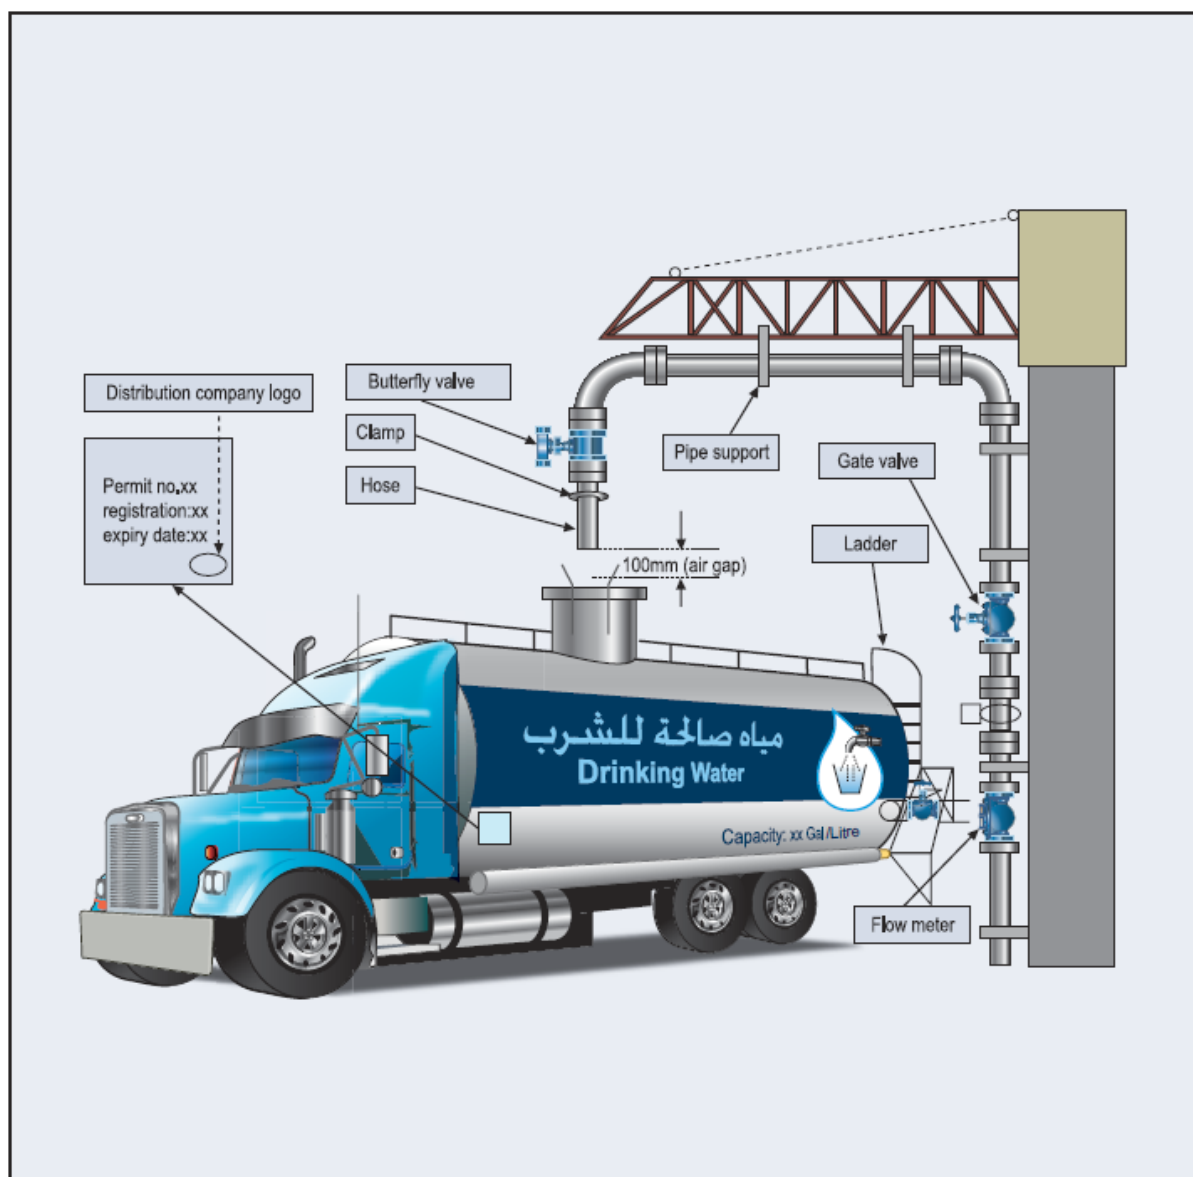

The above diagram is for illustration purposes only. All potable water tankers must comply with the relevant clauses of the Water Supply, Tankering and Water Quality Regulations, in addition to the Distribution Company's own requirements.

The main requirements are:

- 1) the tanker information sticker/label must have all the required details clearly written on it on both sides;
- 2) All connection accessories must be kept in a closed cabinet along with the filling hose; and
- 3) An air gap must be allowed for during the filling process.