

preferred. The bottom lip should be be at a maximum height of 300 mm.

Grab bars shall be provided on both sides of the urinal mounted vertically with the centreline at 1000 mm high and 380 – 450 mm from the centreline of the urinal. Where privacy screens are provided there should be a clearance of 920 mm.

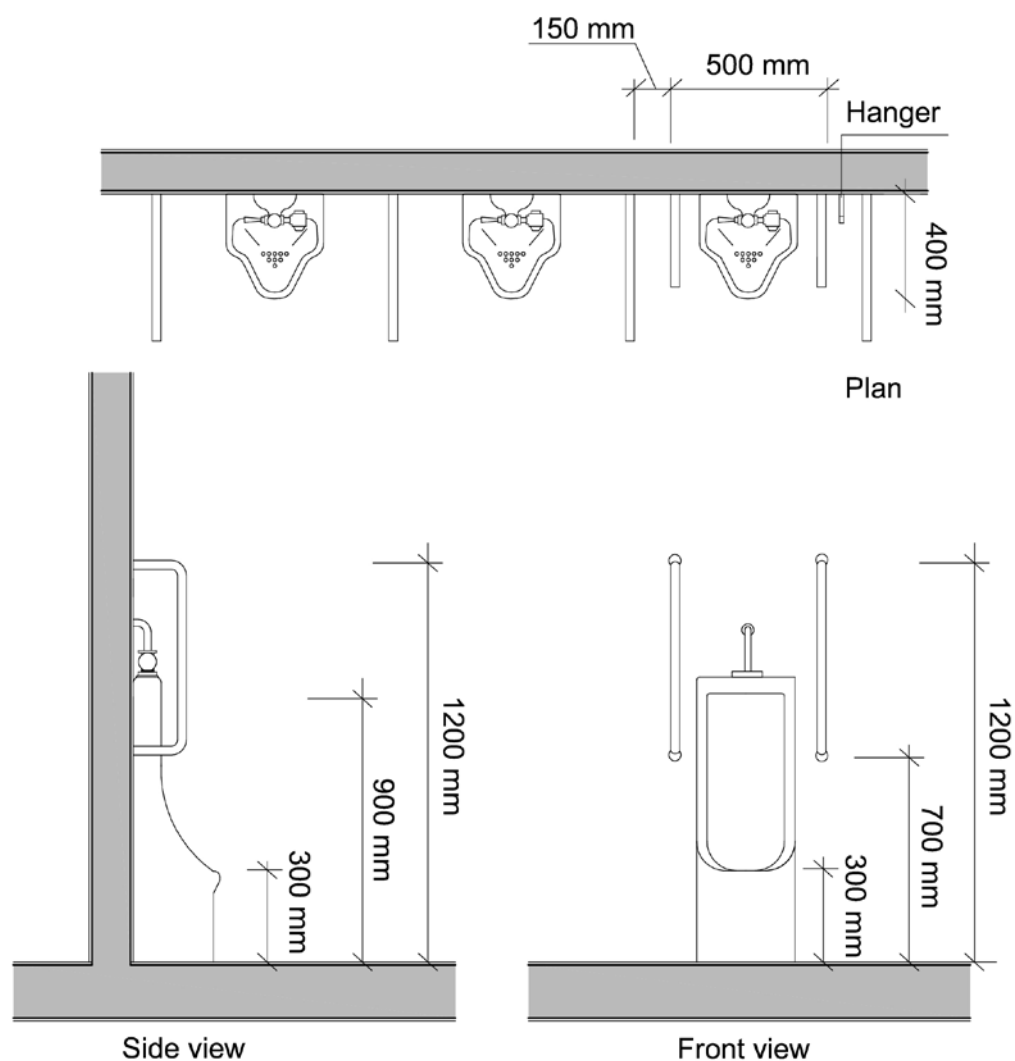


Figure 39. Urinal dimensions and grab bars

### 5.18.1. Floor surfaces

Public toilet shall have non-slippery floor surfaces.