


The distance between ducts and the trench wall shall not be less than 0.10m. The standard duct nest arrangements are presented in Figure 20. For further details, refer **Annexure 2**.

Figure 20: Standard Duct Nest Arrangement

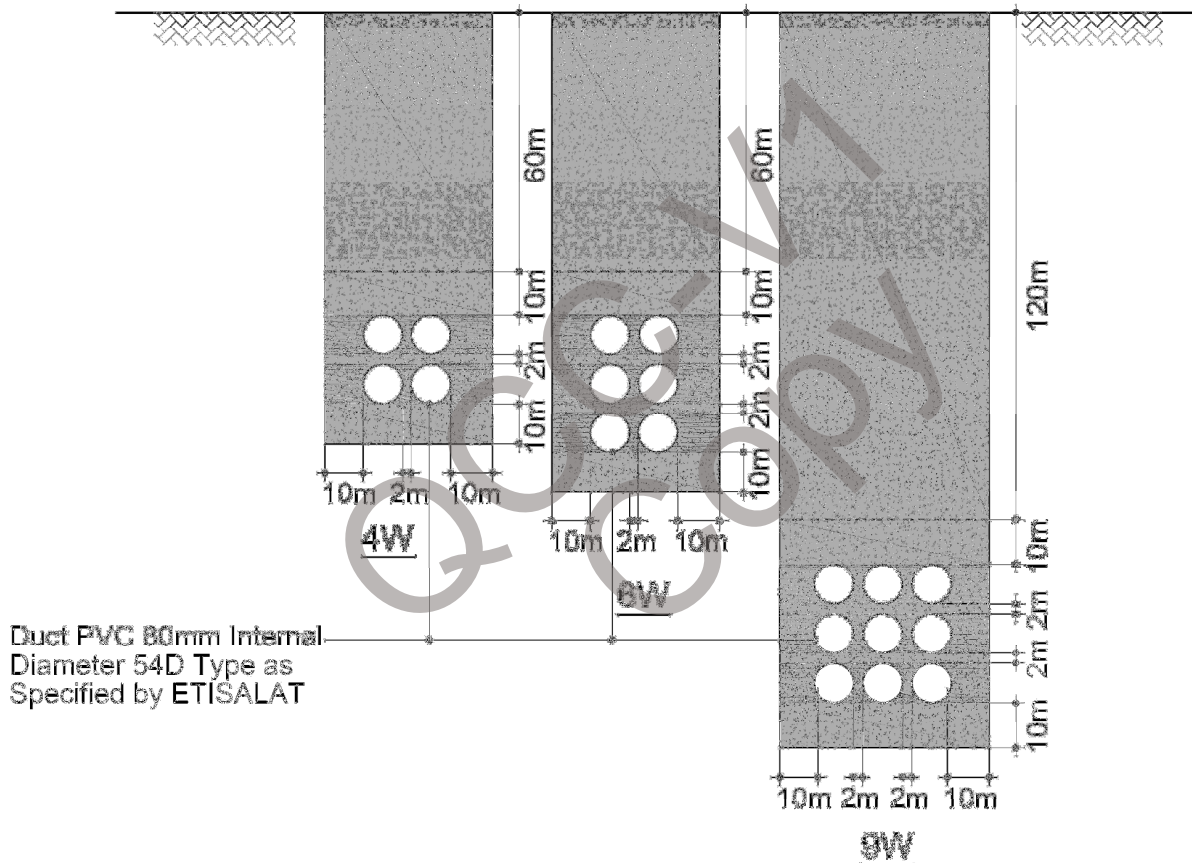

Based on the currently used manhole sizes, the maximum outer width of manholes is 2.0m. The minimum cover requirements in accordance with the current practice of the service providers vary from 0.6m to 1.20m. A typical section presenting the telecommunication manhole is shown in Figure 21. For further details, refer to **Annexure 2**.