


Annex D: Diagrams

D.1 - Typical arrangement for small-size connections up to 25mm in diameter such as villa, shabiat or other similar low-rise Premises, from the main distribution pipe to Customer Premises with ground tank and by-pass arrangements. (Inadequate pressure).

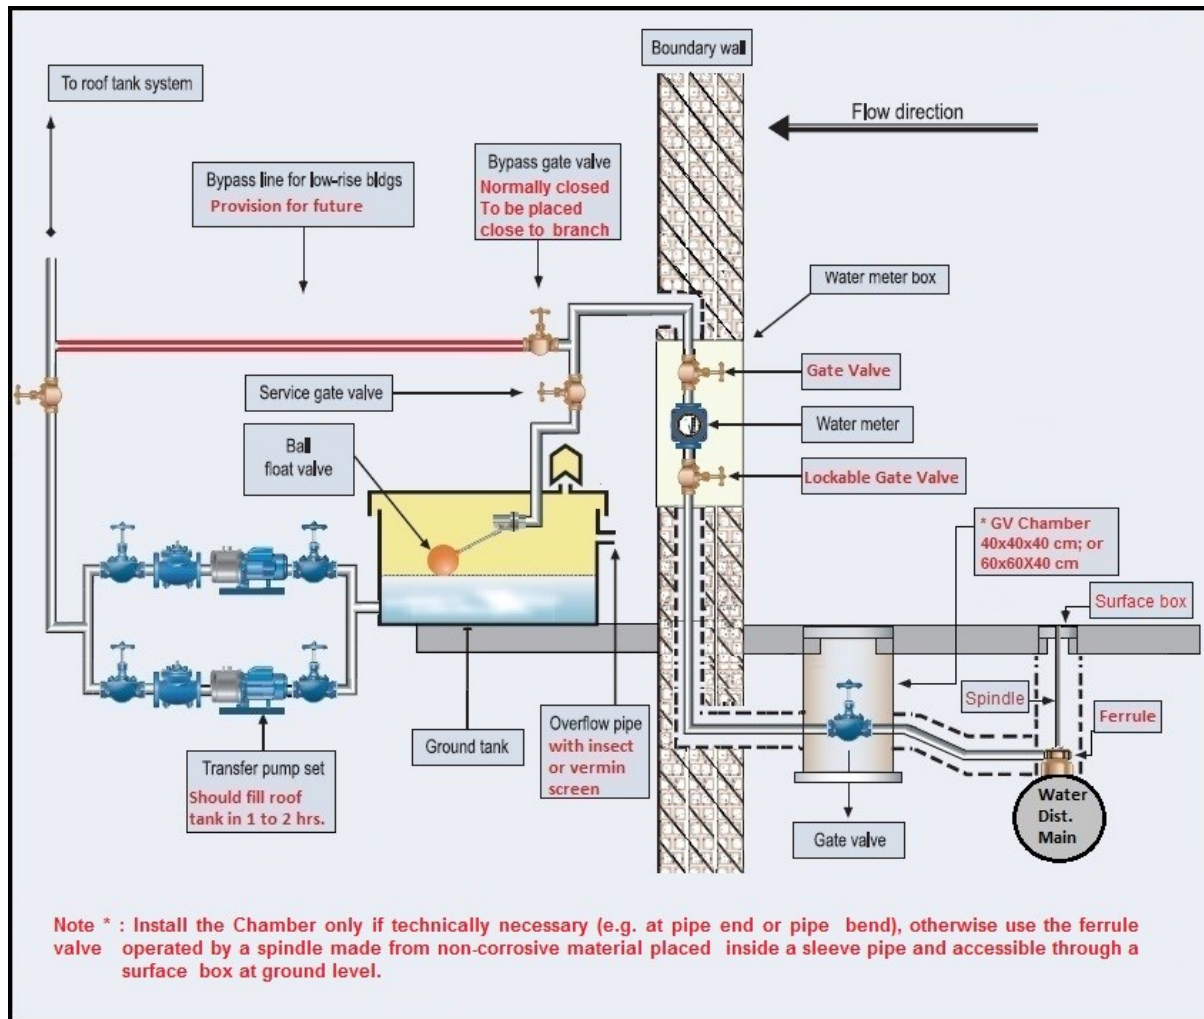

The above drawing is for illustration purposes only. All drawings shall be submitted in accordance with Annex A of this Guide complete with all details. It should be noted that this part of the system shall comply with Distribution Company specific arrangements.