



PLAN ON CONTROL PANEL TRENCH (B)
1:50

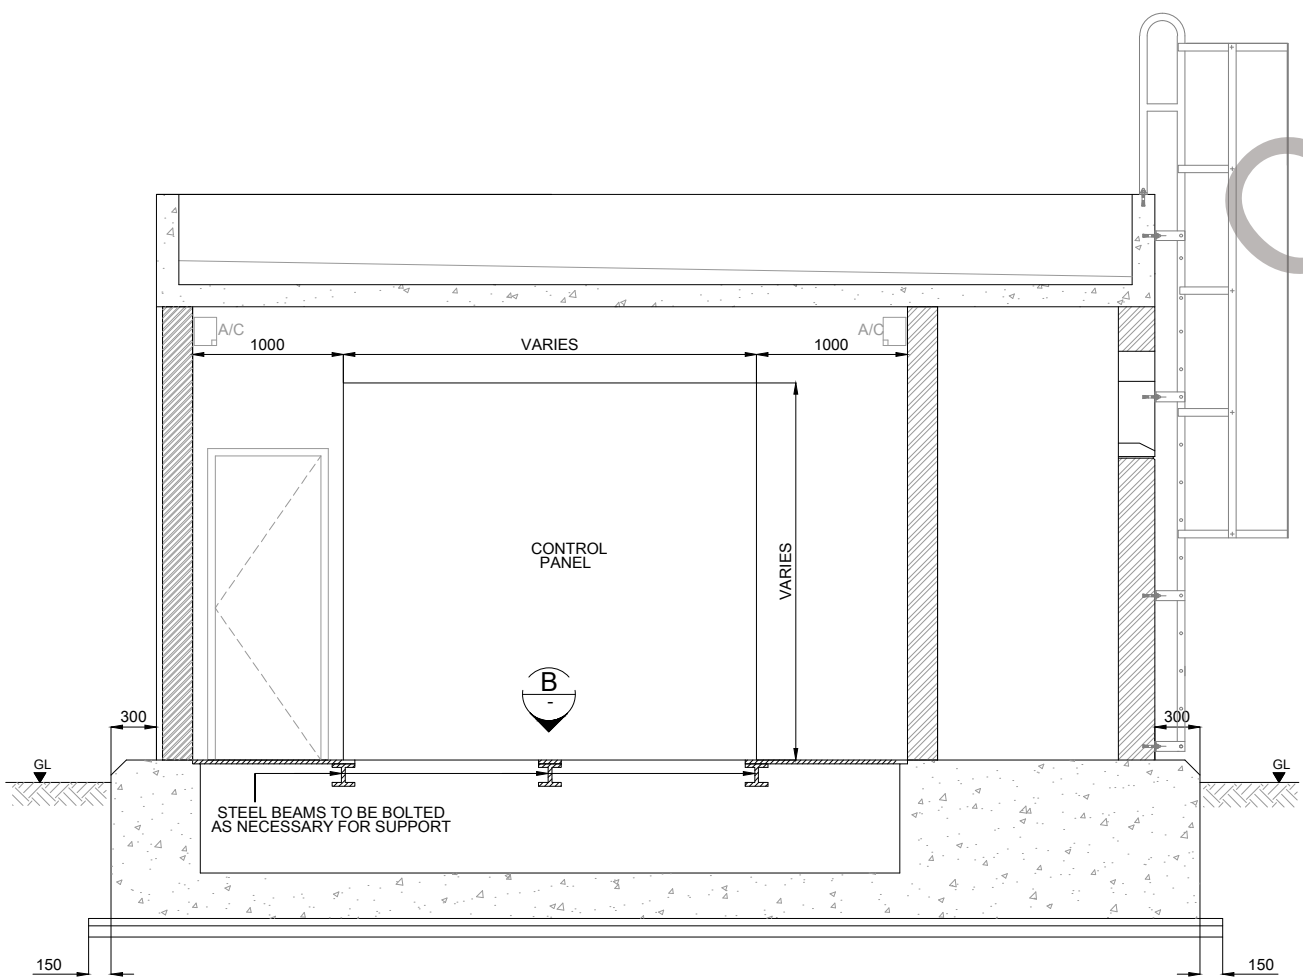

SECTION 1-1 (B)
1:50 SHT-1211

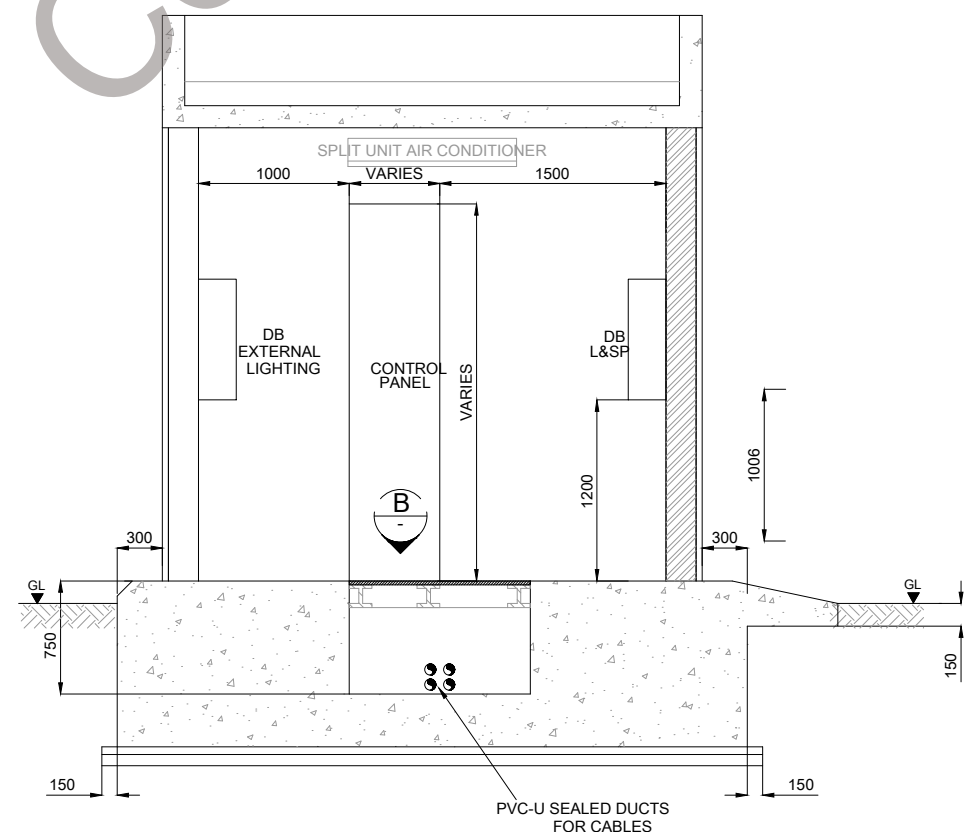

SECTION 2-2 (B)
1:50 SHT-1211

- NOTES:
- THESE DETAILS REPRESENT A MINIMUM REQUIREMENT AND MAY BE VARIED, SUBJECT TO APPROVAL, TO SUIT PROJECT REQUIREMENTS. THEY ARE EXPECTED TO BE INCORPORATED AS TYPICAL DETAILS WHICH SHALL BE CHECKED AND APPROVED AS PART OF THE PROJECT DRAWING SET.
1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
 2. ADDITIONAL DUCTS FOR POWER SUPPLY OF OTHER CONSUMERS (PUMPS, ETC.) INSIDE PUMPING STATION COMPOUND, SHALL BE PROVIDED AS REQUIRED BASED ON ARRANGEMENT OF THE EQUIPMENTS.
 3. BUILDING ORIENTATION TO SUIT SITE ACCESS ROADS.
 4. DOORS ORIENTATION SHALL SUIT SITE REQUIREMENTS.
 5. DOORS SHALL BE SIZED TO ENSURE EASY ACCESS AND REMOVAL OF EQUIPMENT.

REFERENCE DRAWINGS AND DOCUMENTS			
No.	REVISIONS	APP'D	DATE
CLIENT			
TITLE			
STANDARD DRAWINGS STORM WATER WORKS			
DRAWING TITLE			
STANDARD DRAWING CONTROL BUILDING PLAN, SECTION & TRENCH DETAILS			
DRAWN	-	SCALE	1:50
CHECKED	-	DATE	-
APPROVED	-	SIZE	A1
PROJECT No.	-	DWG. No.	1214