


APPENDIX 3**A-TYPICAL ARRANGEMENT OF kWh METERS IN ELECTRIC SERVICES ROOM**

(Refer to sections 3 & 6 for regulations)

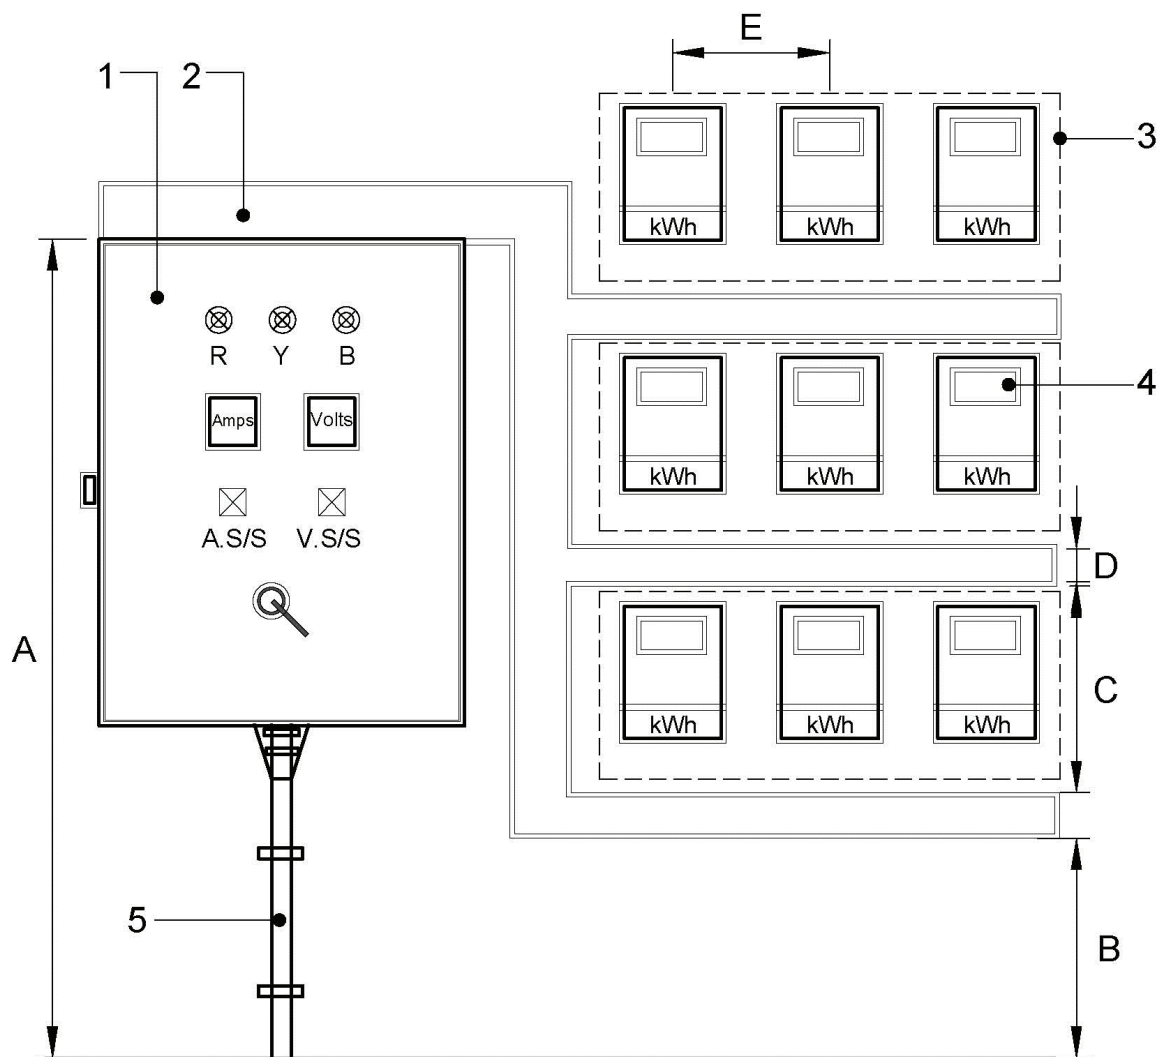

Dimensions in cm				
A	B	C	D	E
180	60 (Min.)	50	10	30

Description :

- 1) Main / Sub-main Distribution Board
- 2) PVC / GS trunking
- 3) Non-combustible type board / plate for fixing kWh meters
- 4) kWh Meter
- 5) Supply Cables

Notes :

- Layout indicates only the minimum space, maximum number of rows and arrangement, etc. of kWh meters.
- Earthing details, outgoing circuits & conduit terminations, etc. are not indicated.
- Minimum 2 mtr. clearance shall be maintained between electricity and water service cabinets / points.