

It is recommended that 1 feeding room be provided for each block of toilets. At least 1 feeding room within 300 m distance from any part of the building shall be provided.

A feeding room shall meet the following requirements:

1. Its surface shall be at least 7 sq. meters for individual feeding rooms and 10 sq. meters for dual feeding rooms.
2. Its design has to ensure an ease of movement with a pram and a child on the arms.
3. It shall have proper ventilation for any smell generated by the diaper waste bins as well as proper place for the diaper waste bins.
4. Furniture shall have a reflectance contrast with the walls of at least 30 points LRV (Light Reflectance Value).

All elements and appliances described in the drawing shall be provided although not necessarily with the same distribution.

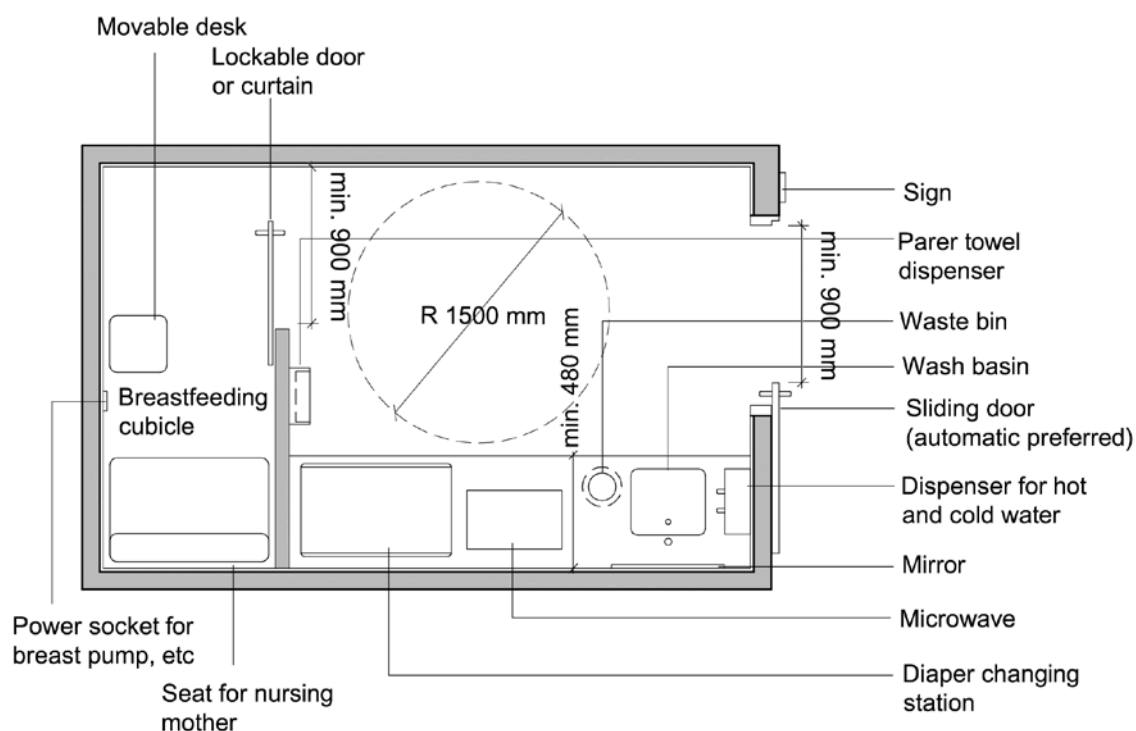


Figure 48. Example of individual feeding room - plan