

7.6. Gender equality

In case of segregated use by gender of the building, the same level of accessibility will be provided for both genders.

7.7. Storage facilities

The storage facility design shall take into consideration all the minimum spaces and reachability recommended in Annex 3.

20% of shelves, boxes or lockers shall be within reaching distance for a wheelchair user or people with short stature, between 600 mm and 1200 mm above the floor.

Lockers numbers should be well contrasted and tactile.

If benches are provided, they should be moveable.

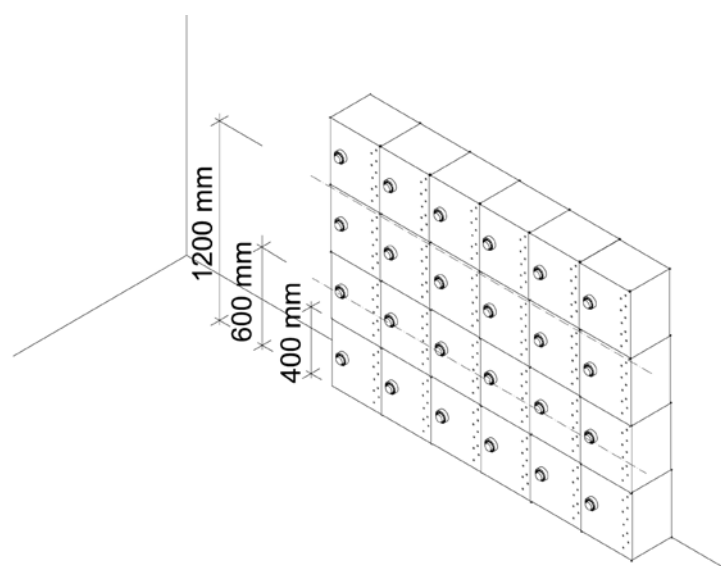


Figure 99. 20% of boxes between 600 mm and 1200 mm