


D.6 - Typical internal connection arrangement for a high-rise building (metered internally).

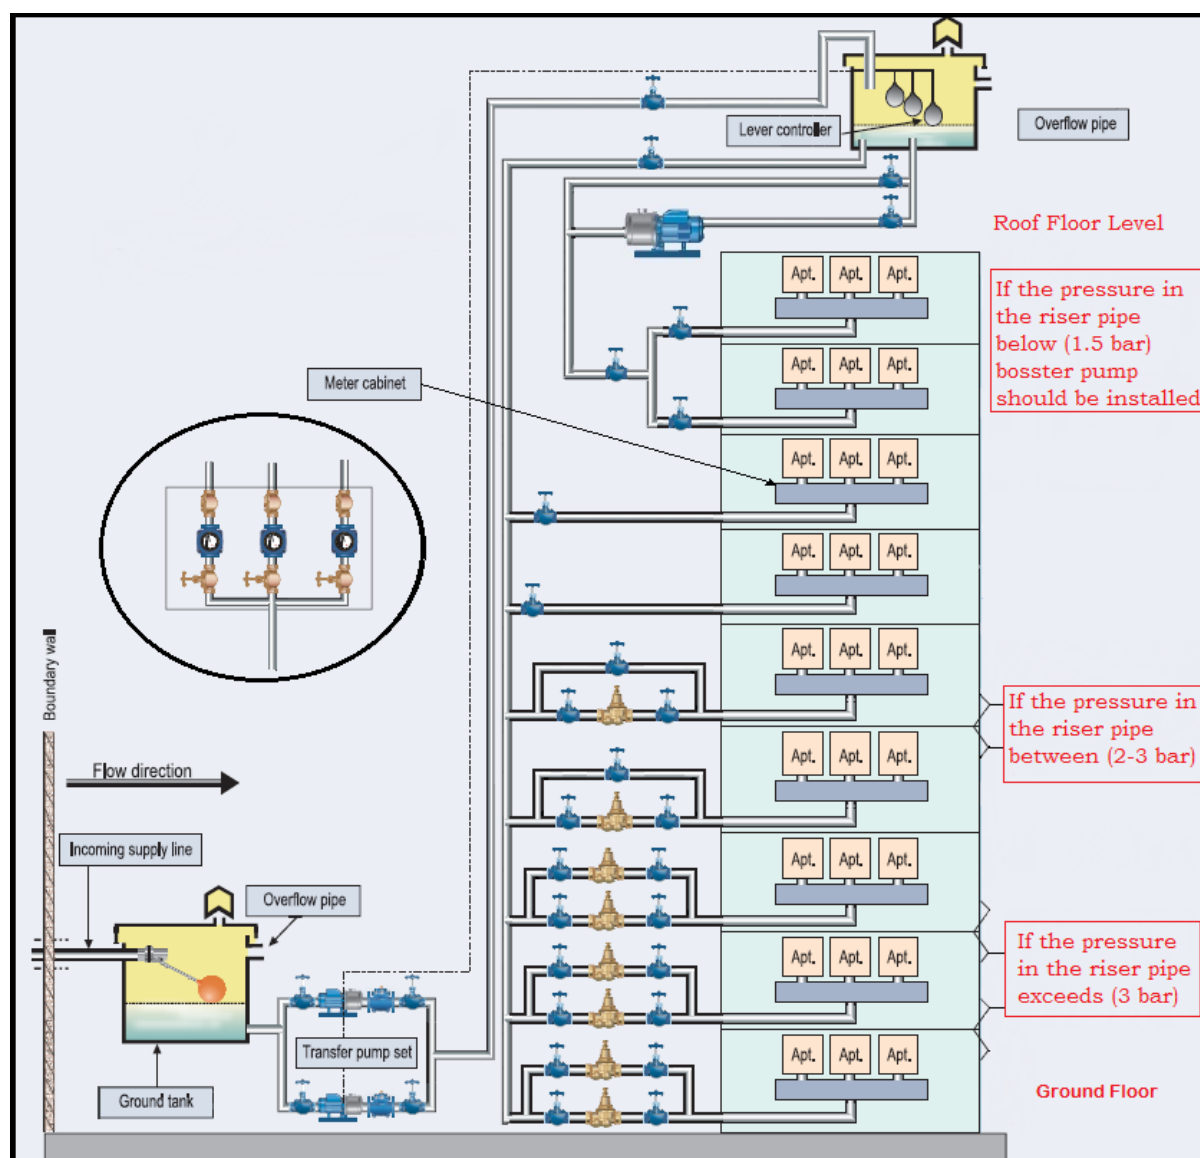

The above drawing is for illustration purposes only. All drawings shall be submitted in accordance with Annex A of this Guide complete with all details. It should be noted that this part of the system shall comply with Distribution Company specific arrangements. Metering for building services and shops shall be in accordance with the approved floor plan.

The valves layout in meter cabinet shall be fitted with pressure-reducing valve where applicable and the valve cabinet location may change subject to the Distribution Company's approval.