

A reception desk visible from and near the entrance shall be provided in all public use buildings.

All entrance doors must have a clear passage width adequate to the intended use of the building and the expected number of users. Minimum dimensions are 900 mm width x 2100 mm height.

In case of revolving doors, an alternative door shall be provided,

Entrance doors shall be power assisted, according to the specification of the Doors Section of this Code.

Doormats shall be levelled with the floor with a tolerance of ± 2 mm.

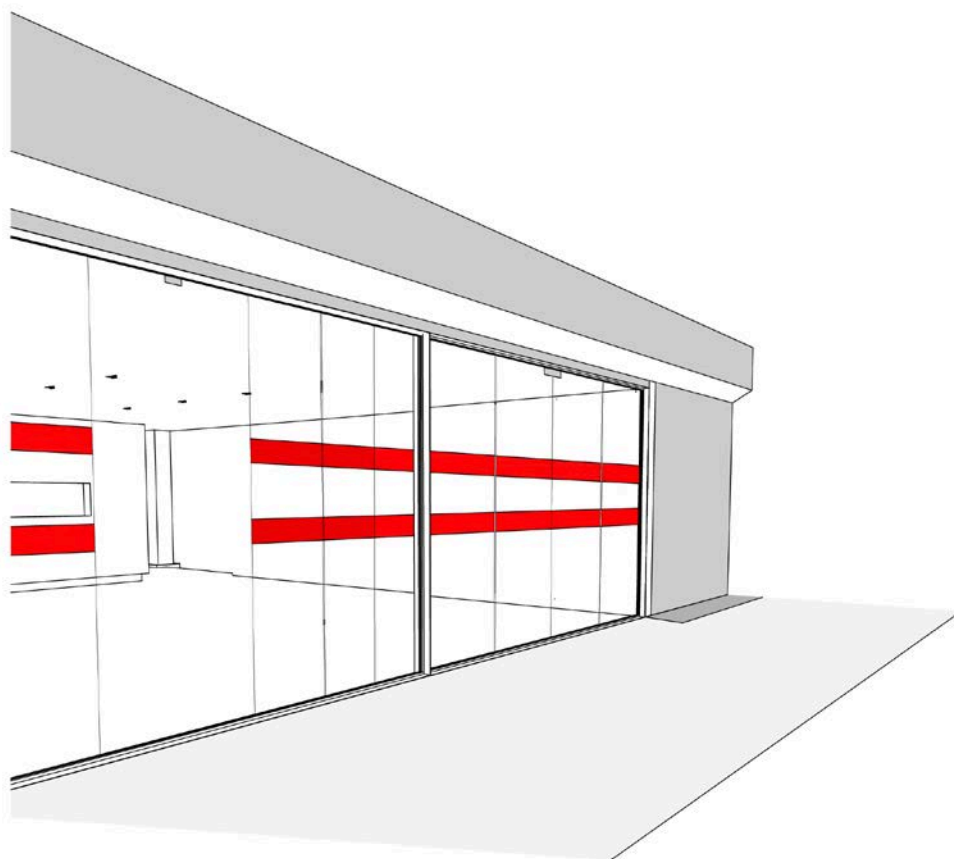


Figure 94. Building entrance