

of toilets, or 1 toilets for male and females within a 150 meters distance from any part of the building.

If only one toilet for each gender is provided, then it must be accessible. Accessible toilets shall fulfil the following requirements:

1. The door should have a clear width of 900 mm and comply with Doors section of this Code.
2. Furniture shall have a reflectance contrast with the walls of at least 30 points LRV (Light Reflectance Value).
3. Every cabin door shall be provided with a latch operable with the elbow installed between 900 and 1200 mm and a coat hanger installed between 1100 and 1200 mm.
4. Each toilet block for both genders shall include a baby changing table duly marked.

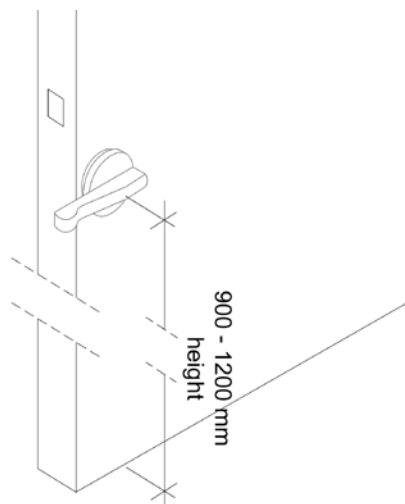


Figure 37. Cabin latch example

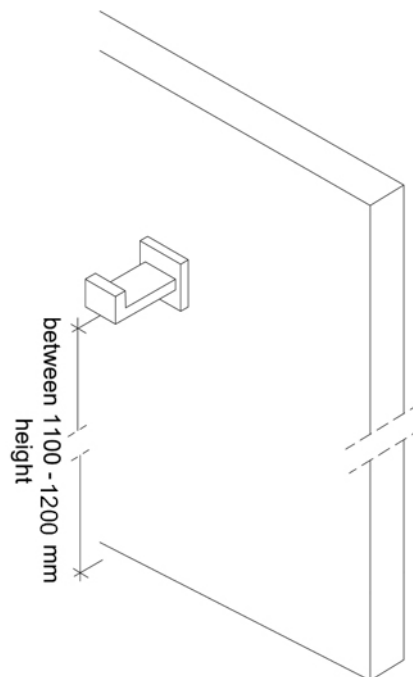


Figure 38. Door hanger

## 5.18. Urinals

At least one accessible urinal shall be provided wherever urinals are located.

Urinals that reach the floor and therefore are designed for all male heights are