

Figure 29 / Heights and arrangement of fittings in a unisex wheelchair-accessible toilet

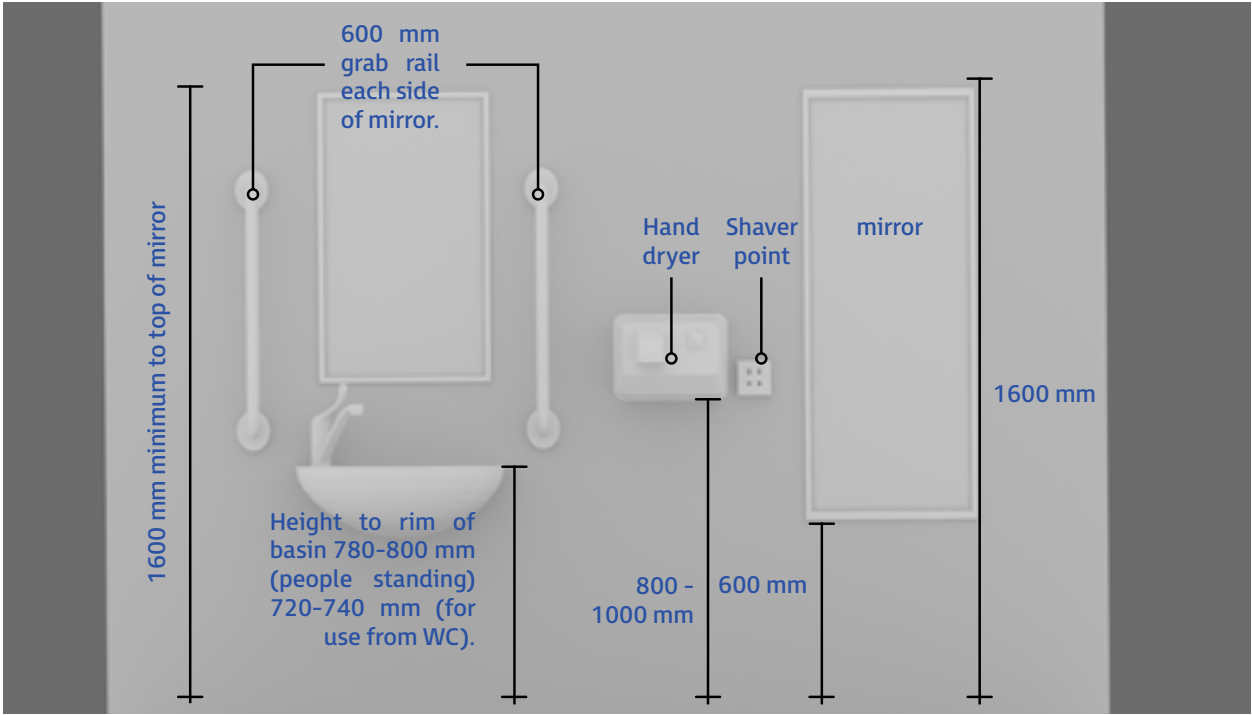


Figure 30 / Height of various fittings in toilet accommodation

TOILETS IN SEPARATE-SEX WASHROOMS

1. The arrangement of fittings and minimum overall dimensions comply with Figure 31.
2. Where provided, a wheelchair-accessible compartment has the same layout and fittings as the unisex toilet.
3. Where provided, enlarged compartments for those who require additional space are 1200mm wide, have a layout based on Diagram 21 and include a horizontal grab bar adjacent to the WC, a vertical grab bar on the rear wall and space for a shelf and fold-down changing table.
4. Any compartment provided for use by ambulant disabled people has a WC pan that will accommodate the use of a variable height seat riser and complies with BS EN 997:2012 with respect to critical dimensions.
5. Doors to compartments for ambulant disabled people are outward opening and fitted with a horizontal closing bar on the inside face as shown on figure 4. Where limited space requires an inward opening door a 450mm diameter manoeuvring space is maintained. A wheelchair accessible washroom contains at least one washbasin with its rim set at 720 to 740mm above the finished floor level.
6. In male washrooms at least one urinal is provided with its rim set at 380mm above finished floor level.
7. For cleaning purposes a self-closing water spray head connected by a flexible hose is positioned beside the WC in a location that is reachable when seated.

WC pan supplier to confirm whether their products are compliant with the BS standard or equivalent.

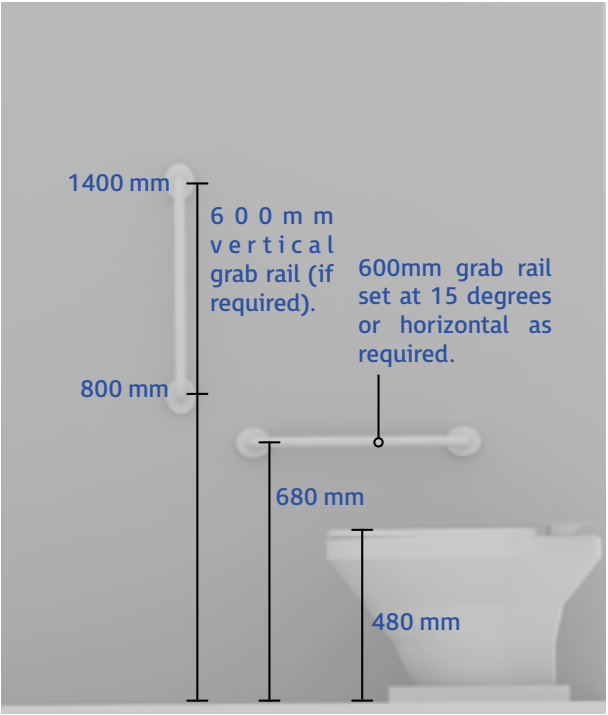
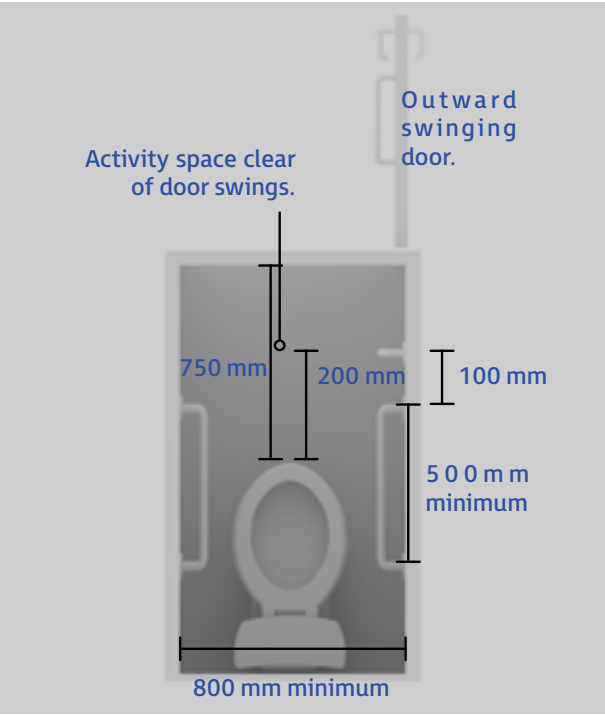


Figure 31 / WC cubicle for ambulant disabled people