

6.17.1. Scaffolding

The following general criteria shall be fulfilled:

1. The temporary or alternative path shall have a minimum width of 900 mm and headroom of 2200 mm, free of obstacles. Where there are changes in direction, the minimum dimensions shall be 1500 mm x 1500 mm.
2. When the width of the sidewalk does not allow the installation of scaffolding, an additional walking surface beside the sidewalk shall be provided.
3. If the road does not allow this solution the passage under the scaffolding shall be closed and an alternative path shall be provided.

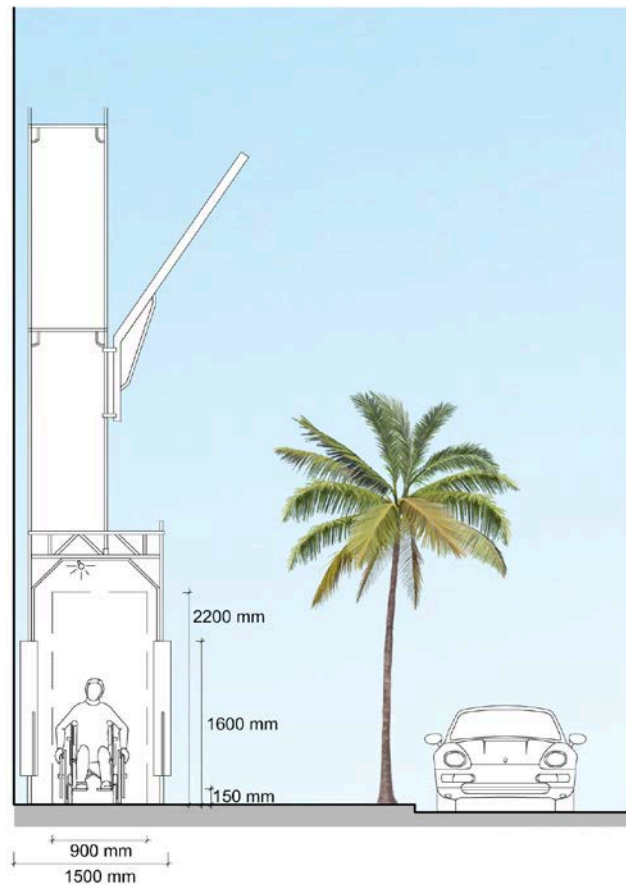


Figure 85. Alternative path under the scaffolding - frontal view