


D-10 –Typical underground tank installation arrangement.

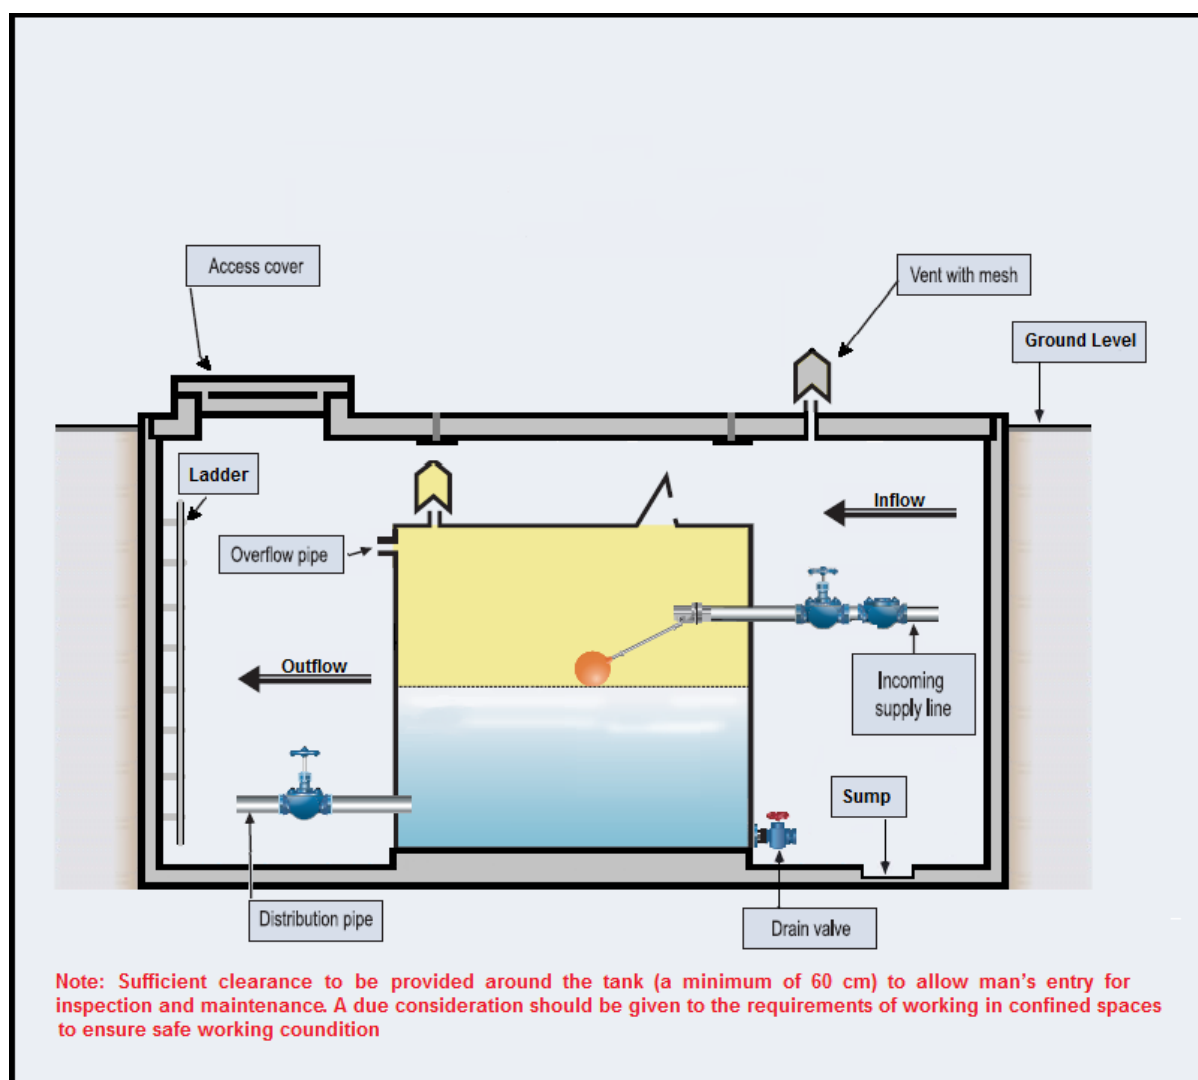

The above diagram is for illustration purposes only. Underground tanks are only permitted in basements or in purpose built underground pump rooms upon approval of the Distribution Company.

Overflow arrangements shall be made to ensure no water returns to the tank after an overflow. A suitable backflow prevention arrangement shall be considered. A suction pipe connected to the foot valve should be fitted in such a way that it can be assembled, dismantled and removed without the need to drain the tank for future maintenance and replacement works.