

## 7.2. Access control barriers

When applicable, barriers shall provide at least one entrance with a width of 900 mm. Turnstiles is not permitted.

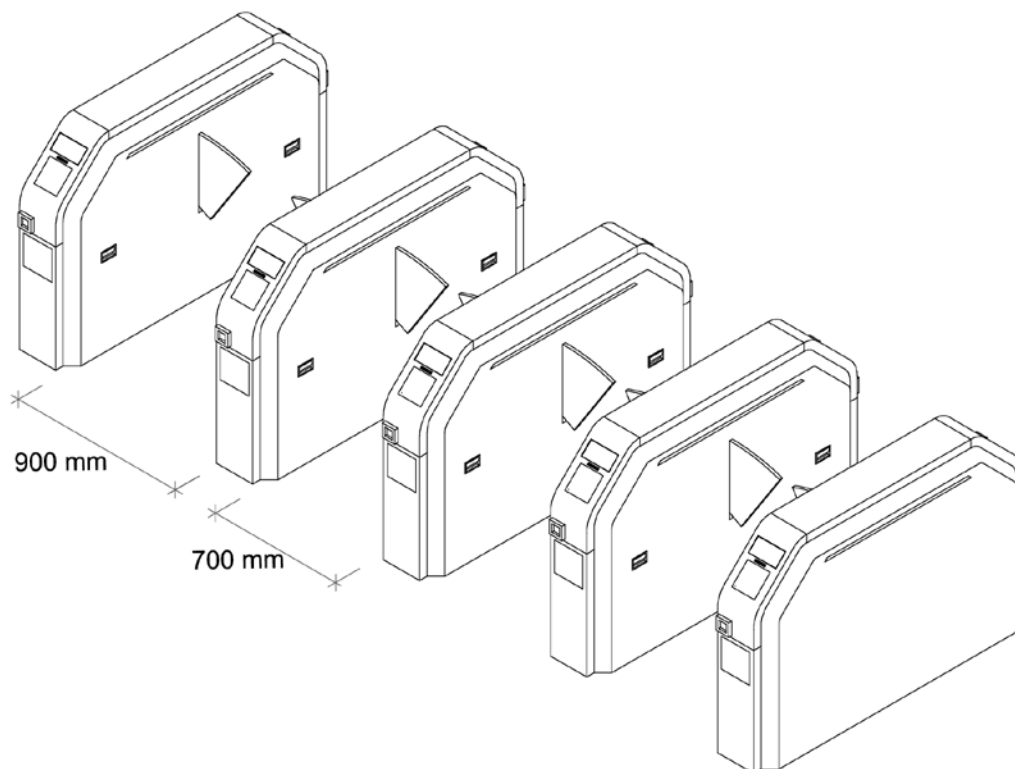


Figure 95. Access control barrier with at least one accessible gate

## 7.3. Counters and reception areas

Counters and reception areas shall provide:

1. Seating places and clear spaces to accommodate wheelchairs, scooters or strollers.
2. In reception areas enough seats for the foreseen waiting people shall be provided.
3. When providing sofas and additional regular chairs with a seat height of 430 mm with +/- 30 mm tolerance and armrests shall be provided.