


1. There is a lateral interaction area on both sides of the toilet and beside the shower if one is provided. The requirement of lateral transfer space on both sides of the toilet in accessible restrooms can be substituted by only one if in the same block there are symmetrical units.
2. Shall provide grab bars as describe in section 5.17.2.
3. A changing table shall be provided in all accessible toilet rooms.

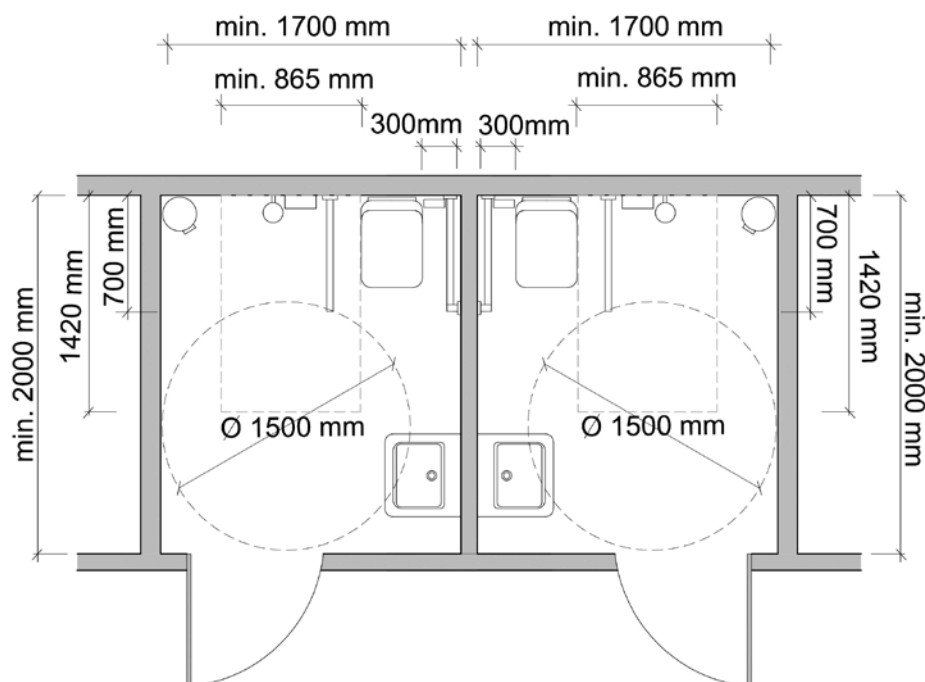

5.19.1. Doors

1. Fulfil the door criteria set out in section 5.12.
2. Open outwards or be sliding.
3. A horizontal handle bar with a length of 300 mm shall be placed at a height between 900 mm and 1000 mm at 300 mm from the hinge side on the inside of the door and by the latch side on the outside of the door.