

5.18.3. Controls and accessories

All controls and accessories shall meet the following requirements:

1. Flushing systems are operated by pressure or with a flush handle. Controls shall have a large surface and are operable with only one hand or elbow.
2. Controls and accessories such as soap dispensers or dryers among others, shall be mounted at a height between 700 mm and 1200 mm.

5.19. Accessible toilet stalls

Accessible toilet stalls can be located both inside the toilet blocks provided for each gender or outside the blocks. Family toilets should be located outside of the block of toilets. According to the tables of Annex 2 this is only allowed in certain types of buildings.

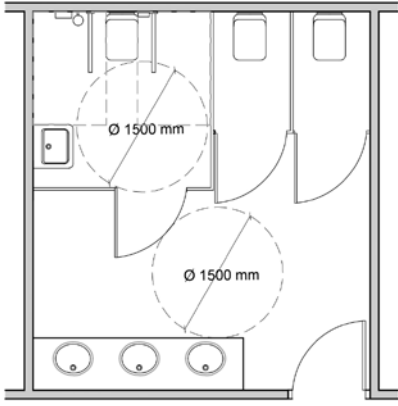

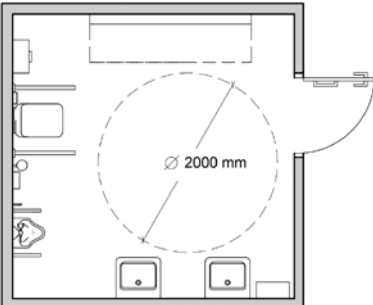
Types of toilets		
		
Accessible toilet within a toilet block	Detached accessible toilet that can be used as family toilet in certain building types	Full Family Toilet

Table 6. Types of toilets