


APPENDIX 3

C-ARRANGEMENT OF METERING IN MAIN LV PANEL

(Main Incomer Compartment / Section)
(Refer section 3 of the regulation)

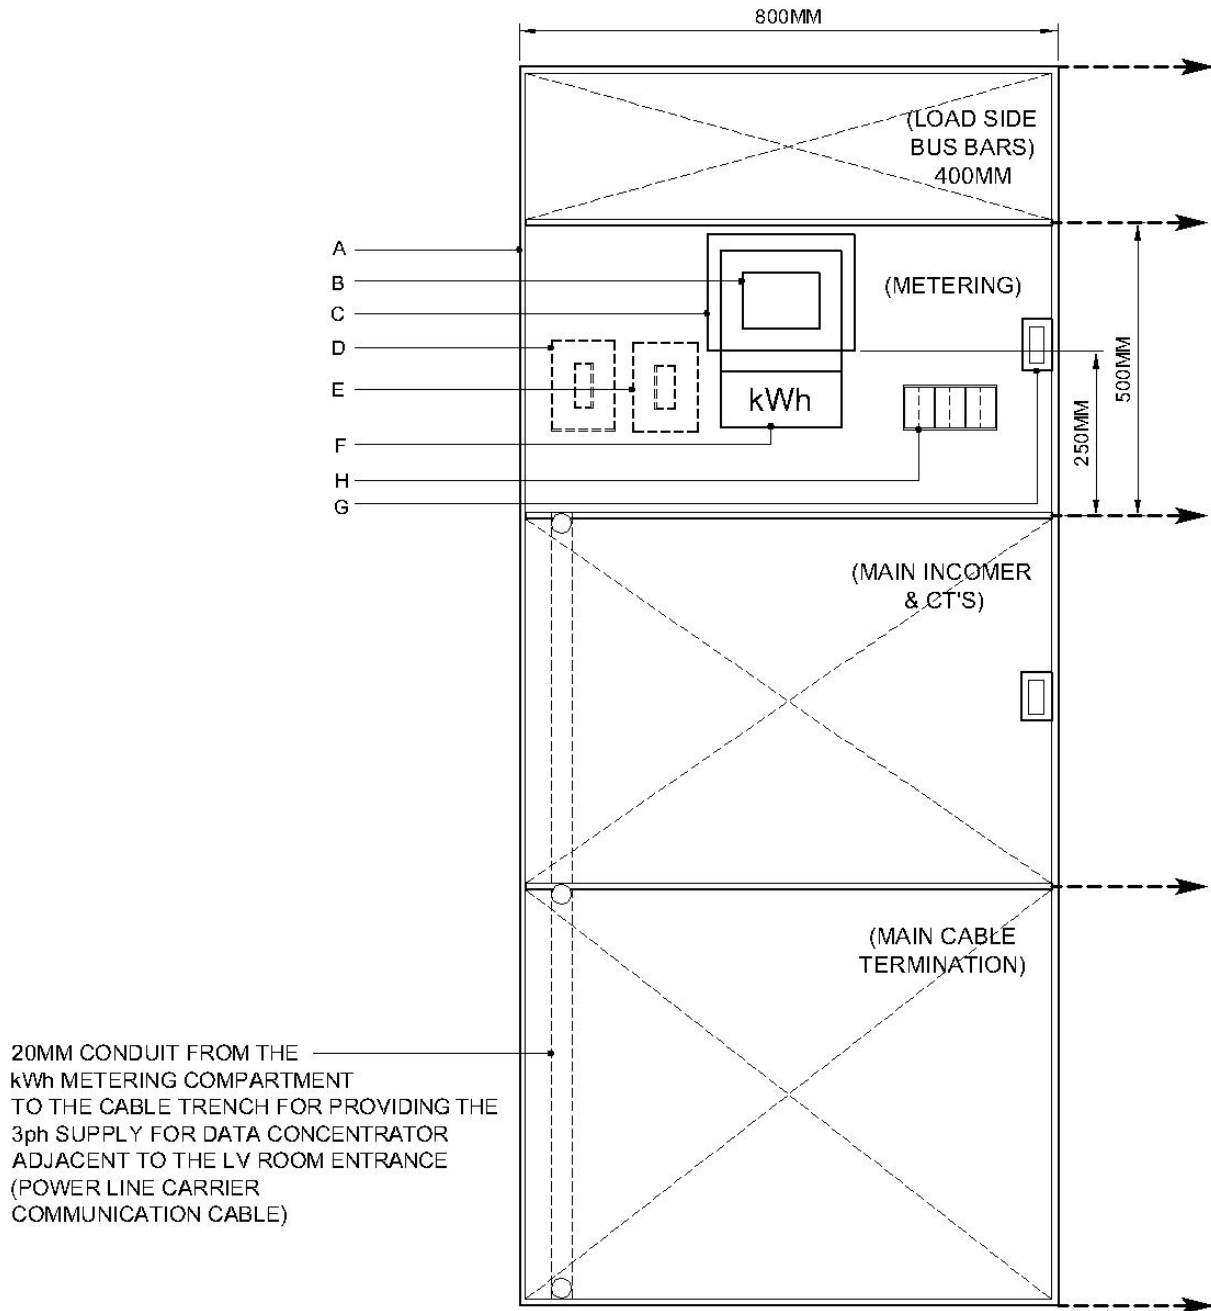

A	B	C	D	E	F	G	H
CT Operated kWh Metering Compartment	Meter Viewing Perspex (Size: 12.5cm x 12.5cm)	Protection Cover with Hinges on Top (Size: 15cm x 15cm)	Sealable Type 3Nos VT Fuse Carriers in Sealable Enclosure for Data Concentrator	Sealable Type 3Nos VT Fuses in Sealable Enclosure for kWh Meter	kWh Meter	Pad locking Arrangement (Hole Size: 10mm dia.)	CT's Shorting Terminal Block in Sealable Enclosure (RS1&RS2 / YS1&YS2 / BS1&BS2)

Notes :

- Meter viewing Perspex (min: 5mm thickness) with hinged type protection cover.
- CT operated metering & Data concentrator: Provide sealable type VT fuse carriers in sealable enclosure