

This appendix is not part of this standard. It is merely informative and does not contain requirements necessary for conformance to the standard. It has not been processed according to the ANSI requirements for a standard and may contain material that has not been subject to public review or a consensus process. Unresolved objectors on informative material are not offered the right to appeal at ASHRAE or ANSI.)

INFORMATIVE APPENDIX F  
INFORMATION ON SELECTED NATIONAL STANDARDS AND  
GUIDELINES FOR PM10, PM2.5, AND OZONE

TABLE F-1 Information Sources for Identifying Noncomplying Locations  
(Information Current as of October 1, 2015)

Country	PM10	PM2.5	Ozone
United States	Find nonattainment areas at: <a href="http://www3.epa.gov/airquality/greenbook/index.html">http://www3.epa.gov/airquality/greenbook/index.html</a>	Find nonattainment areas at: <a href="http://www3.epa.gov/airquality/greenbook/index.html">http://www3.epa.gov/airquality/greenbook/index.html</a>	<b>ASHRAE 62.1-2016 air-cleaning requirement:</b> See Figure F-1 for a list of U.S. locations exceeding the 0.107 level as of 10/1/15
Canada	National Building Code of Canada 2010—Part 6, HVAC <a href="http://www.nationalcodes.ca">www.nationalcodes.ca</a>	National Building Code of Canada 2010—Part 6, HVAC <a href="http://www.nationalcodes.ca">www.nationalcodes.ca</a>	National Building Code of Canada 2010—Part 6, HVAC <a href="http://www.nationalcodes.ca">www.nationalcodes.ca</a>

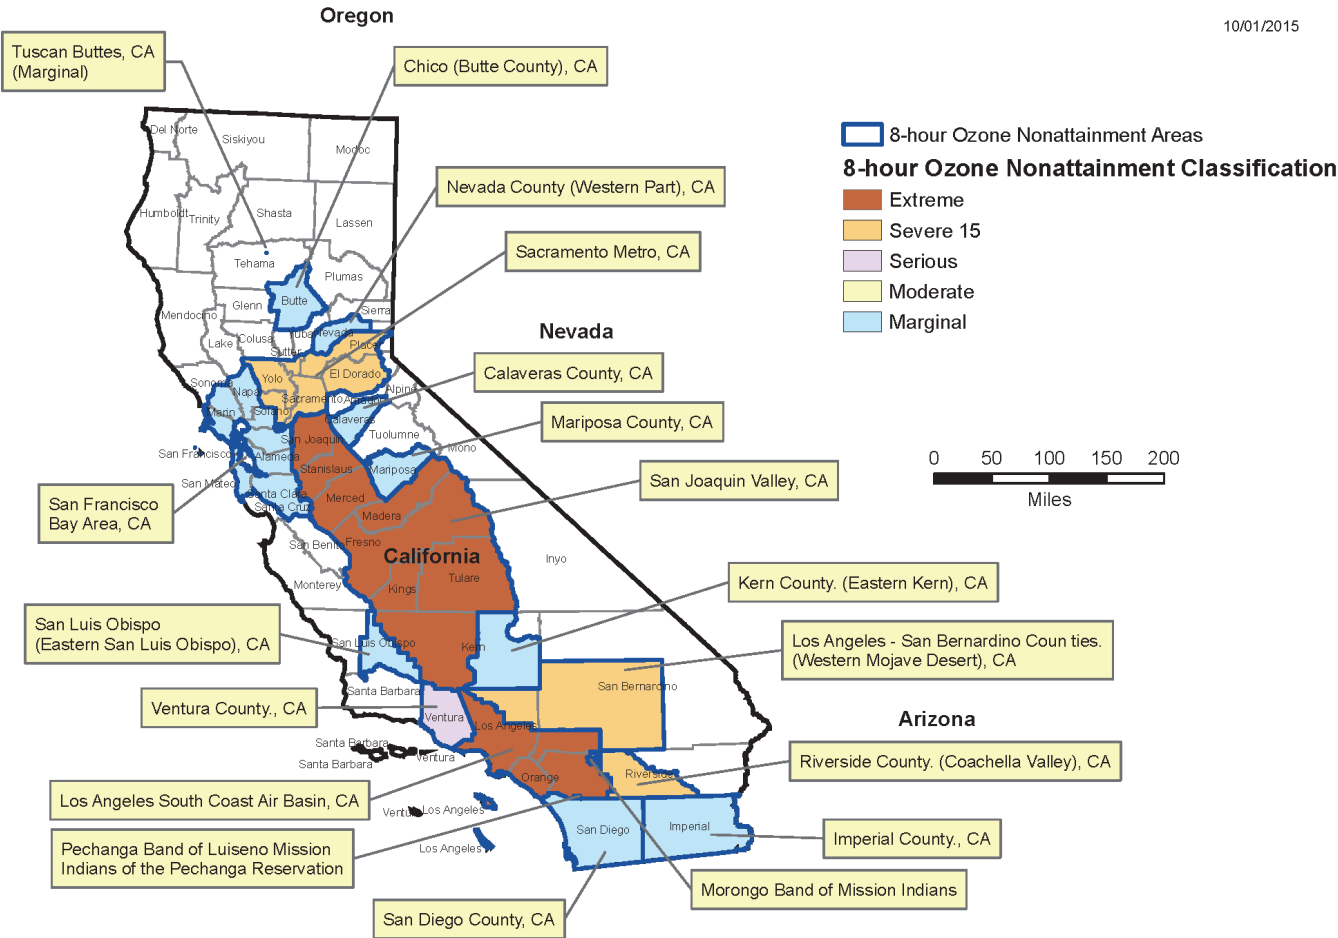


FIGURE F-1 California 8-hour ozone nonattainment areas. (Source: USEPA)