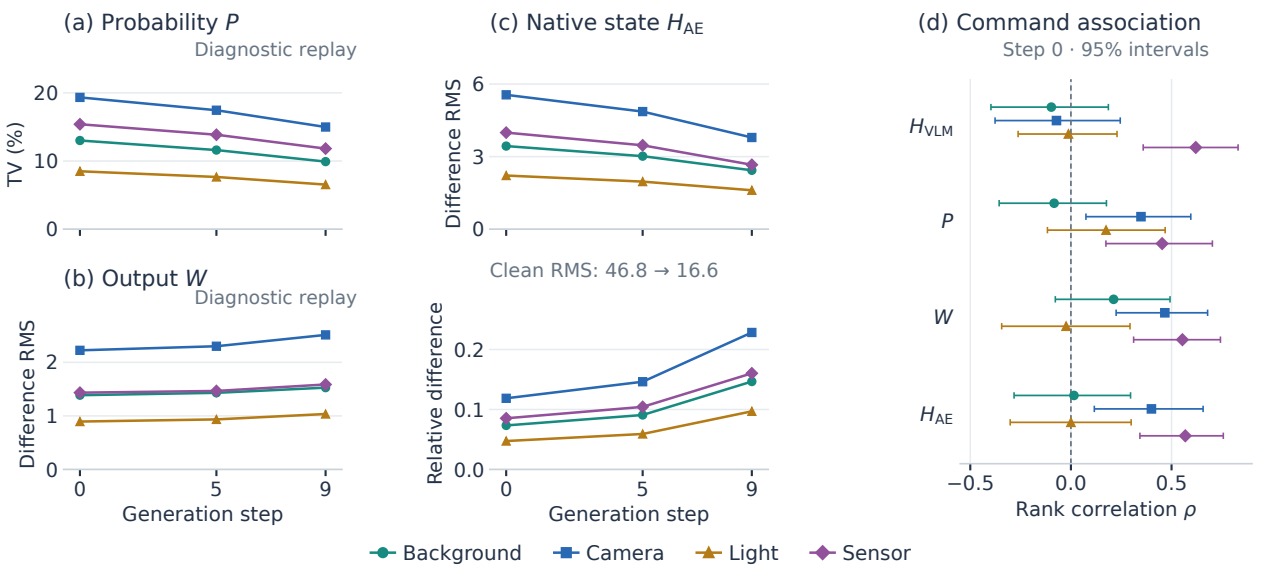

(a) Probability P
Diagnostic replay
TV (%)
20
10
0
(b) Output W
Diagnostic replay
Difference RMS
2
1
0
0
5
9
Generation step
(c) Native state H_{AE}
Difference RMS
6
3
0
Clean RMS: 46.8 → 16.6
Relative difference
0.2
0.1
0.0
0
5
9
Generation step
(d) Command association
Step 0 · 95% intervals
H_{VLM}
P
W
H_{AE}
−0.5
0.0
0.5
Rank correlation ρ
Background
Camera
Light
Sensor