
BSSE-corrected M-B terms for Cl (H2O) ion inside

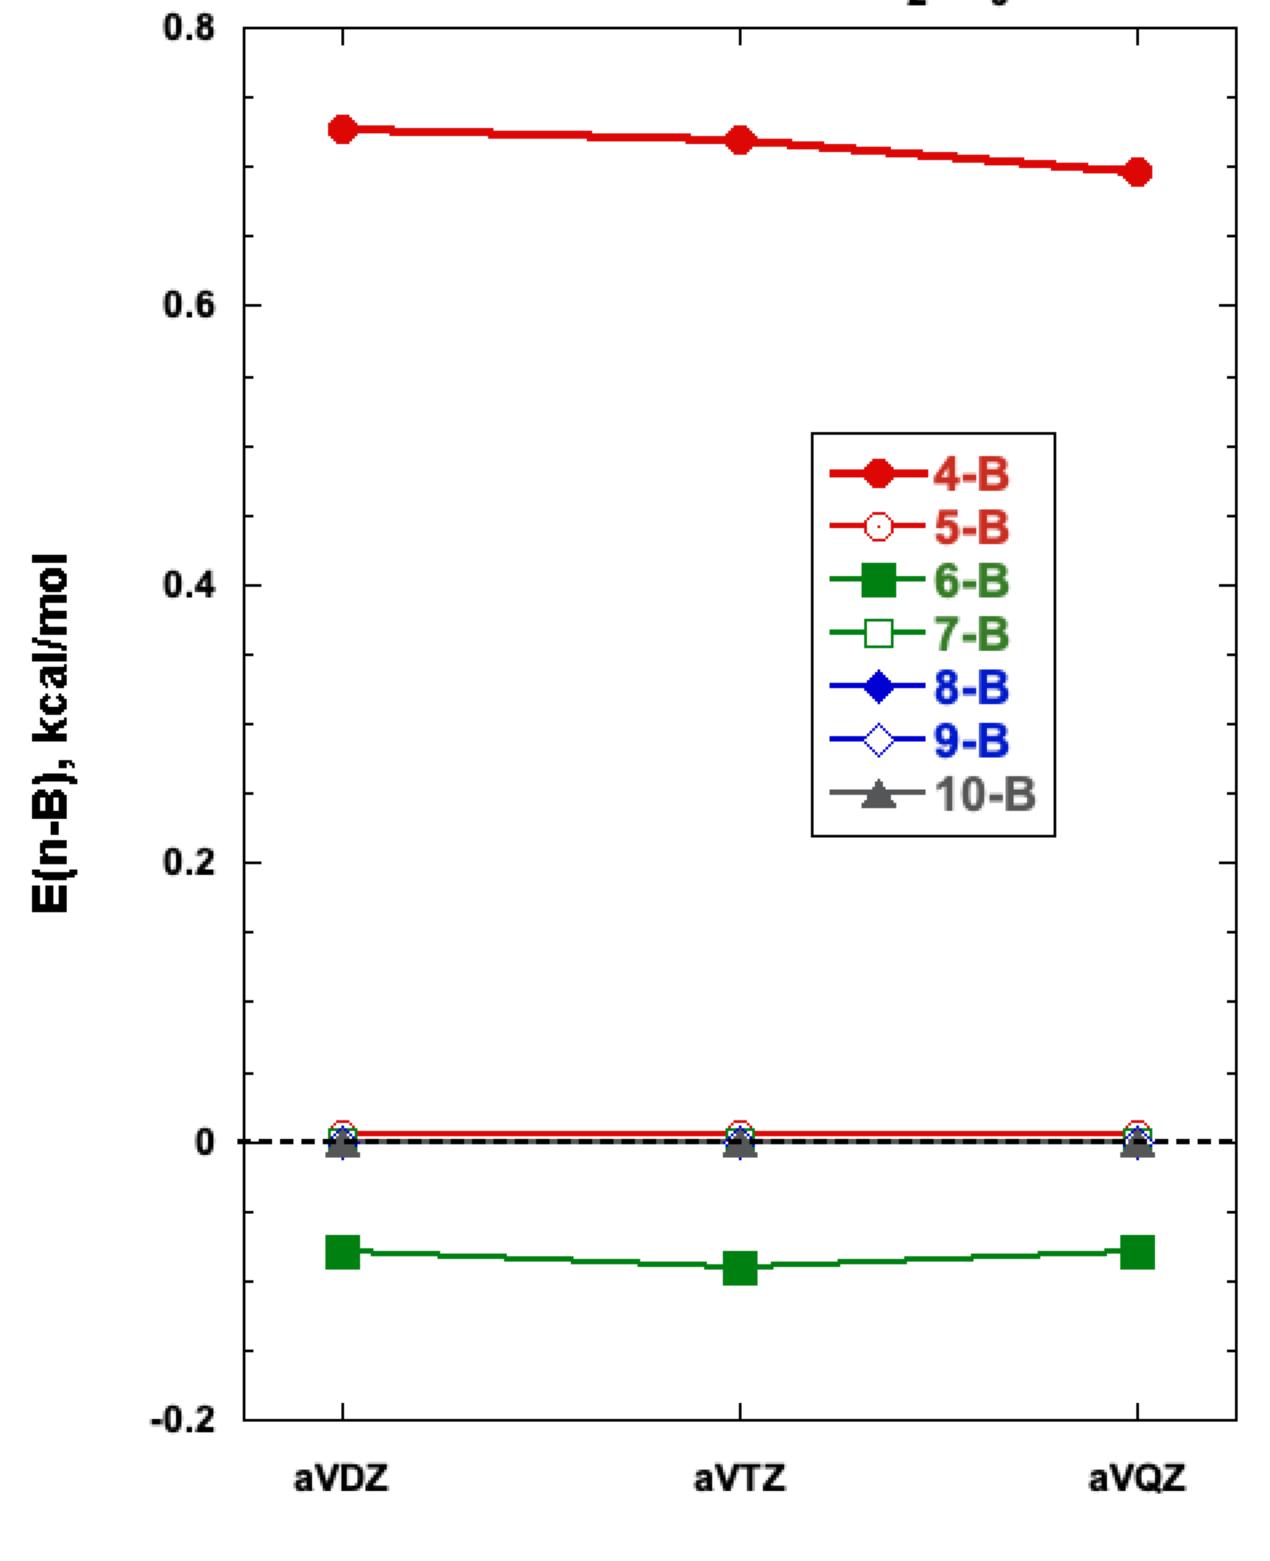

Basis set