


Final Test Accuracy vs Participation

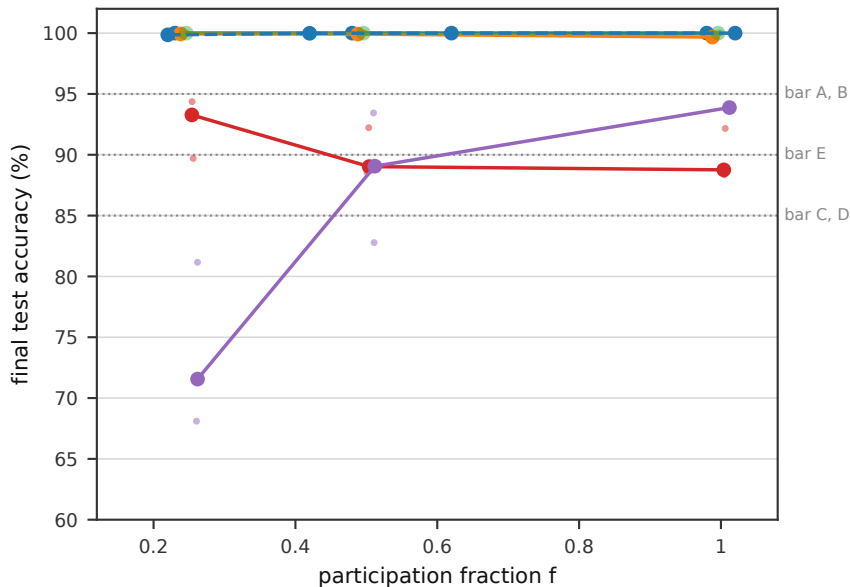

- A: quad-MLP, mod 97, GD, K = 20
- B: transformer, mod 113, K = 20
- C: transformer, S_5 (withheld), K = 20
- D: quad-MLP, S_5 , K = 20
- E: MLP, MNIST, K = 20
- A: K = 50