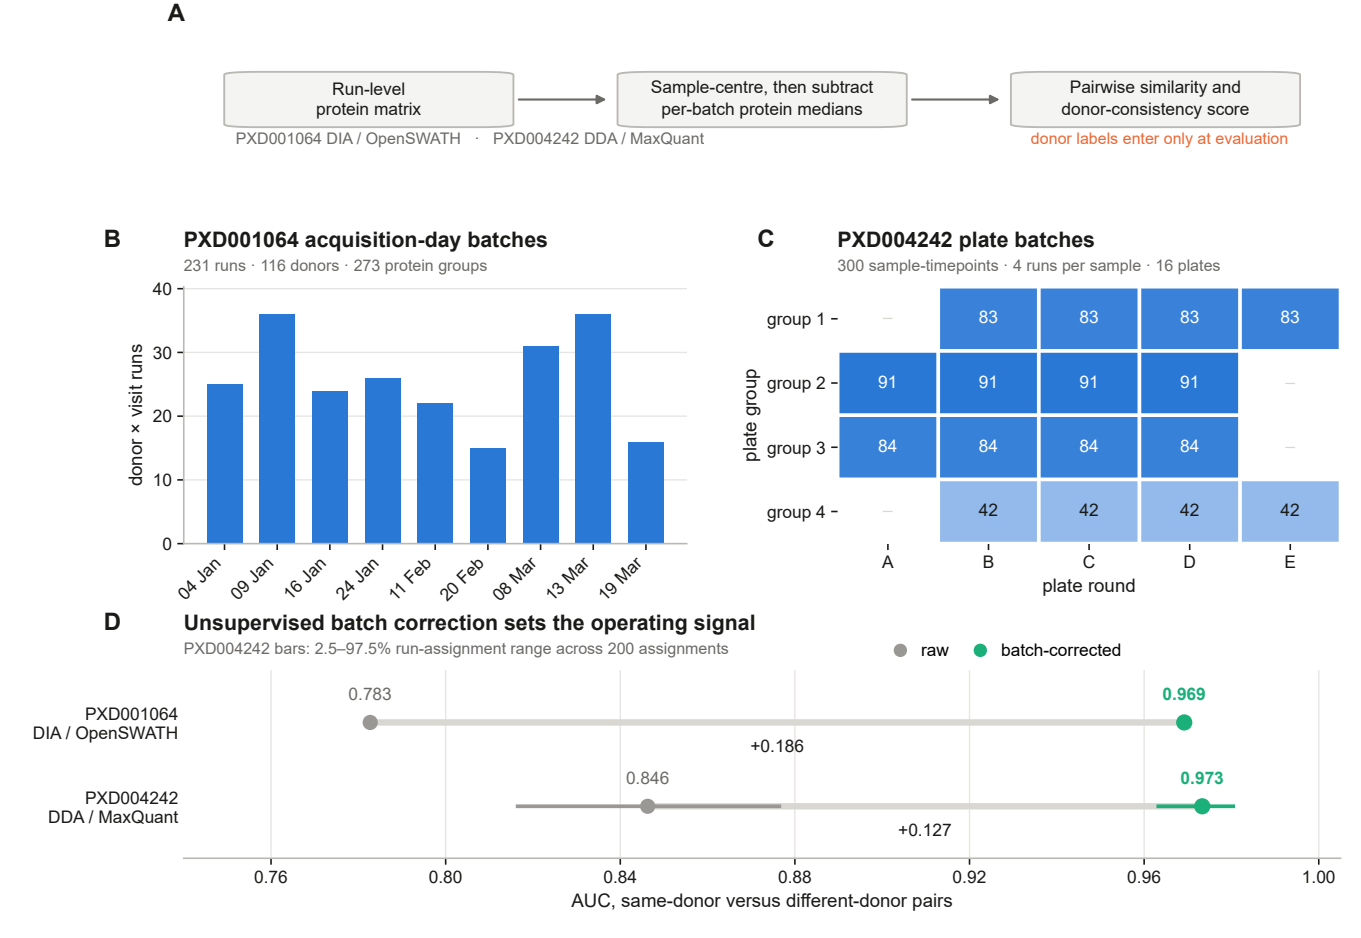

A
Run-level protein matrix
Sample-centre, then subtract per-batch protein medians
Pairwise similarity and donor-consistency score
PXD001064 DIA / OpenSWATH · PXD004242 DDA / MaxQuant
donor labels enter only at evaluation
B
PXD001064 acquisition-day batches
231 runs · 116 donors · 273 protein groups
donor × visit runs
04 Jan
09 Jan
16 Jan
24 Jan
11 Feb
20 Feb
08 Mar
13 Mar
19 Mar
C
PXD004242 plate batches
300 sample-timepoints · 4 runs per sample · 16 plates
plate group
group 1
group 2
group 3
group 4
plate round
D
Unsupervised batch correction sets the operating signal
PXD004242 bars: 2.5–97.5% run-assignment range across 200 assignments
raw
batch-corrected
PXD001064 DIA / OpenSWATH
PXD004242 DDA / MaxQuant
0.783
0.969
+0.186
0.846
0.973
+0.127
AUC, same-donor versus different-donor pairs