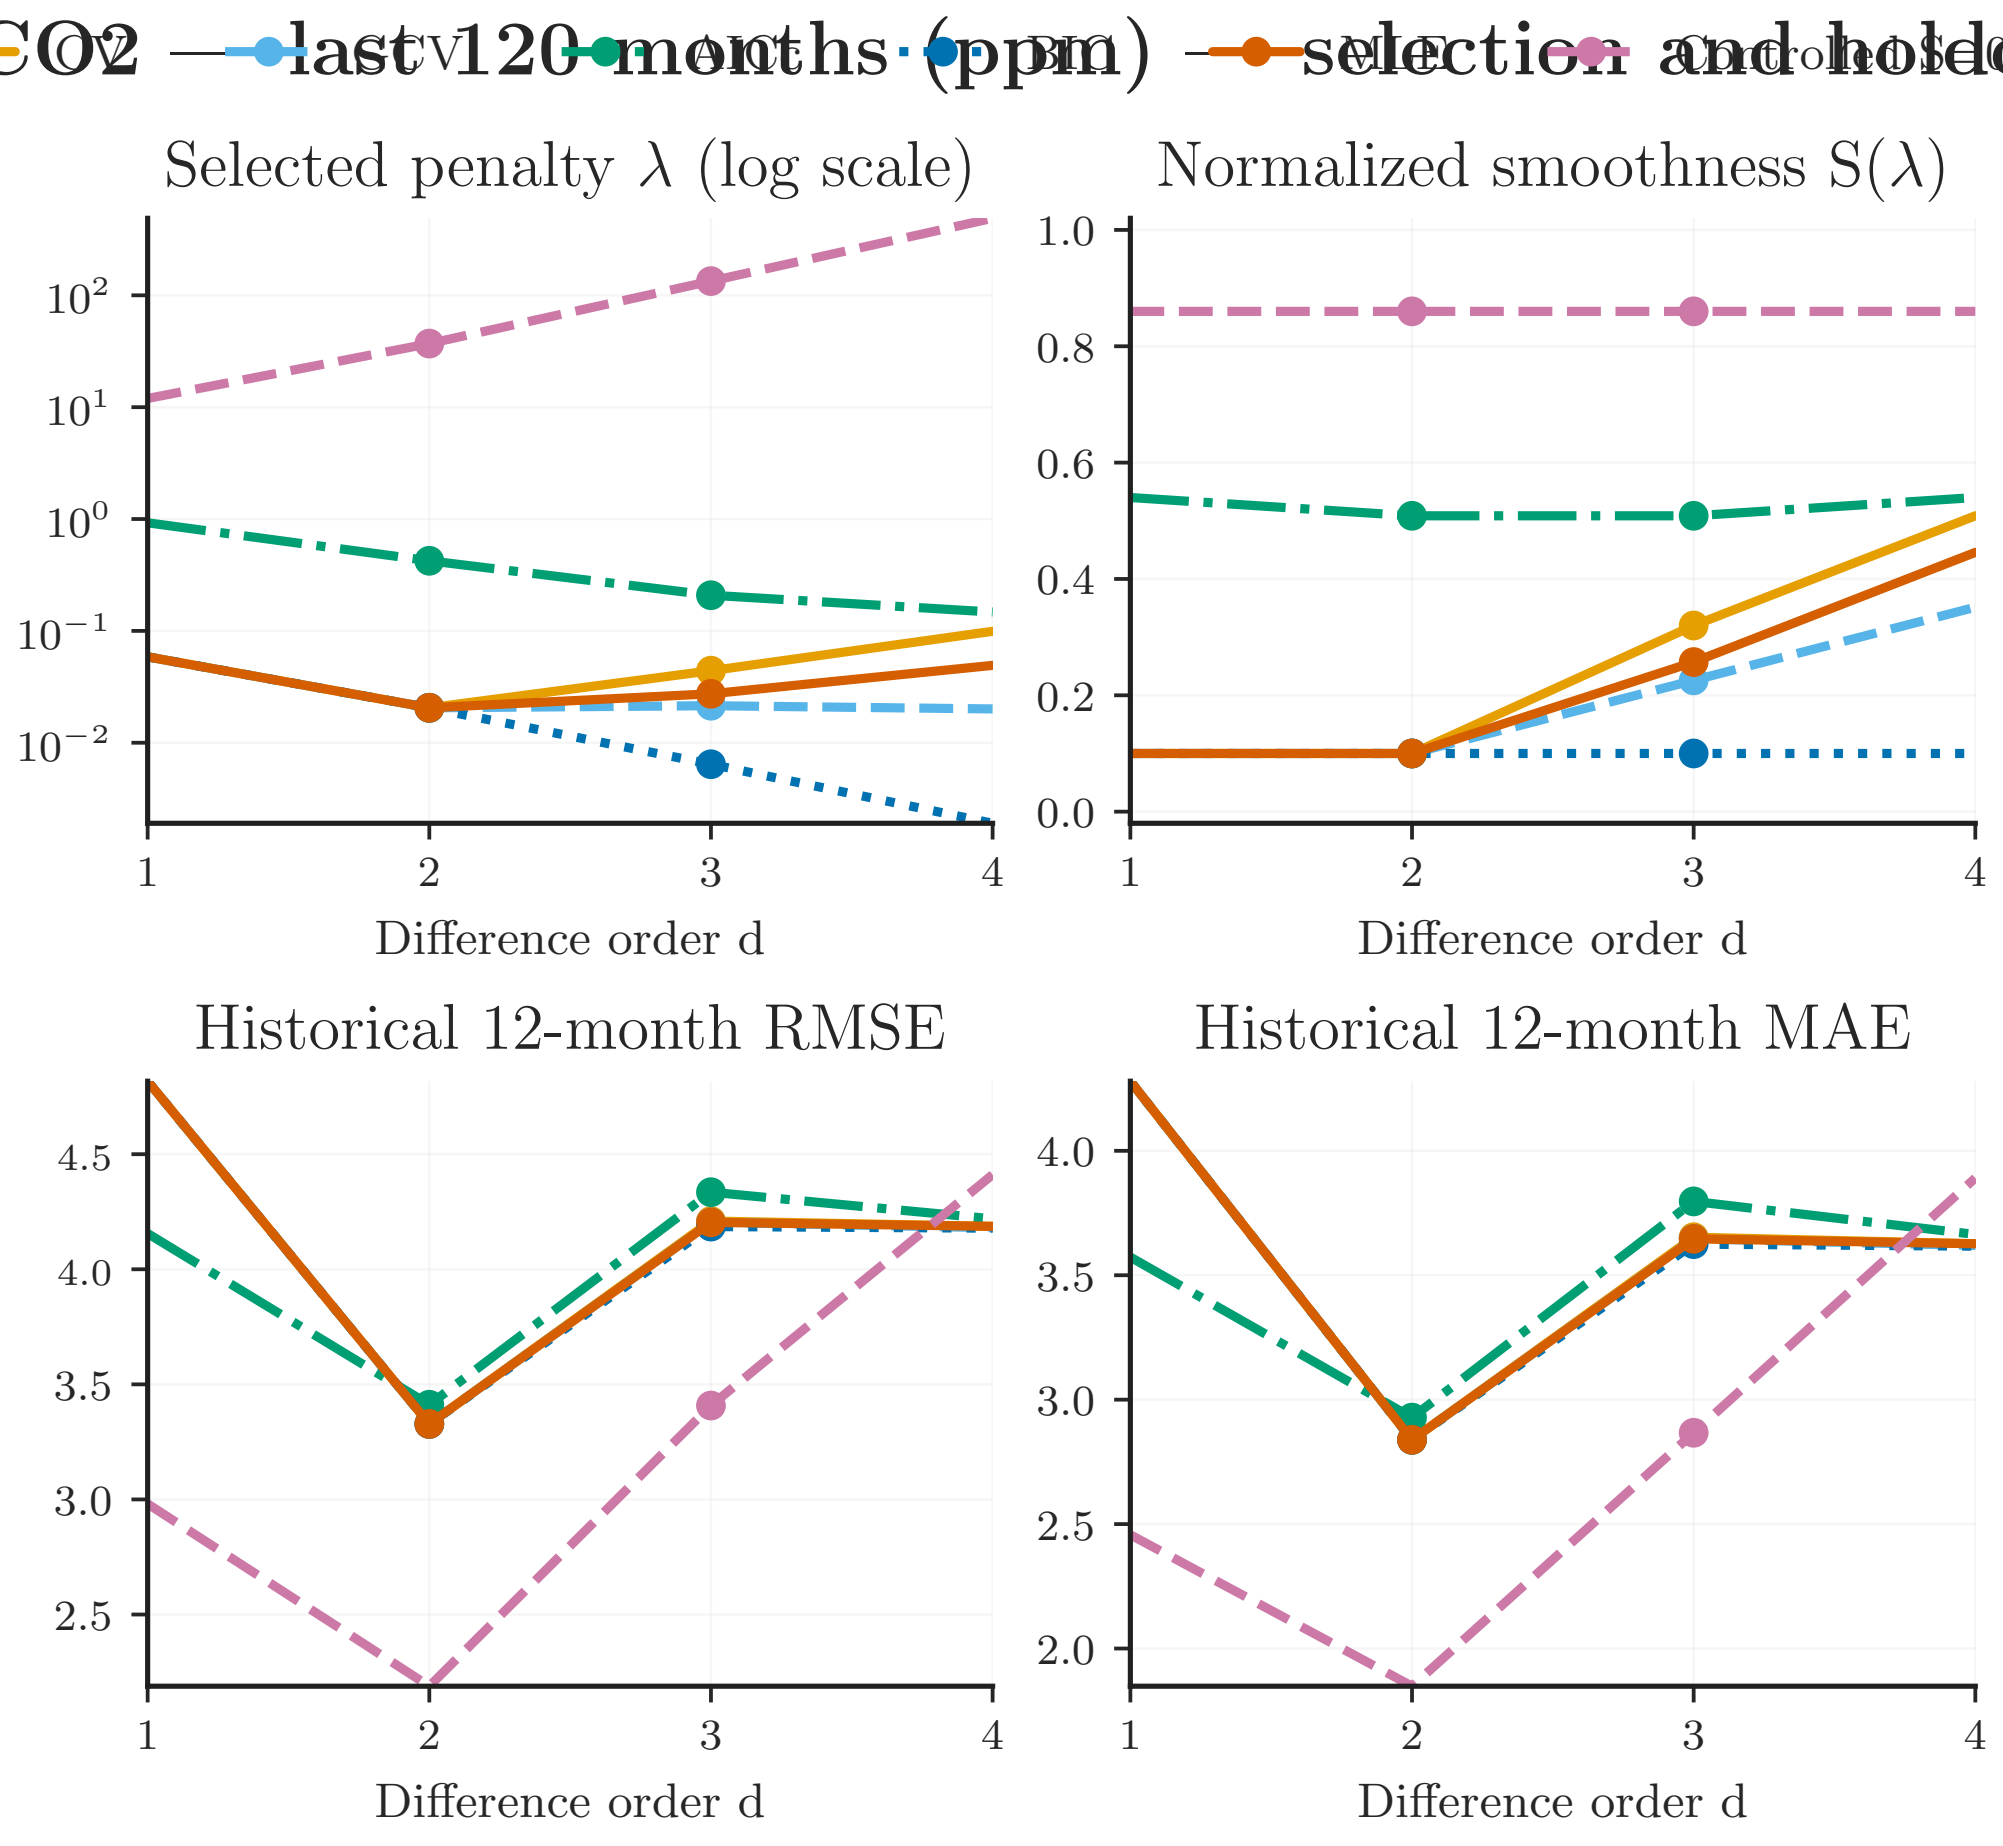

CO2 — last 120 months (ppm) — selection and hold
GCV
AIC
BIC
MBIC
Controlled
Selected penalty λ (log scale)
Normalized smoothness S(λ)
Difference order d
Historical 12-month RMSE
Historical 12-month MAE