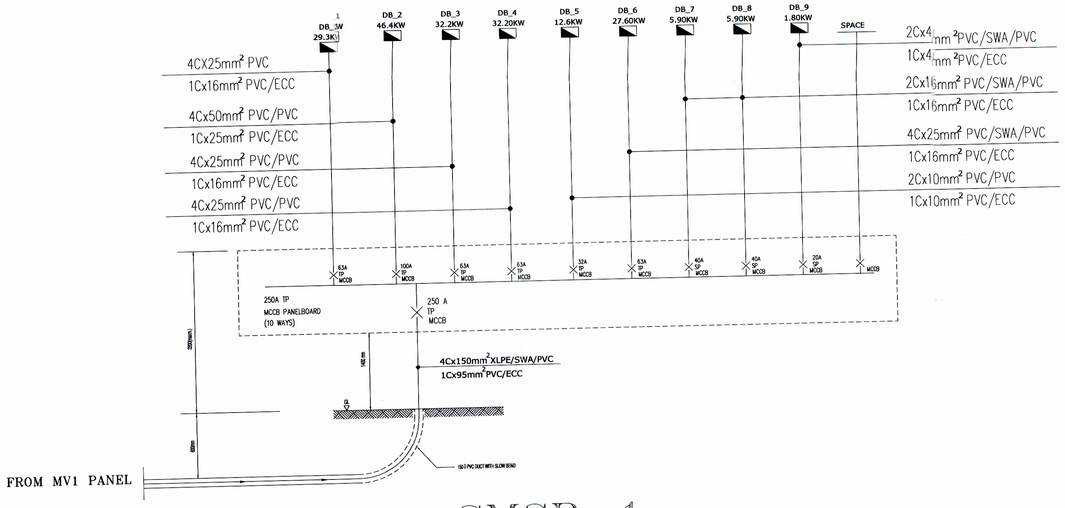

SMSB-1

SMSB-1

A.C.	W.H.	C.C.U	G.L	T.L.
79.00	14.00	0.00	100.90	193.90

Total connected load = 1938.90 KW

Maximum demand load = 143.74KW

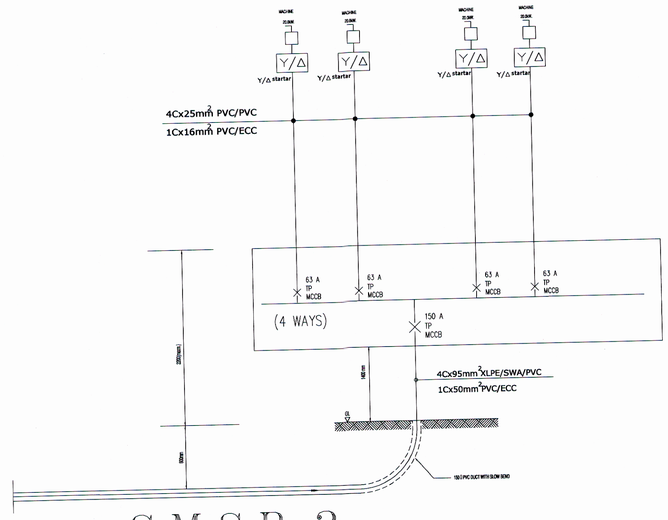

S.M.S.B 2

S.M.S.B2

A/C	W/H	C.C.U	M/C	G.L	TOTAL
0.0	0.0	0.0	80.0	0.0	80.0

TOTAL CONNECTED LOAD= 80.00 KW

MAXIMUM DEMAND LOAD= 72.00 KW

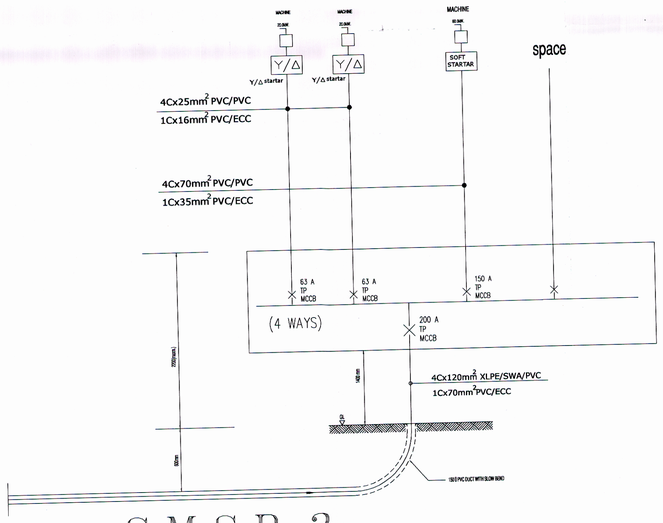

S.M.S.B 3

S.M.S.B3

A/C	W/H	C.C.U	M/C	G.L	TOTAL
0.0	0.0	0.0	100.0	0.0	100.0

TOTAL CONNECTED LOAD= 100.00 KW

MAXIMUM DEMAND LOAD= 90.00 KW

69105
21/5/2013

U.D.D STAMP

MUNICIPALITY STAMP

Municipality of Ramallah & Al-Bireh
Urban Planning & Water Corporations
دائرة حسب المصرف
20 MAY 2013
رخص البناء / كهرباء

Enquiry No. :	Application No. :
CONSULTANT REG. No : / GRADE : A	CONSULTANT REG. No : / GRADE : A
CONSULTANT STAMP & SIGNATURE :	SUB-CONSULTANT STAMP & SIGNATURE :
TECHNIQAL MANAGER :	TECHNIQAL MANAGER
REGISTRATION No. :	REGISTRATION No :

الأقصى للاستشارات الهندسية

Al- AQSA Engineering Consultancy (Q.E.C)

PROJECT: **AGRI GREEN**

FACTORY(G), OFFICE(G+1), STORE AND DINING ROOM

LOCATION: INDUSTRIAL AREA

CLIENT: ENG. ADNAN FAHAD AL NAIMI

DATE: OCTOBER, 2012 | JOB NO.:

TITLE: ELECTRICAL LAYOUT S.L.D

DRAWING NO.: E-06	SCALE: N.T.S	
DRAWN BY:	DESIGNED BY: ENG:AHMED ATTIA	CHECKED BY: ENG:AHMED ATTIA
CAD FILE: ARCH. MOHD RADWAN	REGISTRATION No. :	REGISTRATION No. :
REVISION	SIGNATURE	SIGNATURE