


Parameter name and pulse sampling location	Input 4.5kW/20A 220 V	execution device	execution device	execution device	execution device	execution device	execution device	execution device	execution device	execution device	execution device	execution device	execution device
		Servomotor M1	Servomotor M1	Servomotor M2	Servomotor M2	Servomotor M3	Servomotor M3	Servomotor M4	Servomotor M4	Servomotor M5	Servomotor M5	Servomotor M6	Servomotor M6
Positional designation		M1	M1	M2	M2	M3	M3	M4	M4	M5	M5	M6	M6

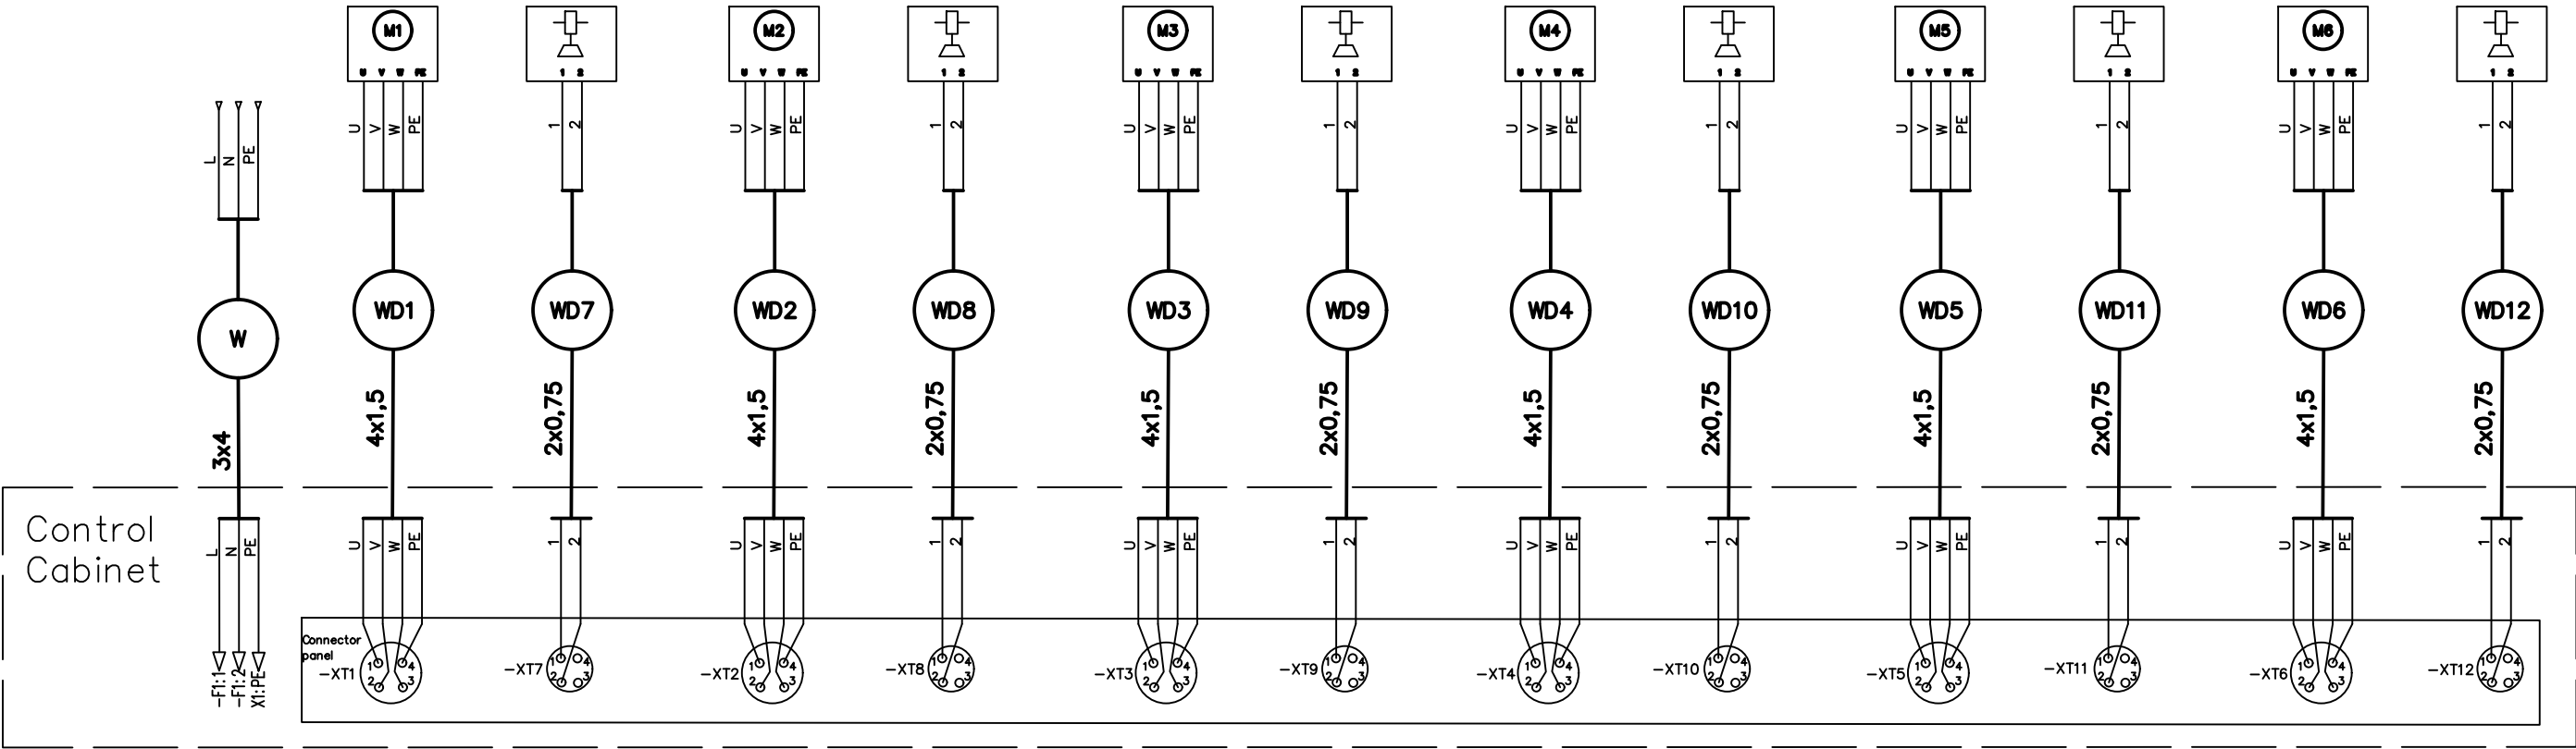

			Date		Control Cabinet Rev 1.1				
			Ed.						
			Appr.						
Modification	Date	Name	Original		Replaced by				Page 1
									Page 1