
CARBONMIRROR REV B — METER — DEVELOPMENT / ENERGIZATION HOLD

HOT_* = LIVE LINE REFERENCED. Never connect hot ground to PE, USB, isolated ground or accessible metal.


Protected line -> Kelvin shunt -> relay COM. Voltage samples input L–N; separate ACPL–K376 senses switched output.

01 LOAD SHUNT + MATCHED RC

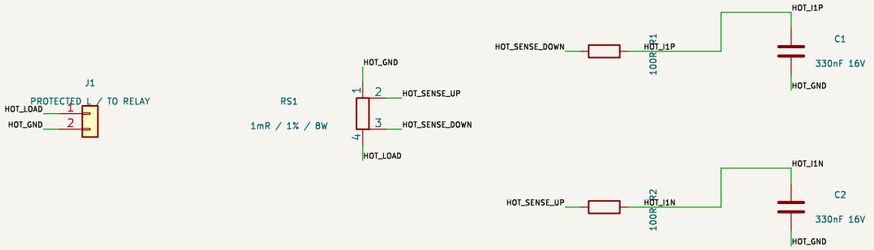


02 VOLTAGE DIVIDER + FILTER


03 ATM90E26 AFE

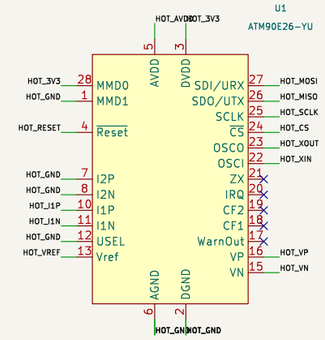


04 REINFORCED SPI BARRIER

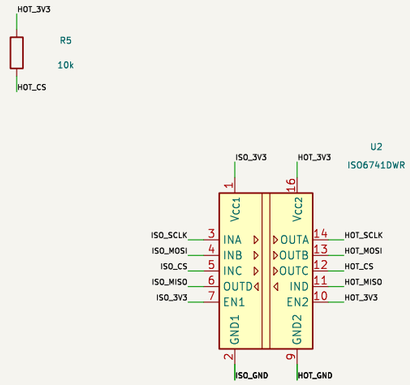


05 ISOLATED POWER 5V -> 3.3V



06 CLOCK / RESET / DECOUPLING

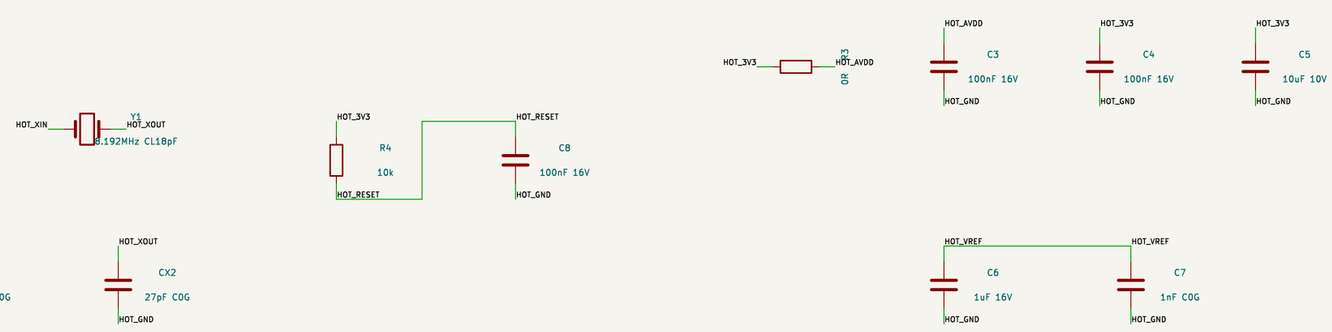



Sheet: /
File: meter.kicad_sch

Title: CarbonMirror REV B isolated metering

Size: A3	Date:	Rev: ENGINEERING CANDIDATE
KiCad E.D.A. 9.0.2		Id: 1/1