


CARBONMIRROR REV B - METER - DEVELOPMENT / ENERGIZATION HOLD


HOT_* = LIVE LINE REFERENCED. Never connect hot ground to PE, USB, isolated ground or accessible metal.

Protected line -> Kelvin shunt -> relay COM. Voltage samples Input L-N: separate ACPL-K376 senses switched output.


01 LOAD SHUNT + MATCHED RC

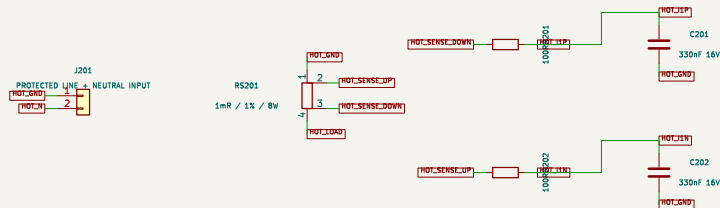


03 ATM90E26 AFE



02 VOLTAGE DIVIDER + FILTER

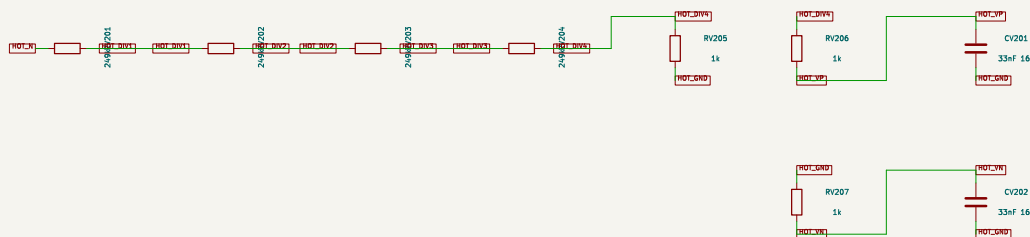

06 RESET / DECOUPLING; POWERED CLOCK ON OVERVIEW

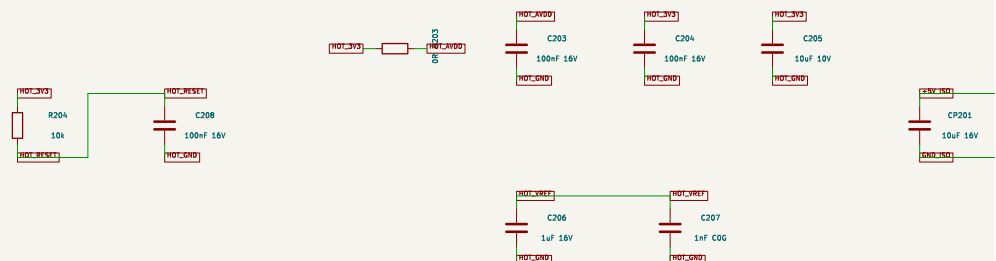

04 REINFORCE



05 ISOLATED P

