

8000 CFM

8000 CFM




8000 CFM


8000 CFM





AO

Control room



32000 CFM

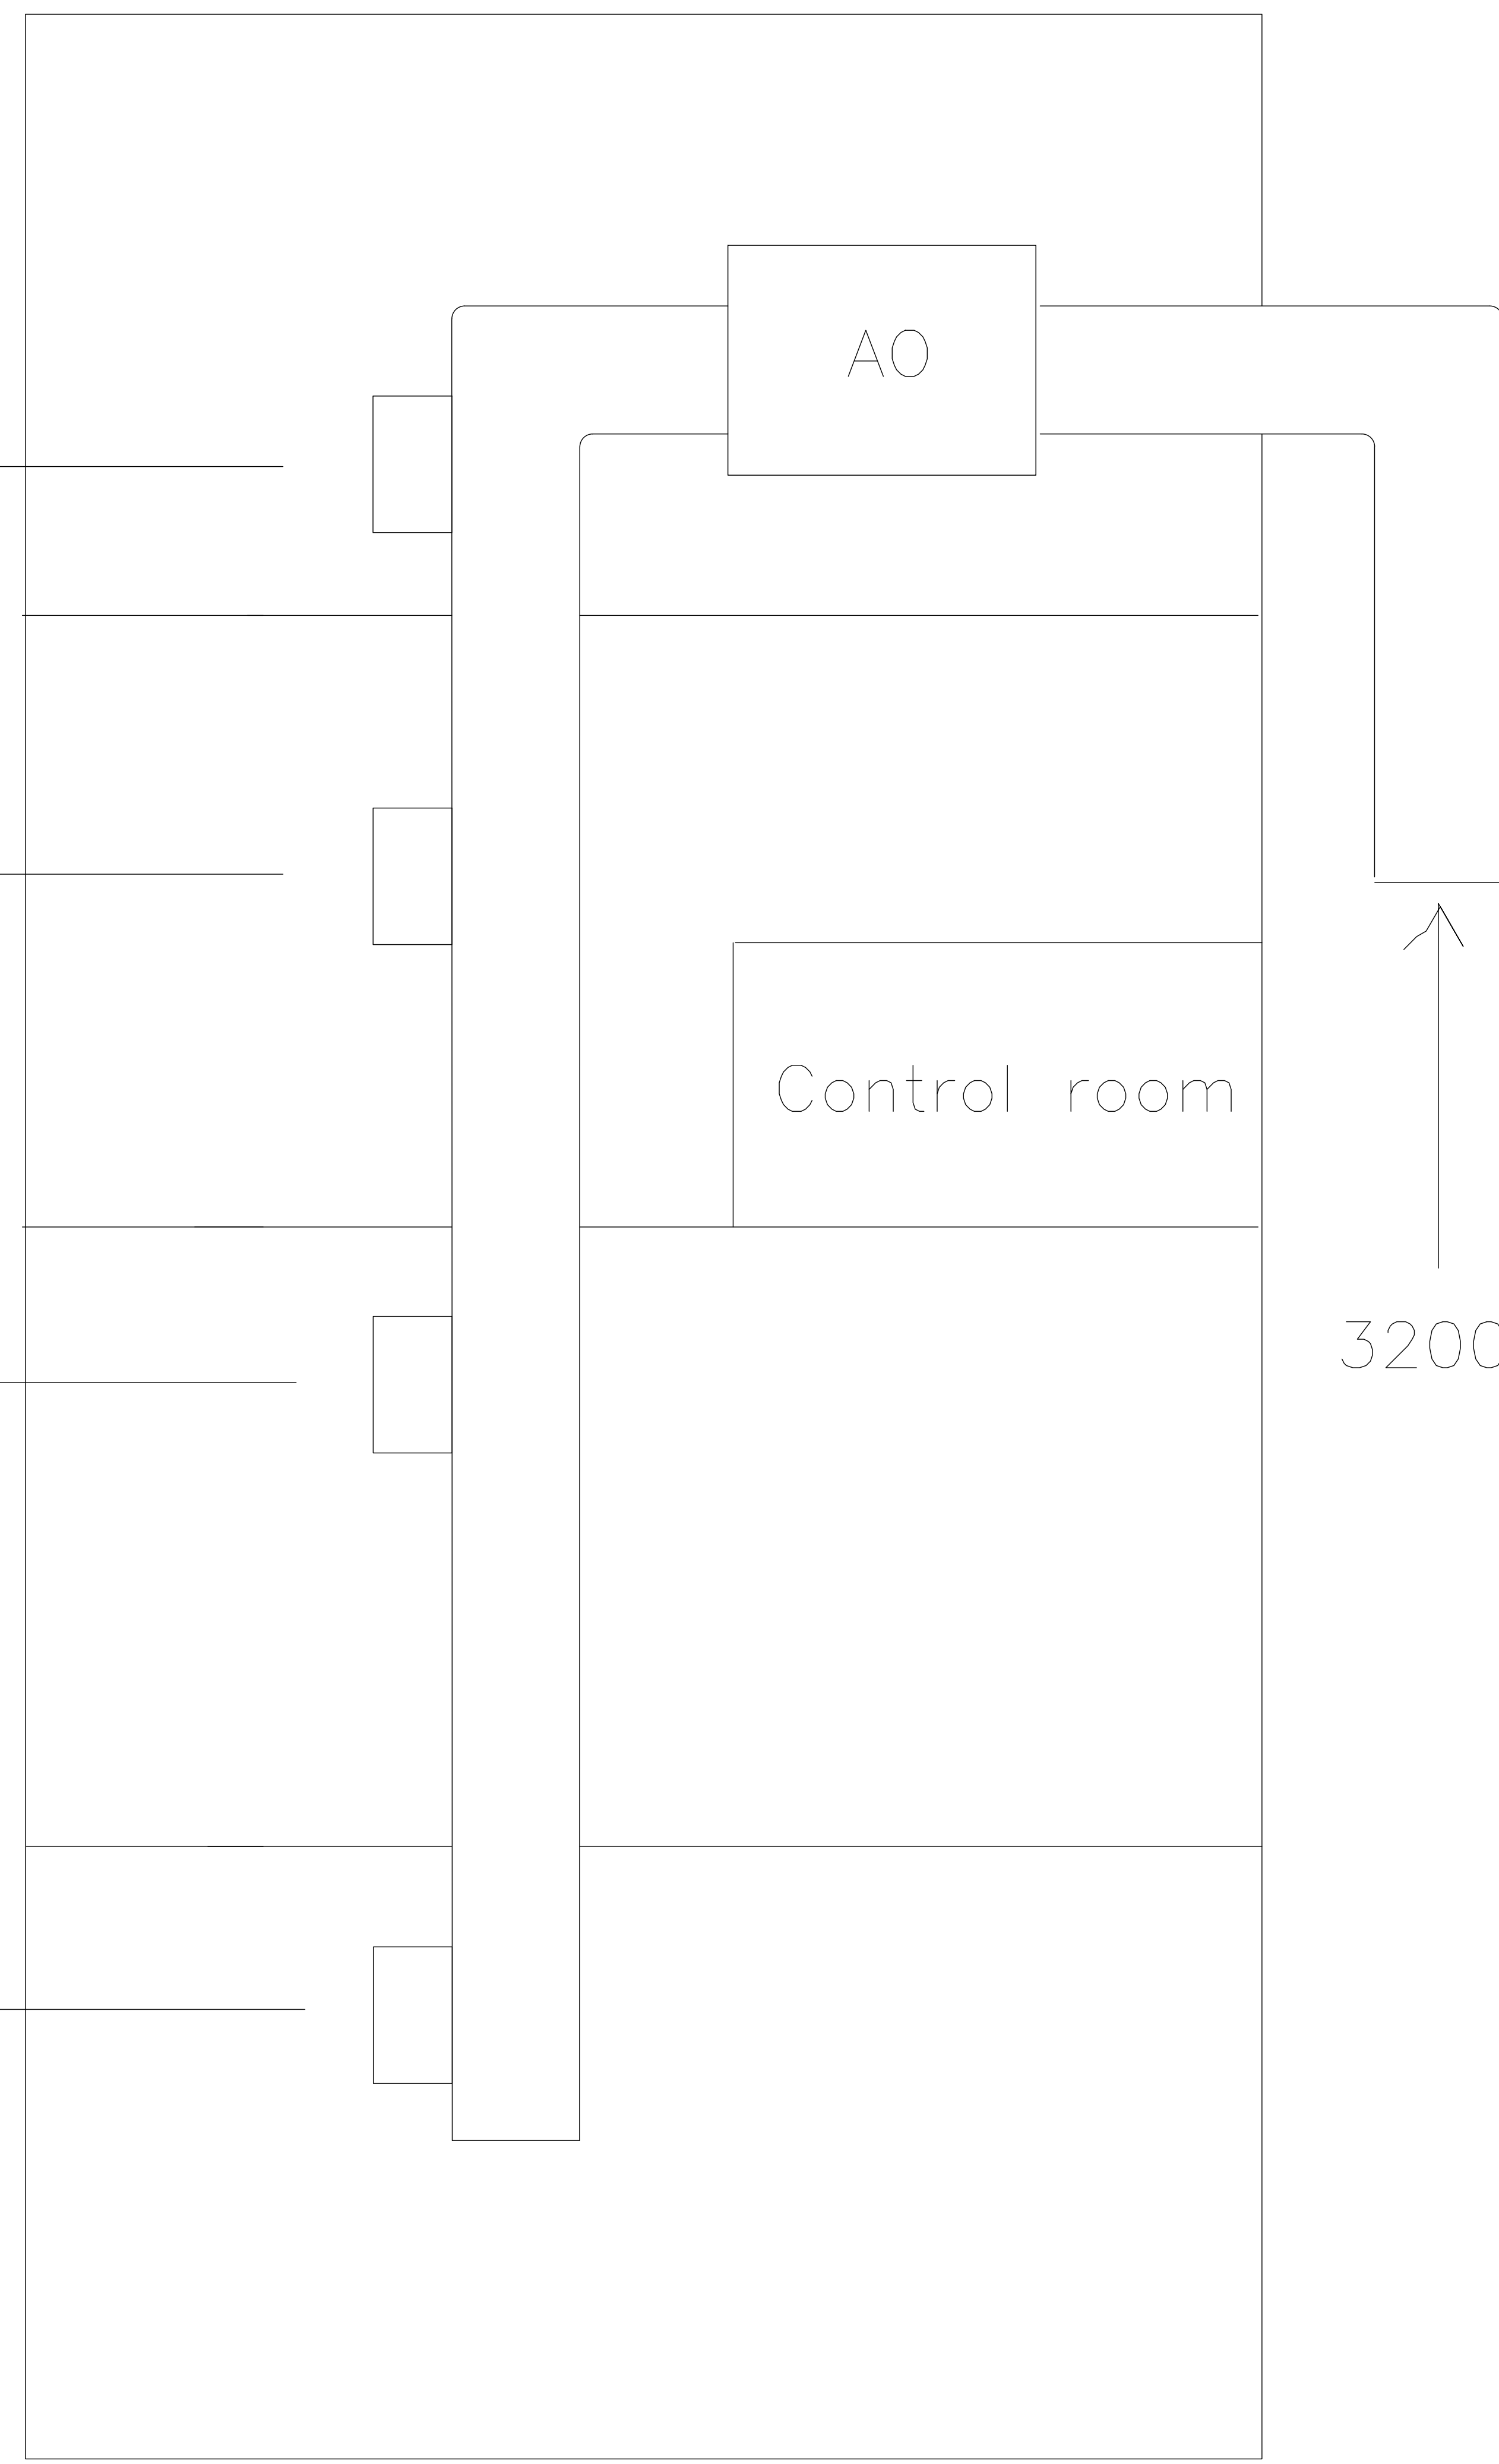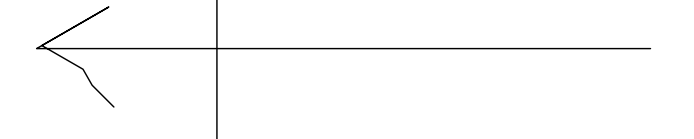



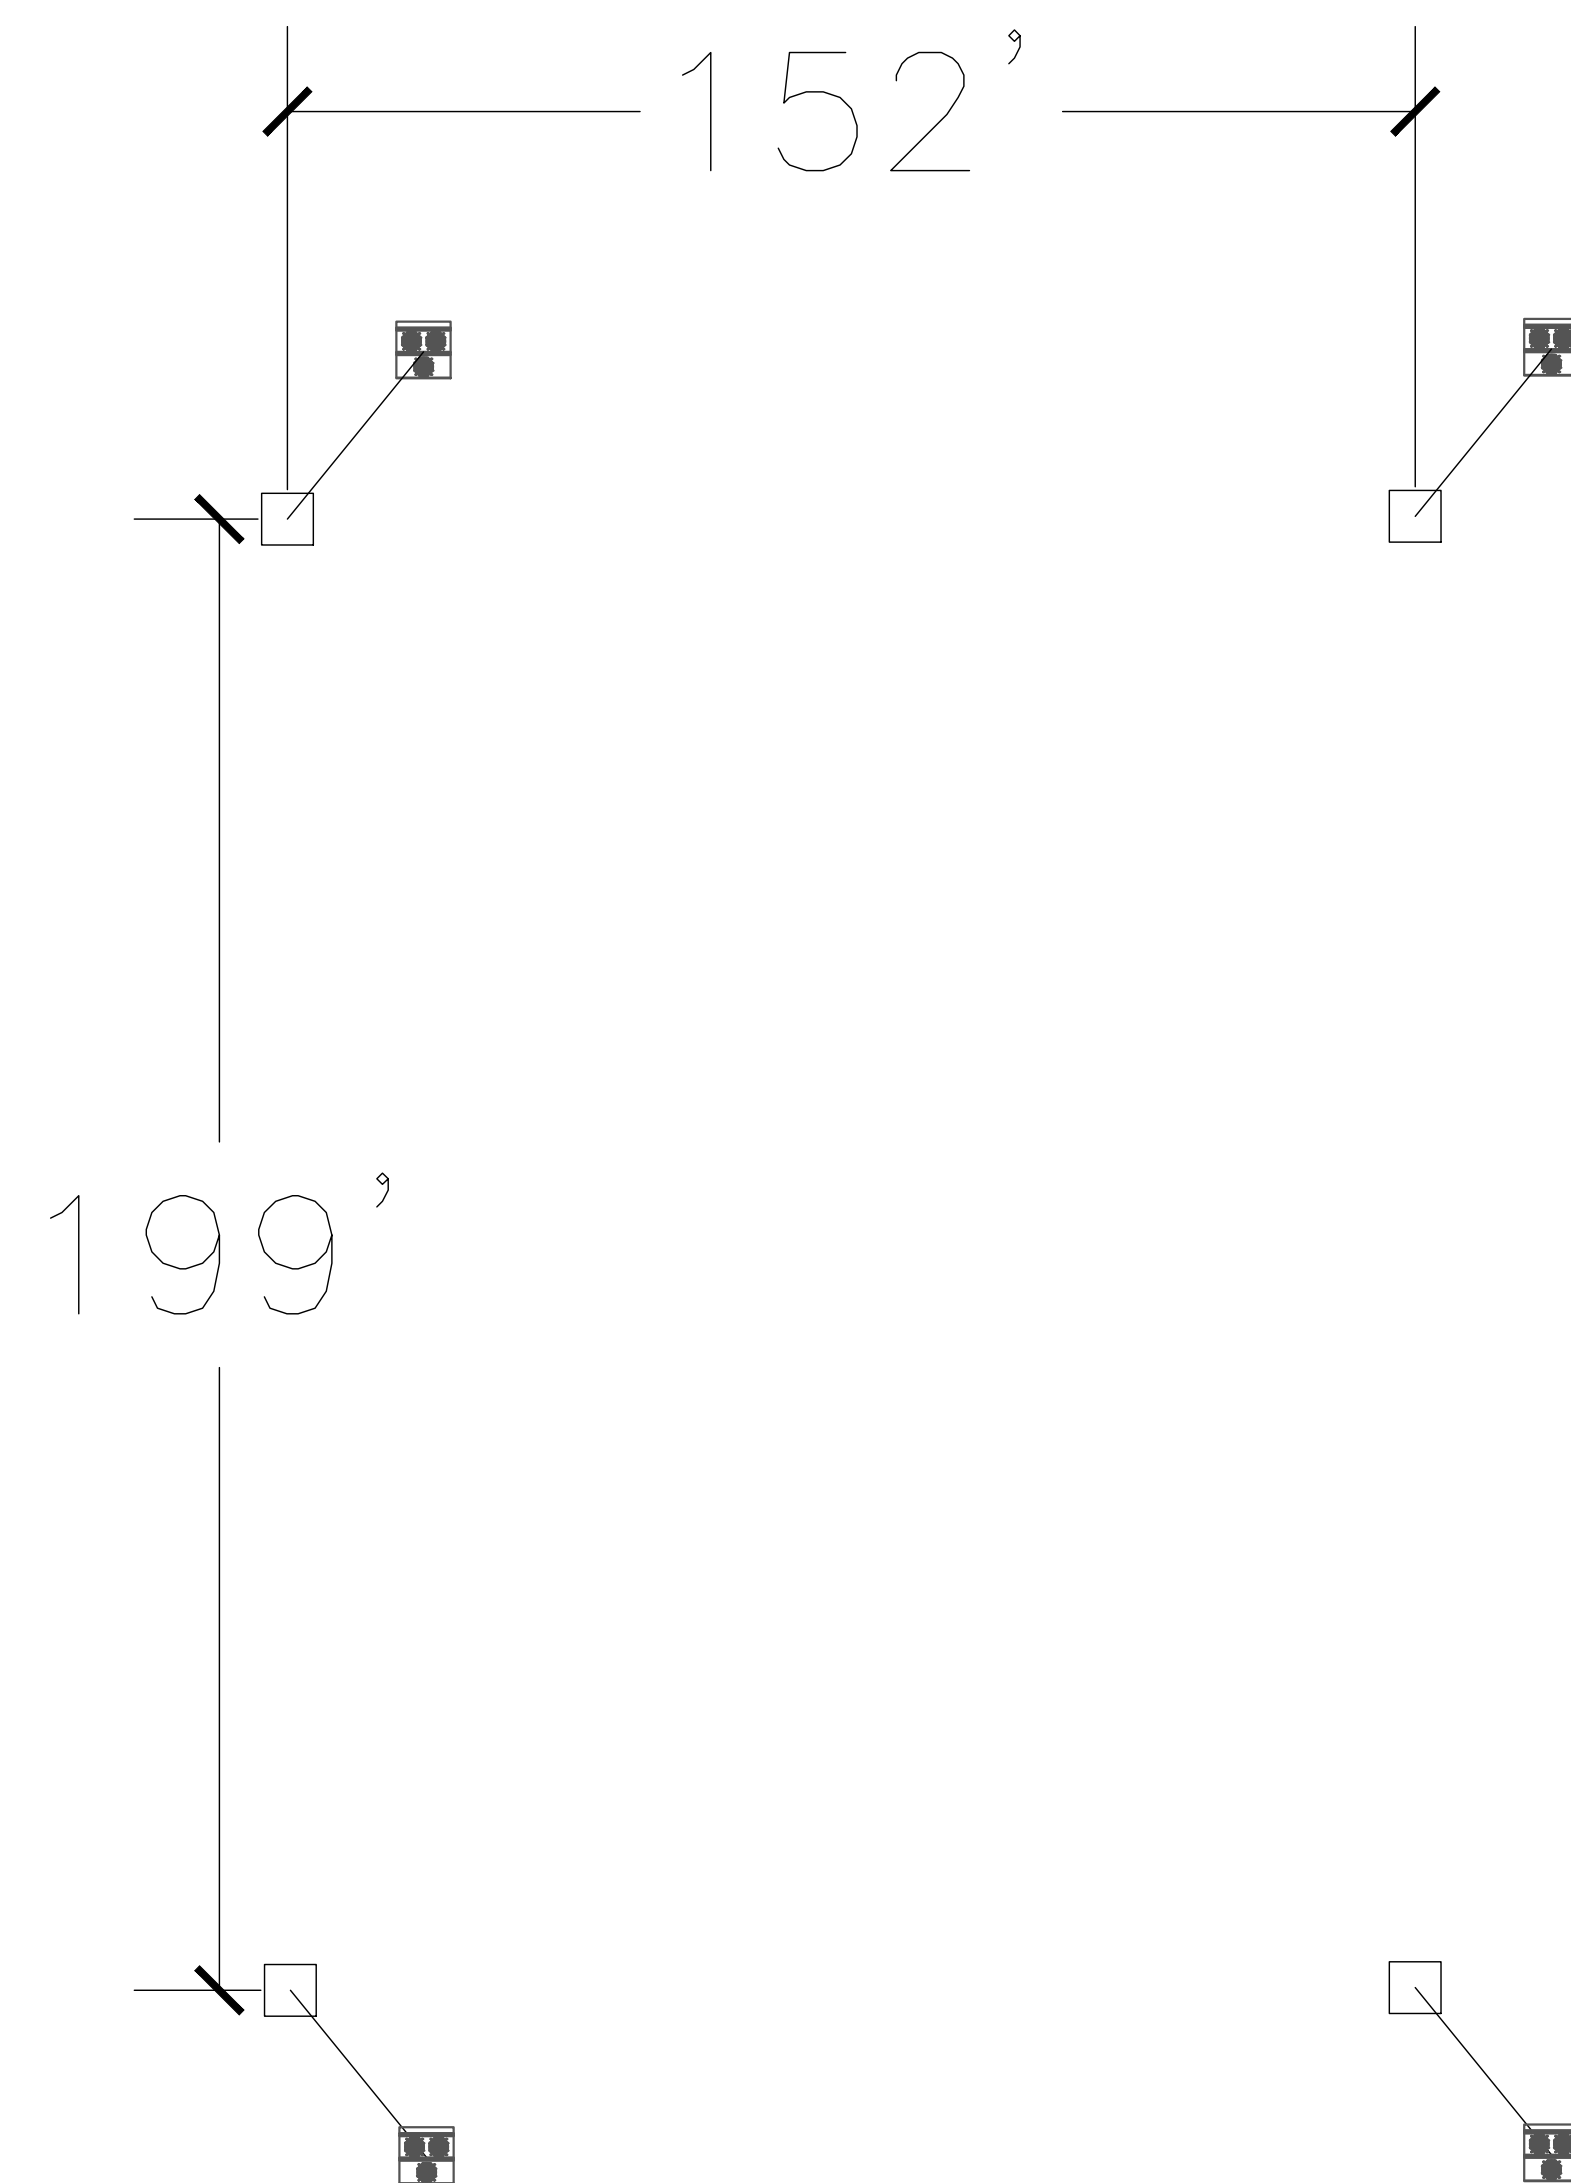

Vertical Air Rotation Unit

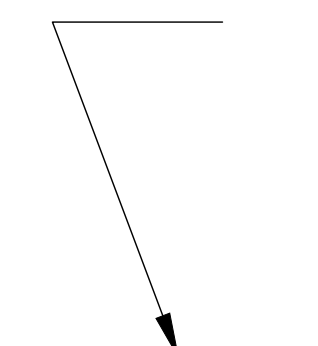

Daikin RCS110D
100-ton Air-Cooled
Condenser




RED: RETURN
BLUE: SUPPLY

Vertical Air Rotation Unit


199'


152'

1000-TON
CHILLER
PLANT



CHILLER
EVAPORATOR
CONNECTION:
10"

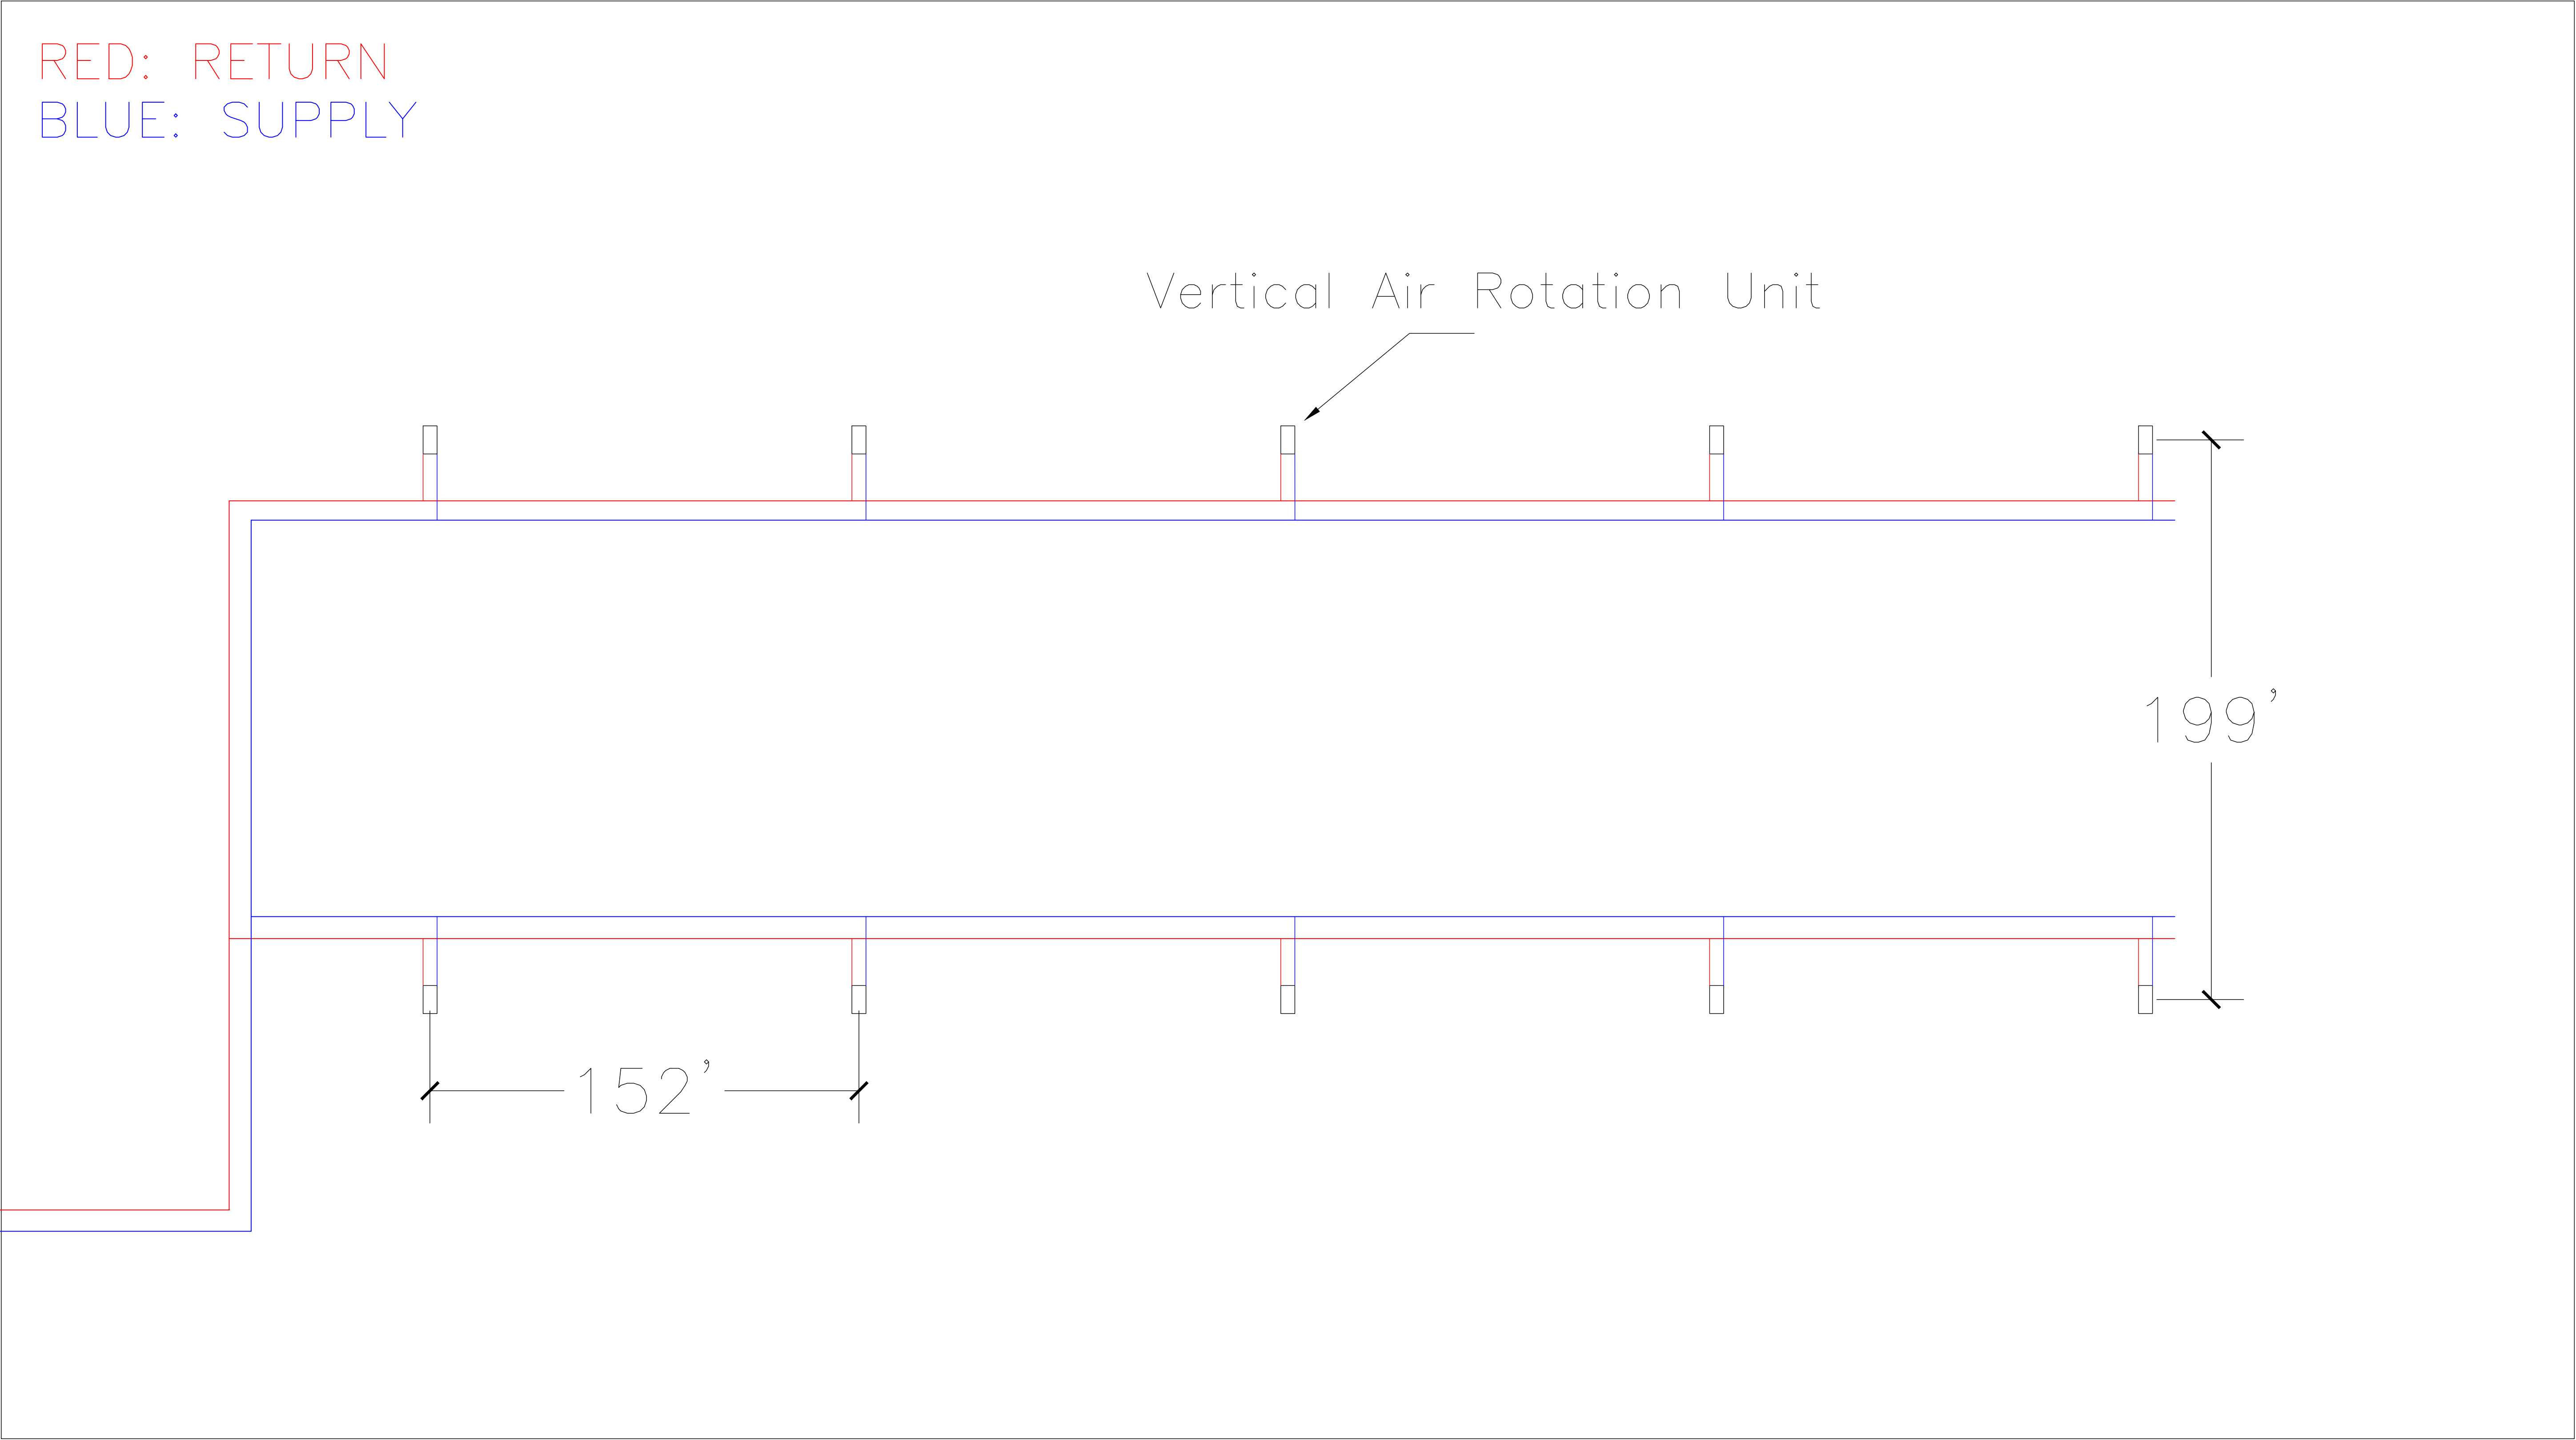

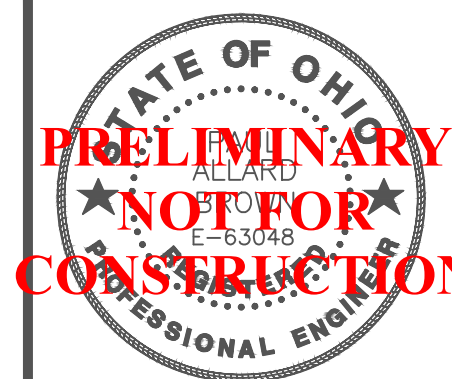

THE WELLINGTON AT DAYTON

2656 W ALEX BELL ROAD DAYTON OH, 45459

[illegible]

6.29.21	START
DATE	ISSUE/REVISION


We hereby expressly reserve the property rights to this drawing and it is not to be reproduced, copied in any format or manner whatsoever without first obtaining our express written permission and


DRAWN BY: KGH		CHECKED BY: PAB	
------------------	--	--------------------	--

JOB NUMBER
33621, OTHERS

M-1

SHEET NUMBER

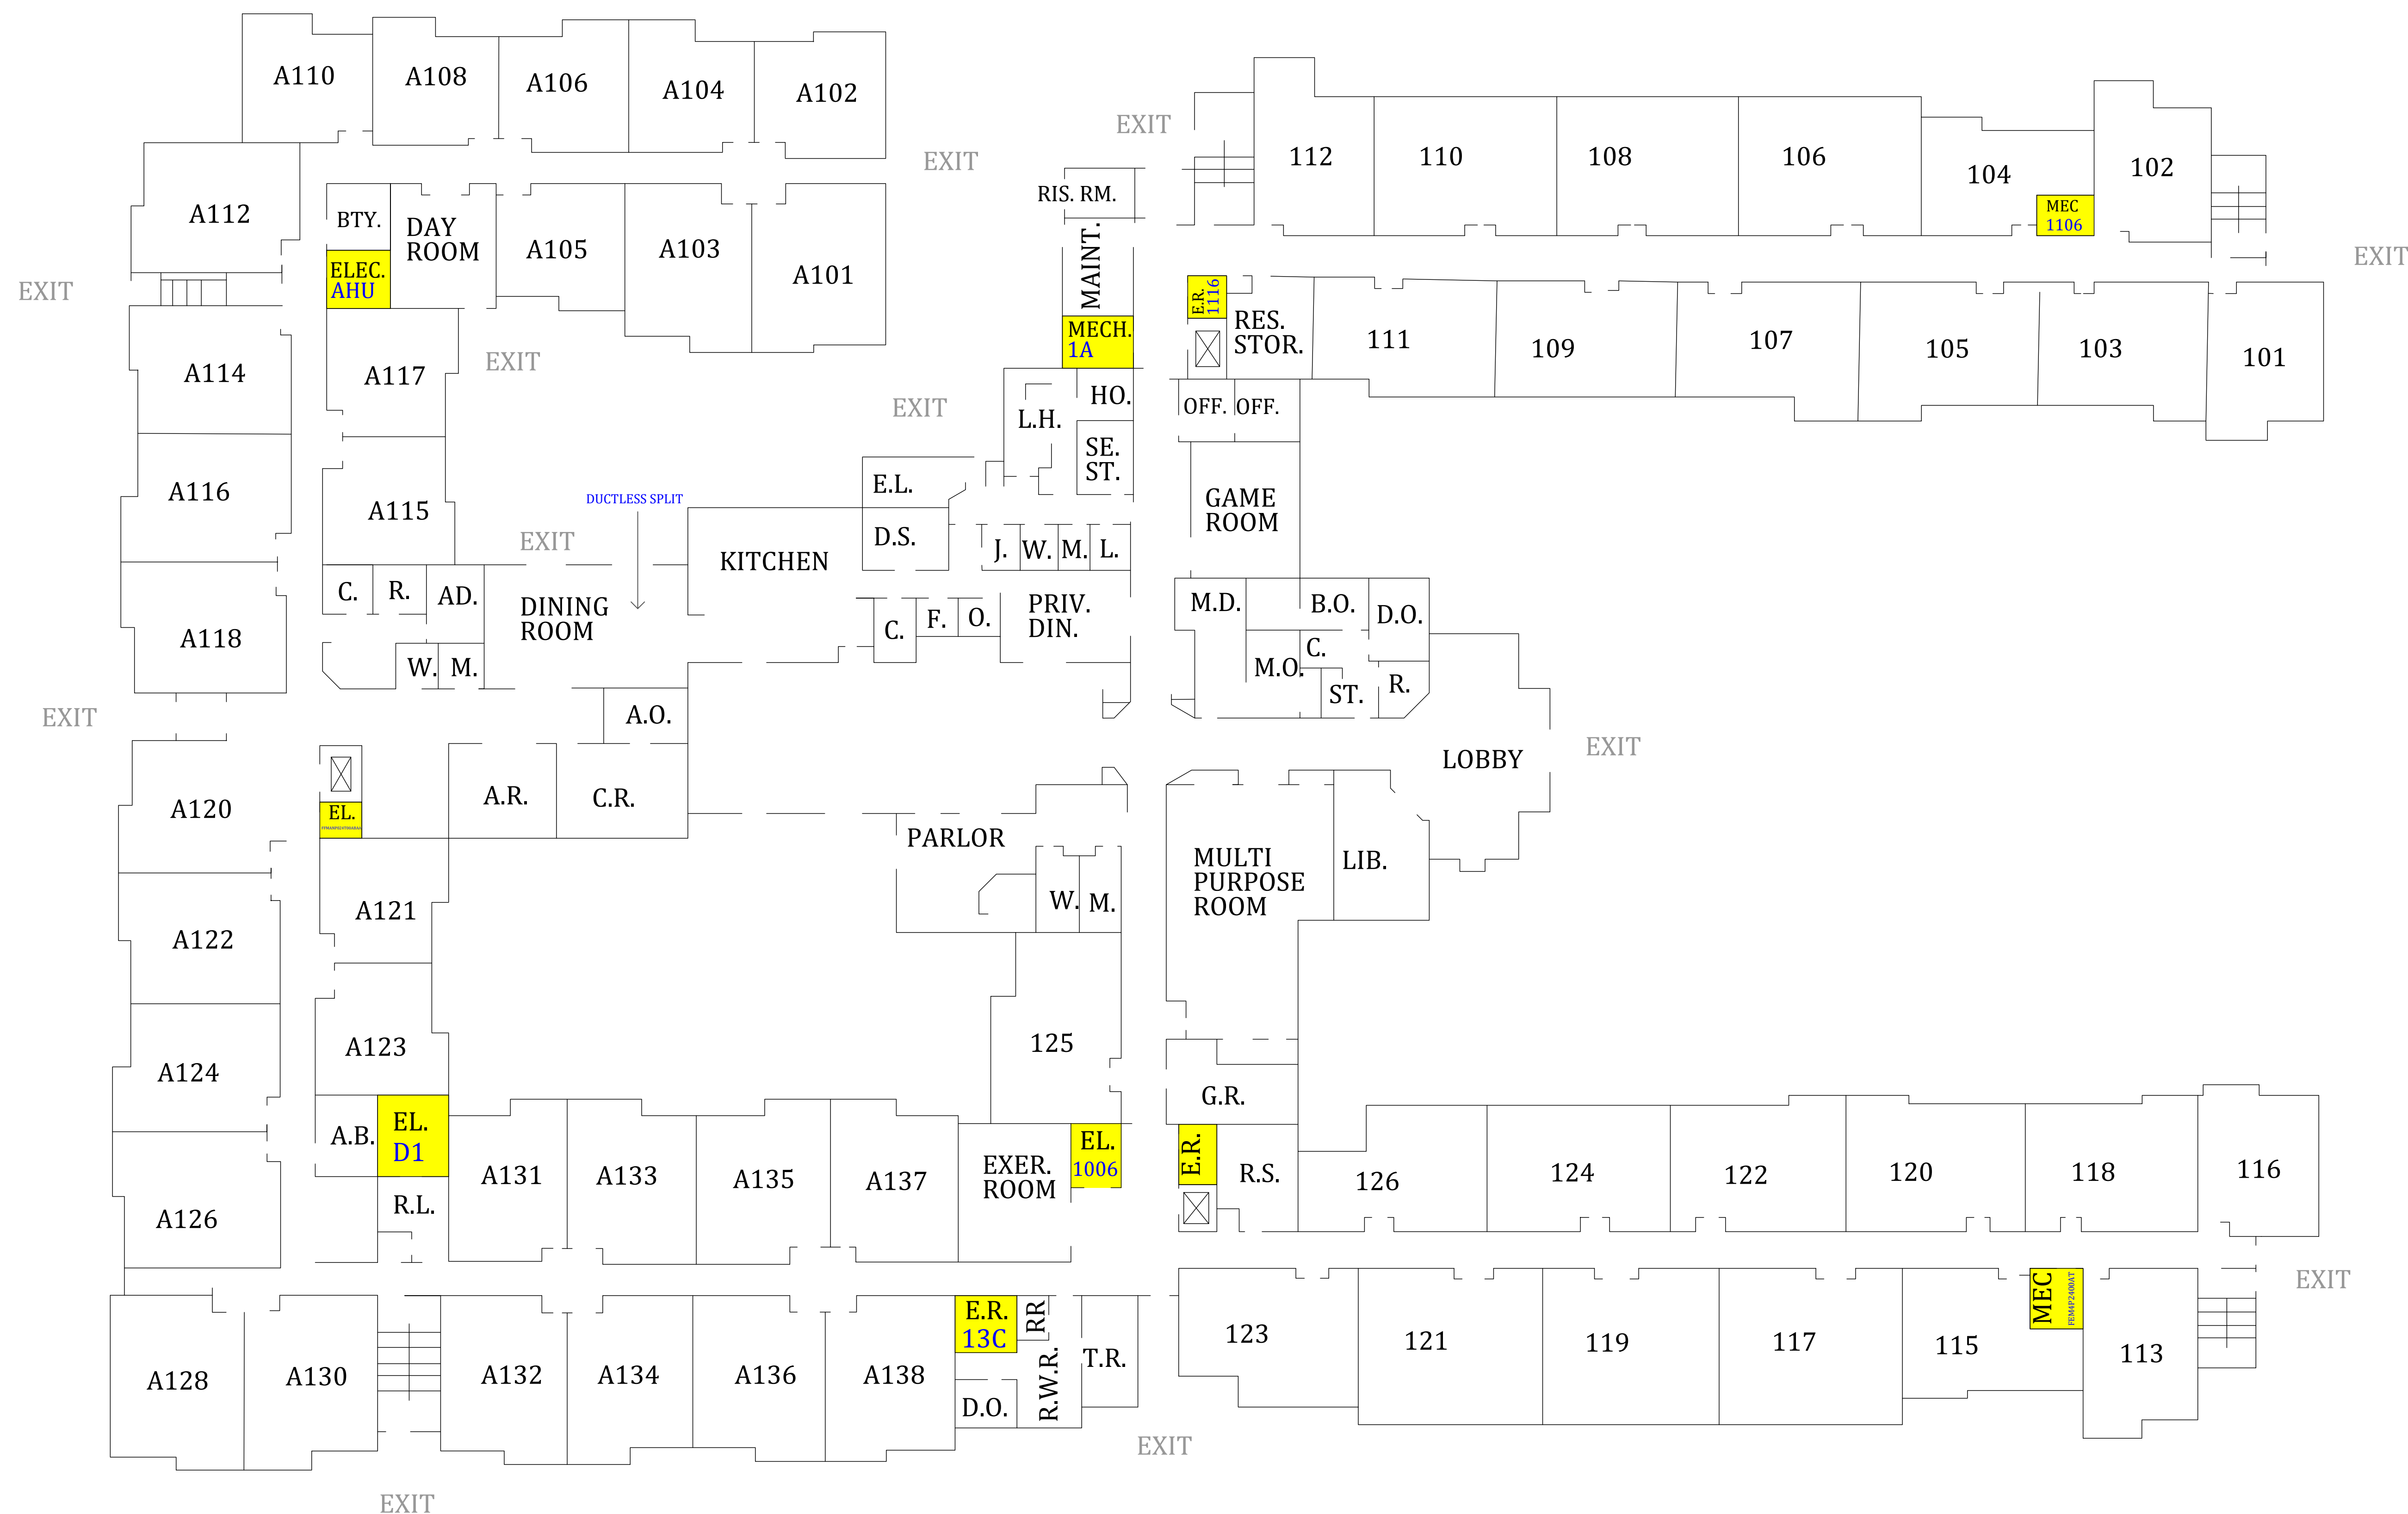

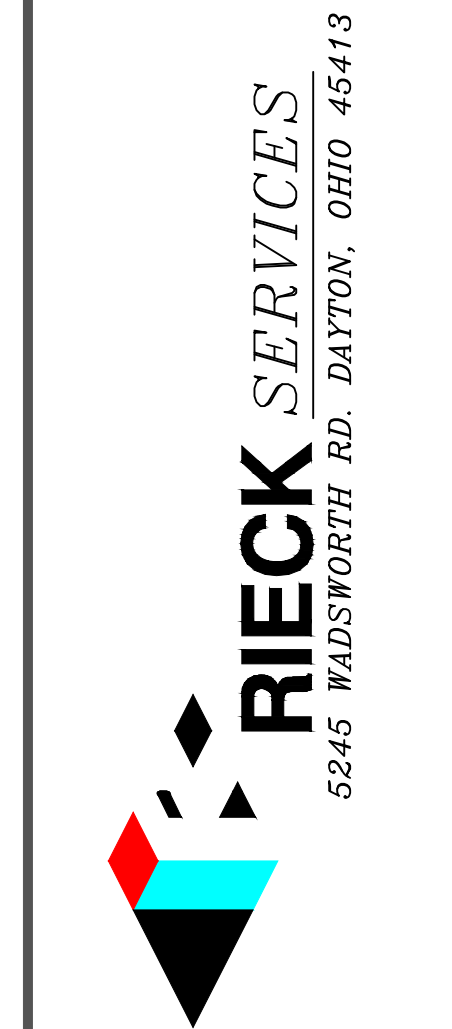



2656 W ALEX BELL ROAD DAYTON OH, 45459

6.29.21	START
DATE	ISSUE/REVISION
<p>We hereby expressly reserve the property rights to this drawing and it is not to be reproduced, copied in any format or manner whatsoever without first obtaining our express written permission and consent.</p>	

M-2



OUTSIDE PLAN VIEW 1

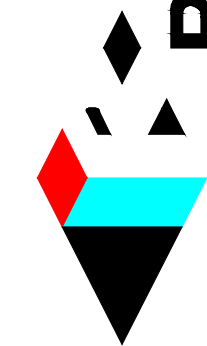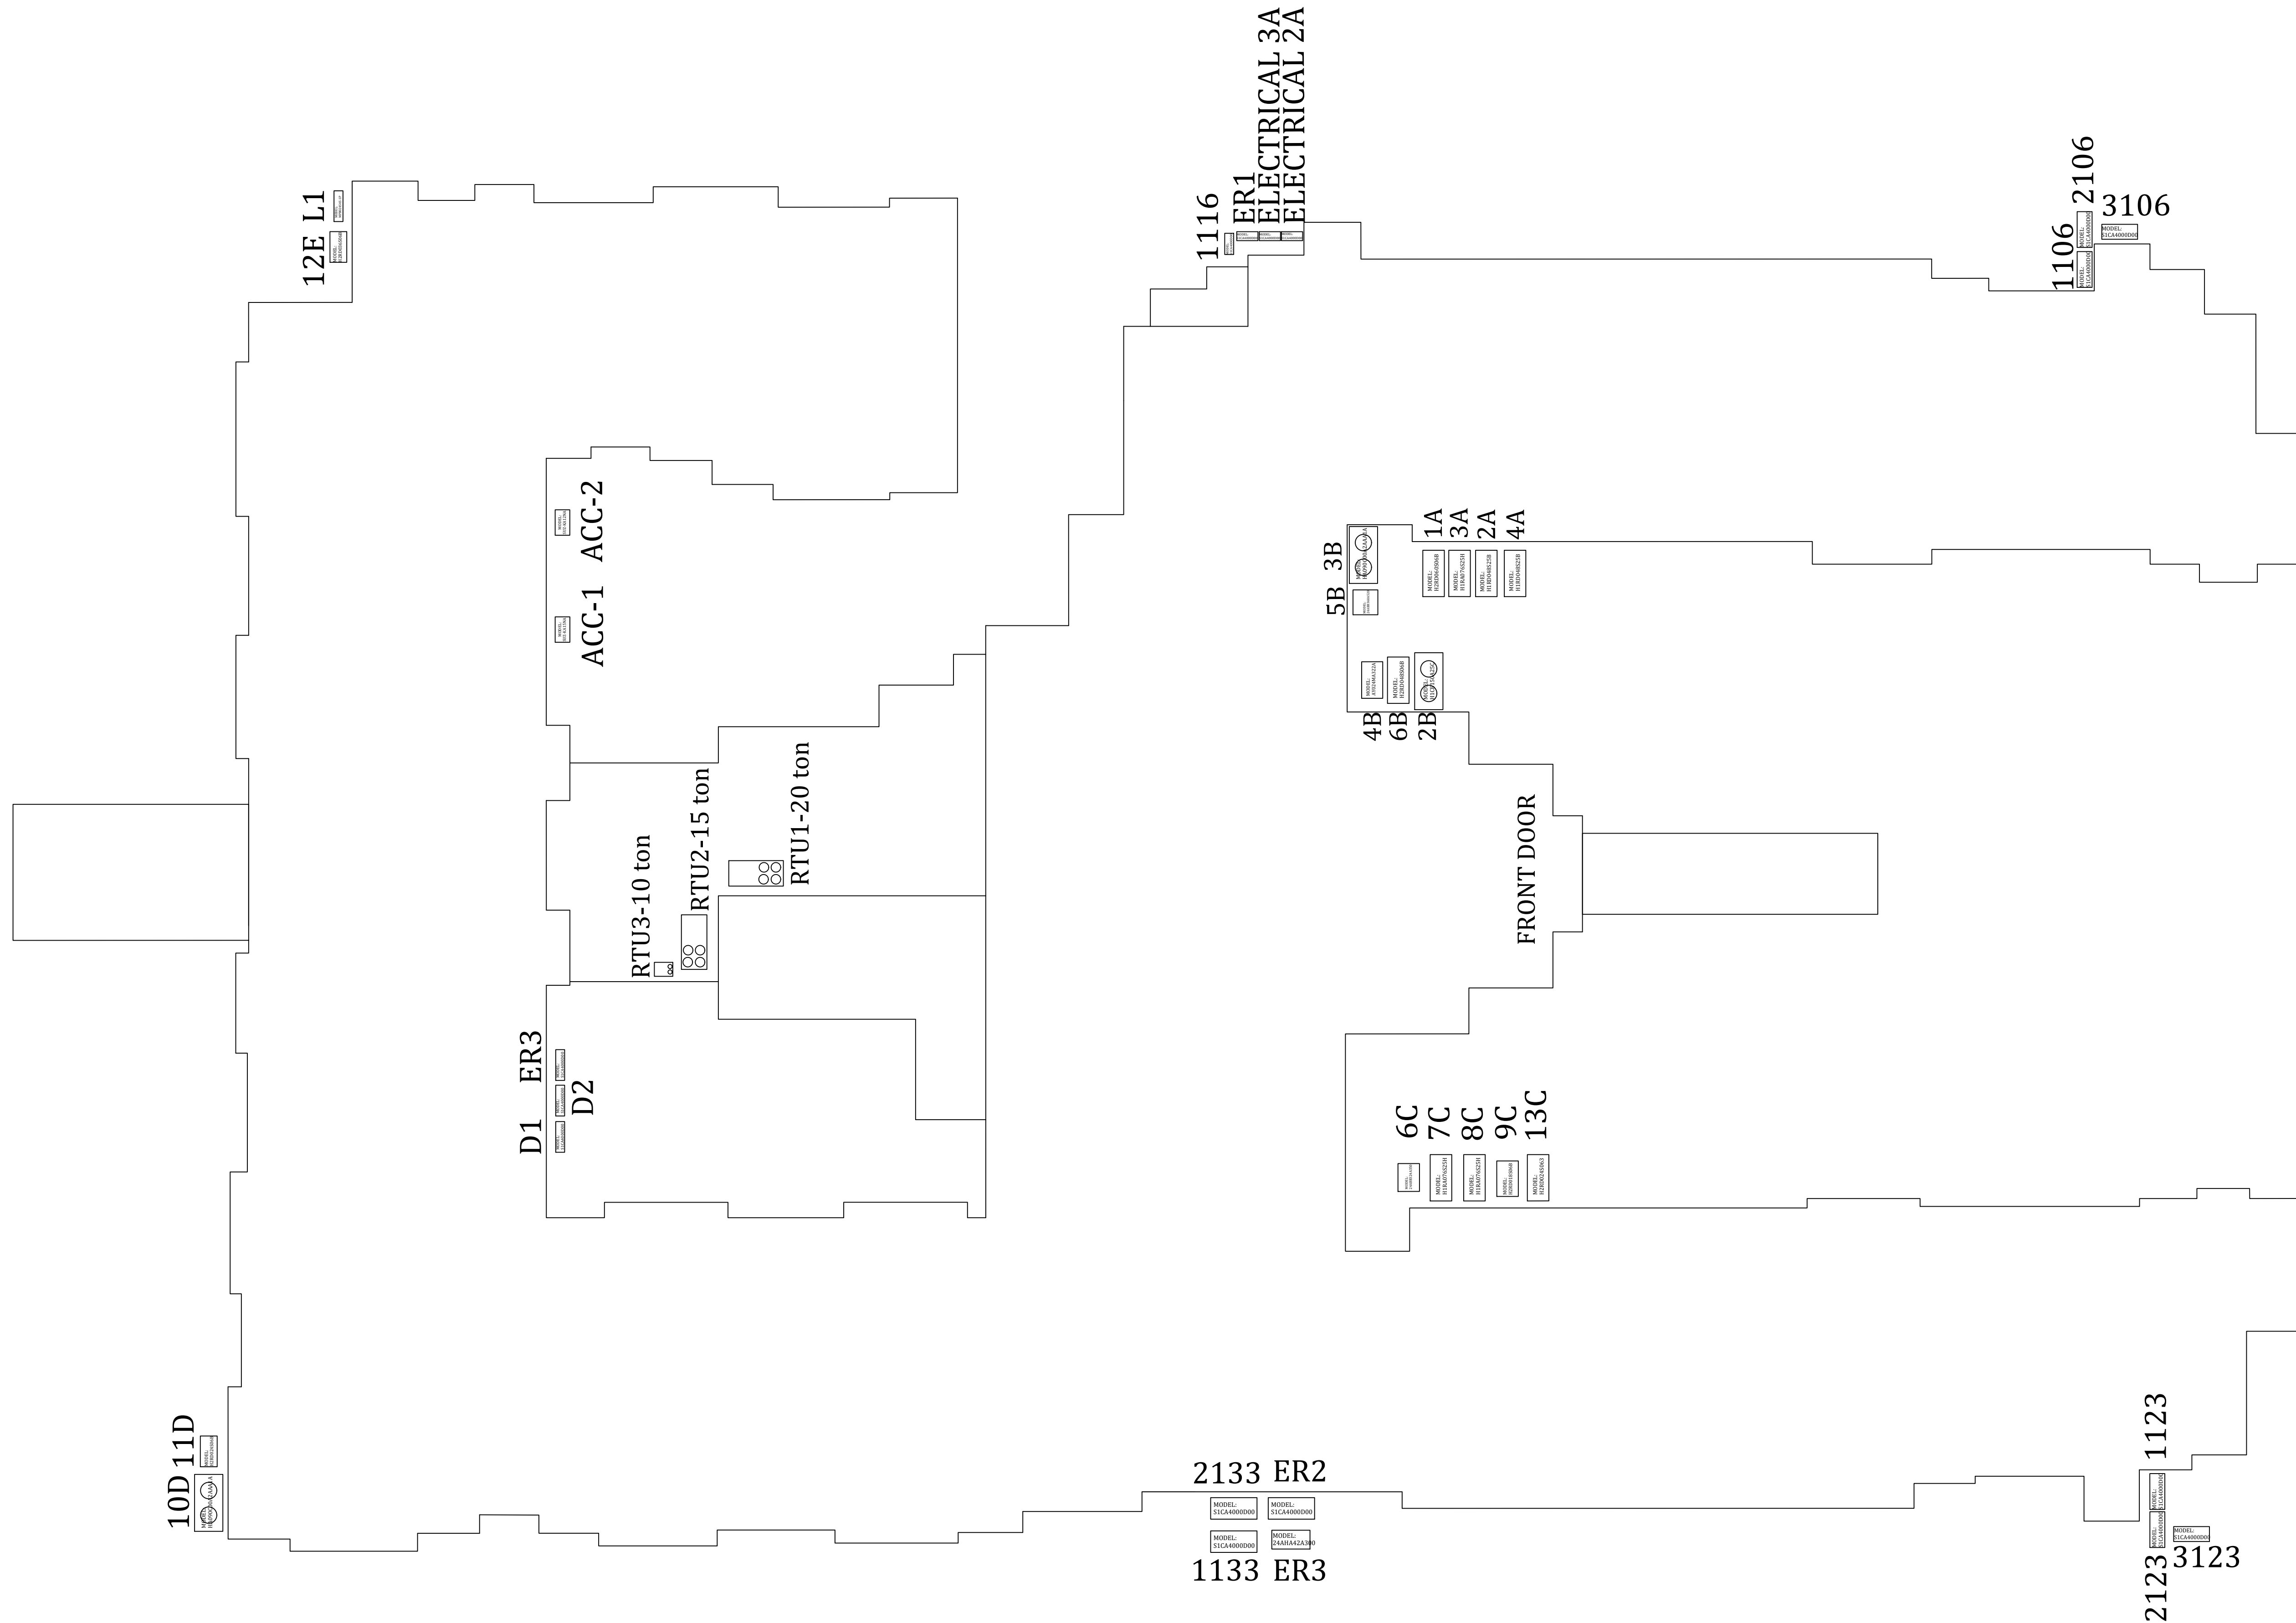

RIECK SERVICES
5245 WADSWORTH RD. DAYTON, OHIO 45413

THE WELLINGTON AT DAYTON

2656 W ALEX BELL ROAD DAYTON OH, 45459

[illegible]

6.29.21	START
DATE	ISSUE/REVISION


We hereby expressly reserve the property rights to this drawing and it is not to be reproduced, copied in any format or manner whatsoever without first obtaining our express written permission and consent.

DRAWN BY: KGH	CHECKED BY: PAB
------------------	--------------------


JOB NUMBER
33621, OTHERS

M-4

SHEET NUMBER

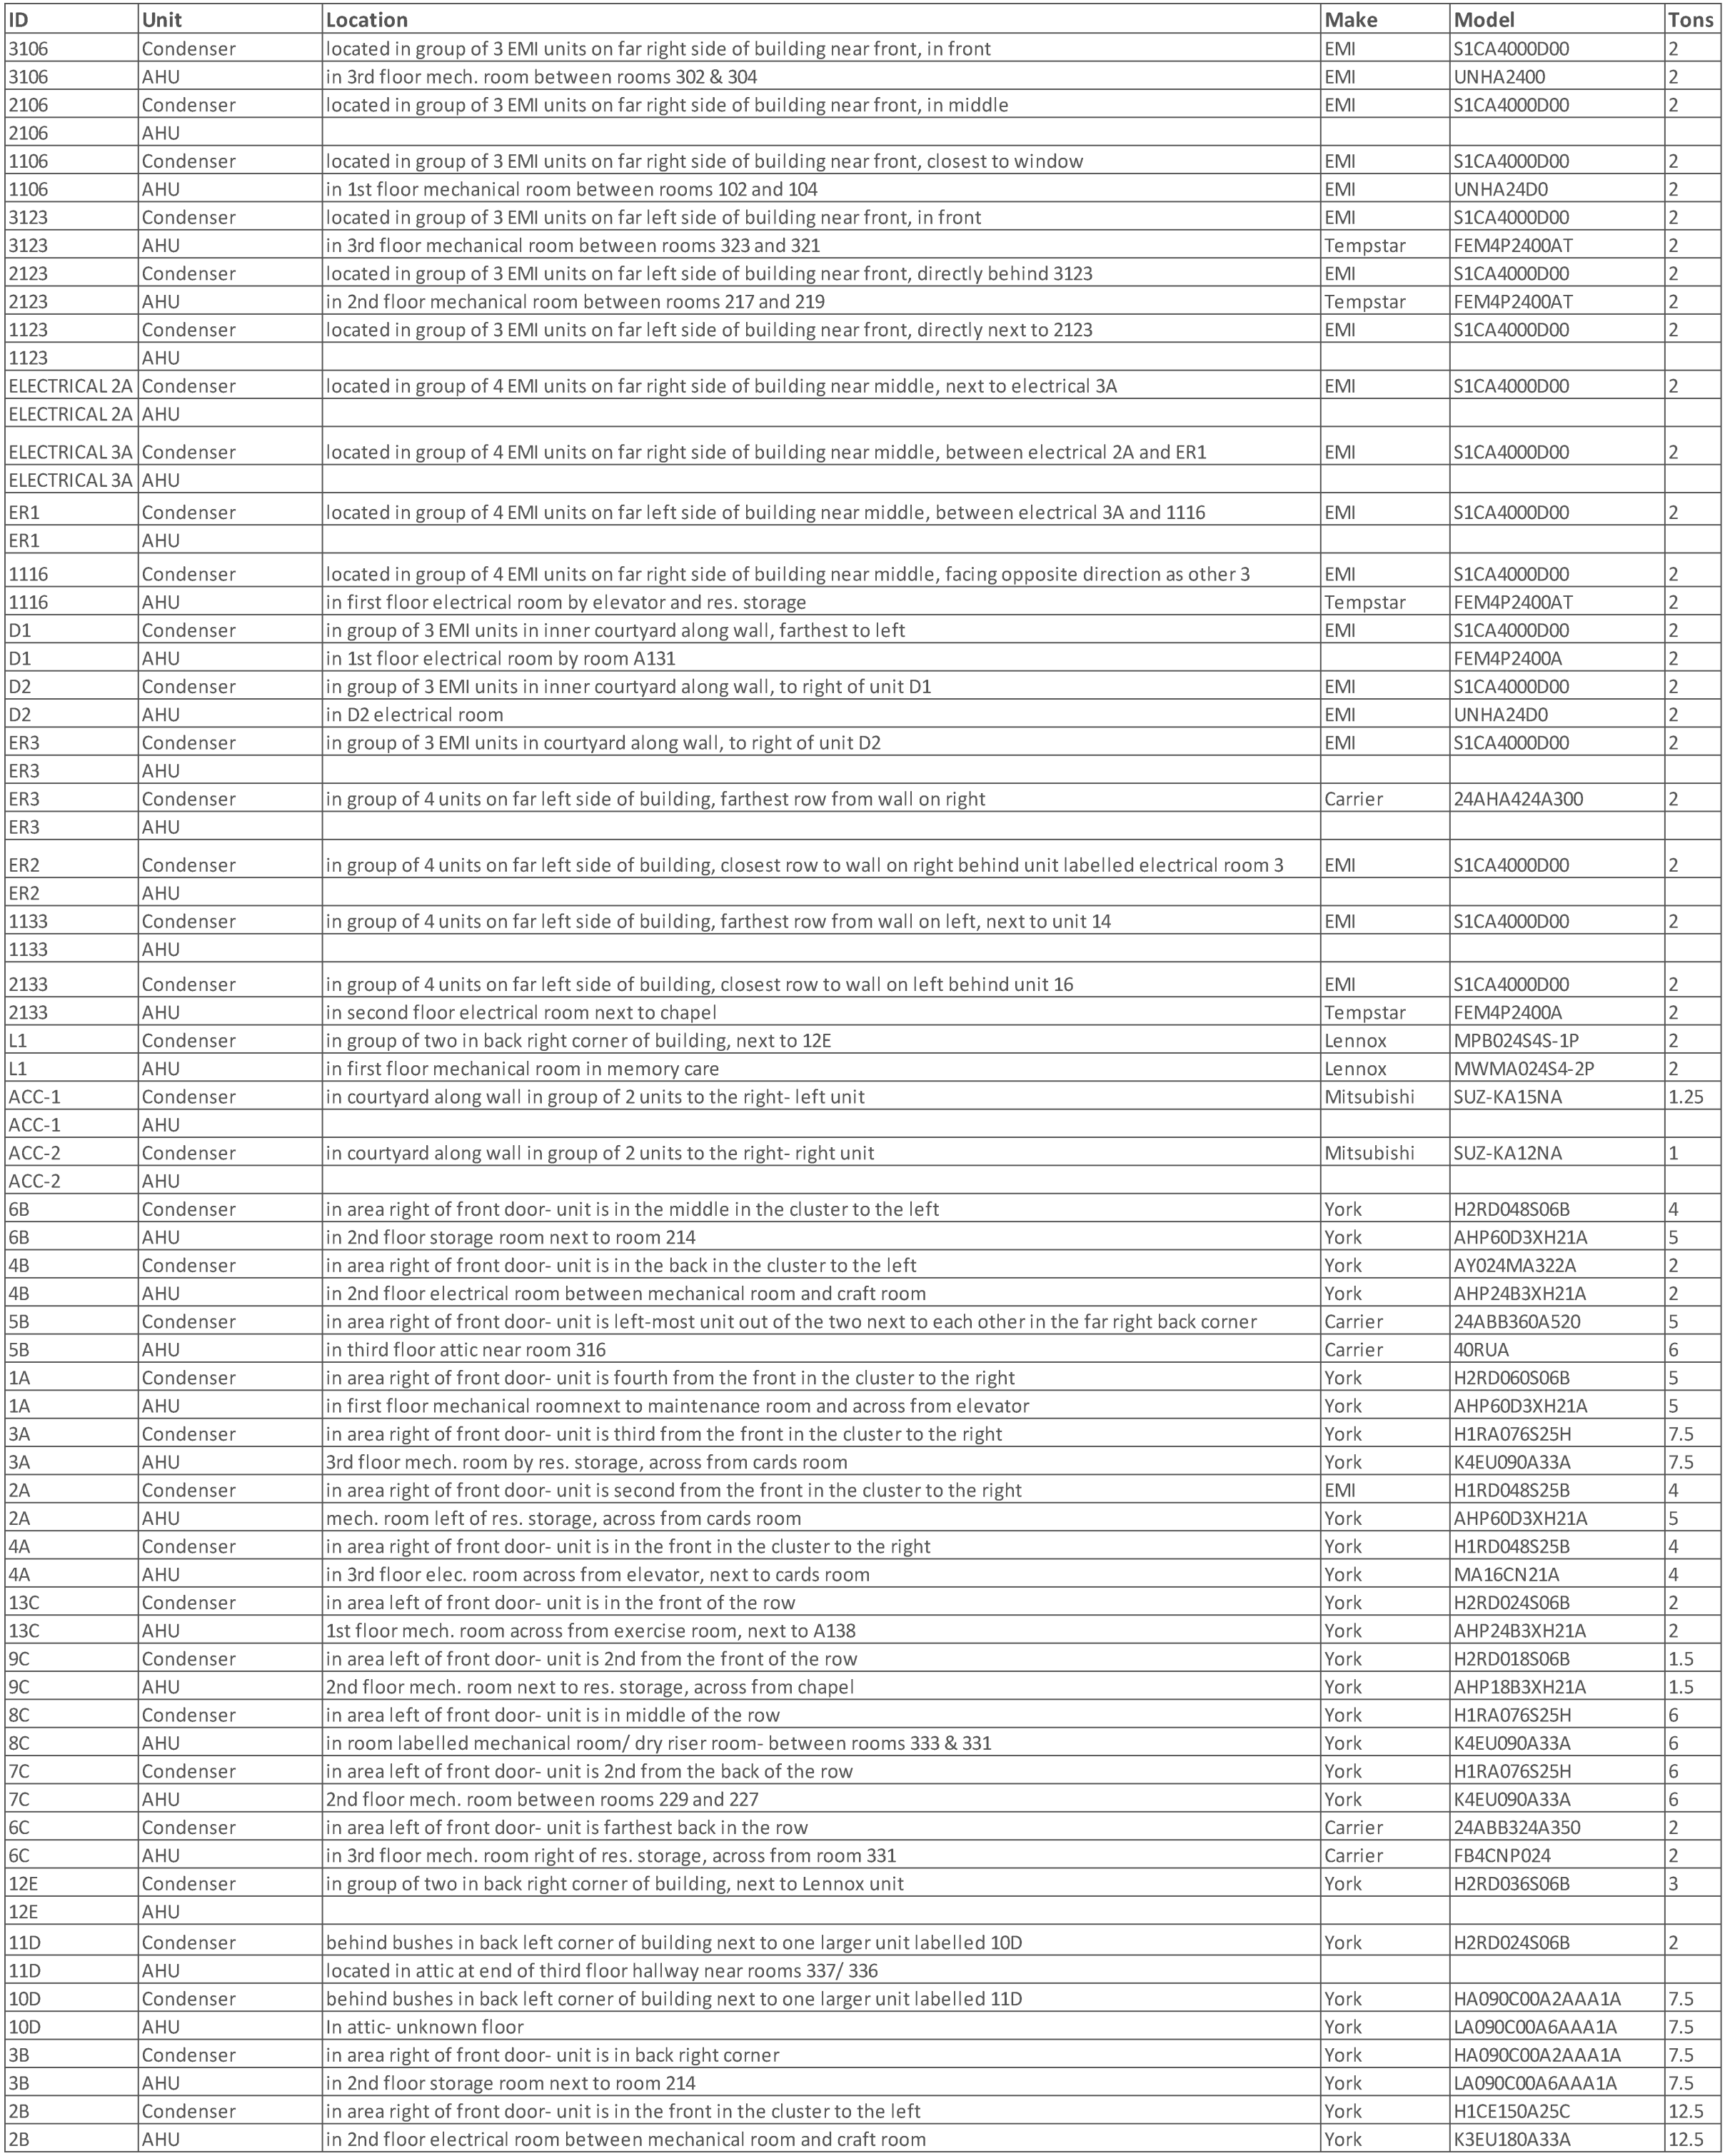

STATE OF OHIO
 PROFESSIONAL ENGINEER
 NO. 63048
 PRELIMINARY
 NOT FOR
 CONSTRUCTION



RIECK SERVICES
5245 WADSWORTH RD. DAYTON, OHIO 45413

WELLINGTON AT DAYTON

2656 W ALEX BELL ROAD DAYTON OH, 45459

[illegible]

6.29.21	START
DATE	ISSUE/REVISION

We hereby expressly reserve the property rights to this drawing and it is not to be reproduced, copied in any format or manner whatsoever without first obtaining our express written permission and consent.


DRAWN BY: KGH	CHECKED BY: PAB
------------------	--------------------

JOB NUMBER
33621, OTHERS

M-5


SHEET NUMBER

NO	QTY	DESCRIPTION	NOTES
1	1	AIRBASE SECTION	*
2	2	SUPPLY FANS	
3	1	POWER/ CONTROL PANEL	
4	3	SCREENED INLET OPENINGS	*
5	1	HEAT EXCHANGER ASSEMBLY	1440 MBH OUTPUT
6	1	HEAT EXCHANGER TUBE ACCESS PANEL (TYP 2)	
7	1	BURNER ASSEMBLY	1800 CFH NG INPUT
8	1	8in FLUE OUTLET CONNECTION	FLUE BY OTHERS
9	1	OUTLET SECTION	SCREENED OUTLET

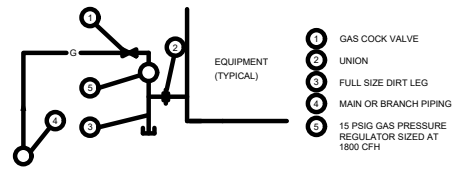

NATURAL GAS CONNECTION DETAIL

SCALE: N.T.S.

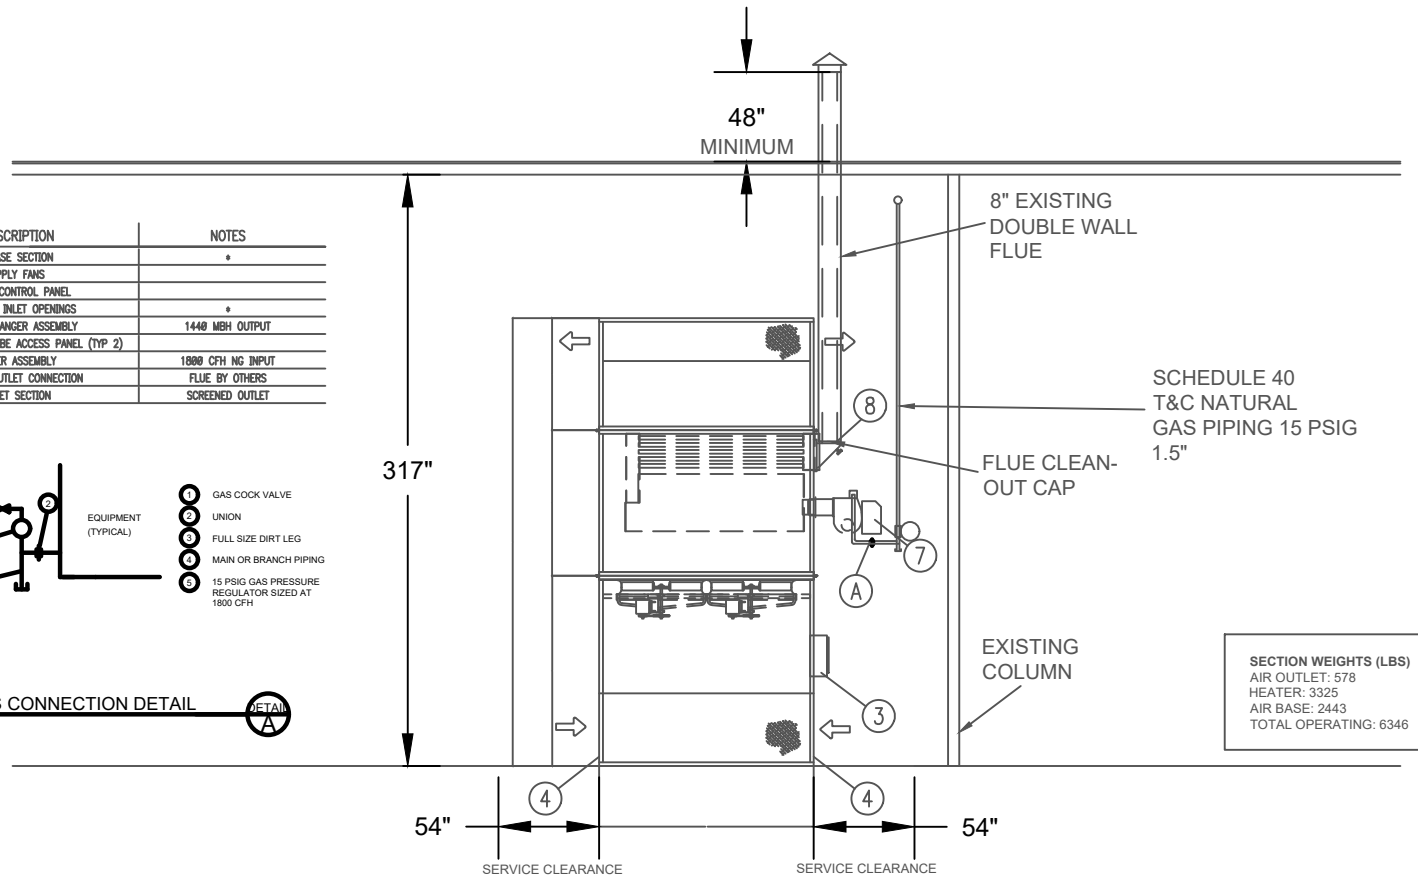

SECTION WEIGHTS (LBS)
AIR OUTLET: 578
HEATER: 3325
AIR BASE: 2443
TOTAL OPERATING: 6346