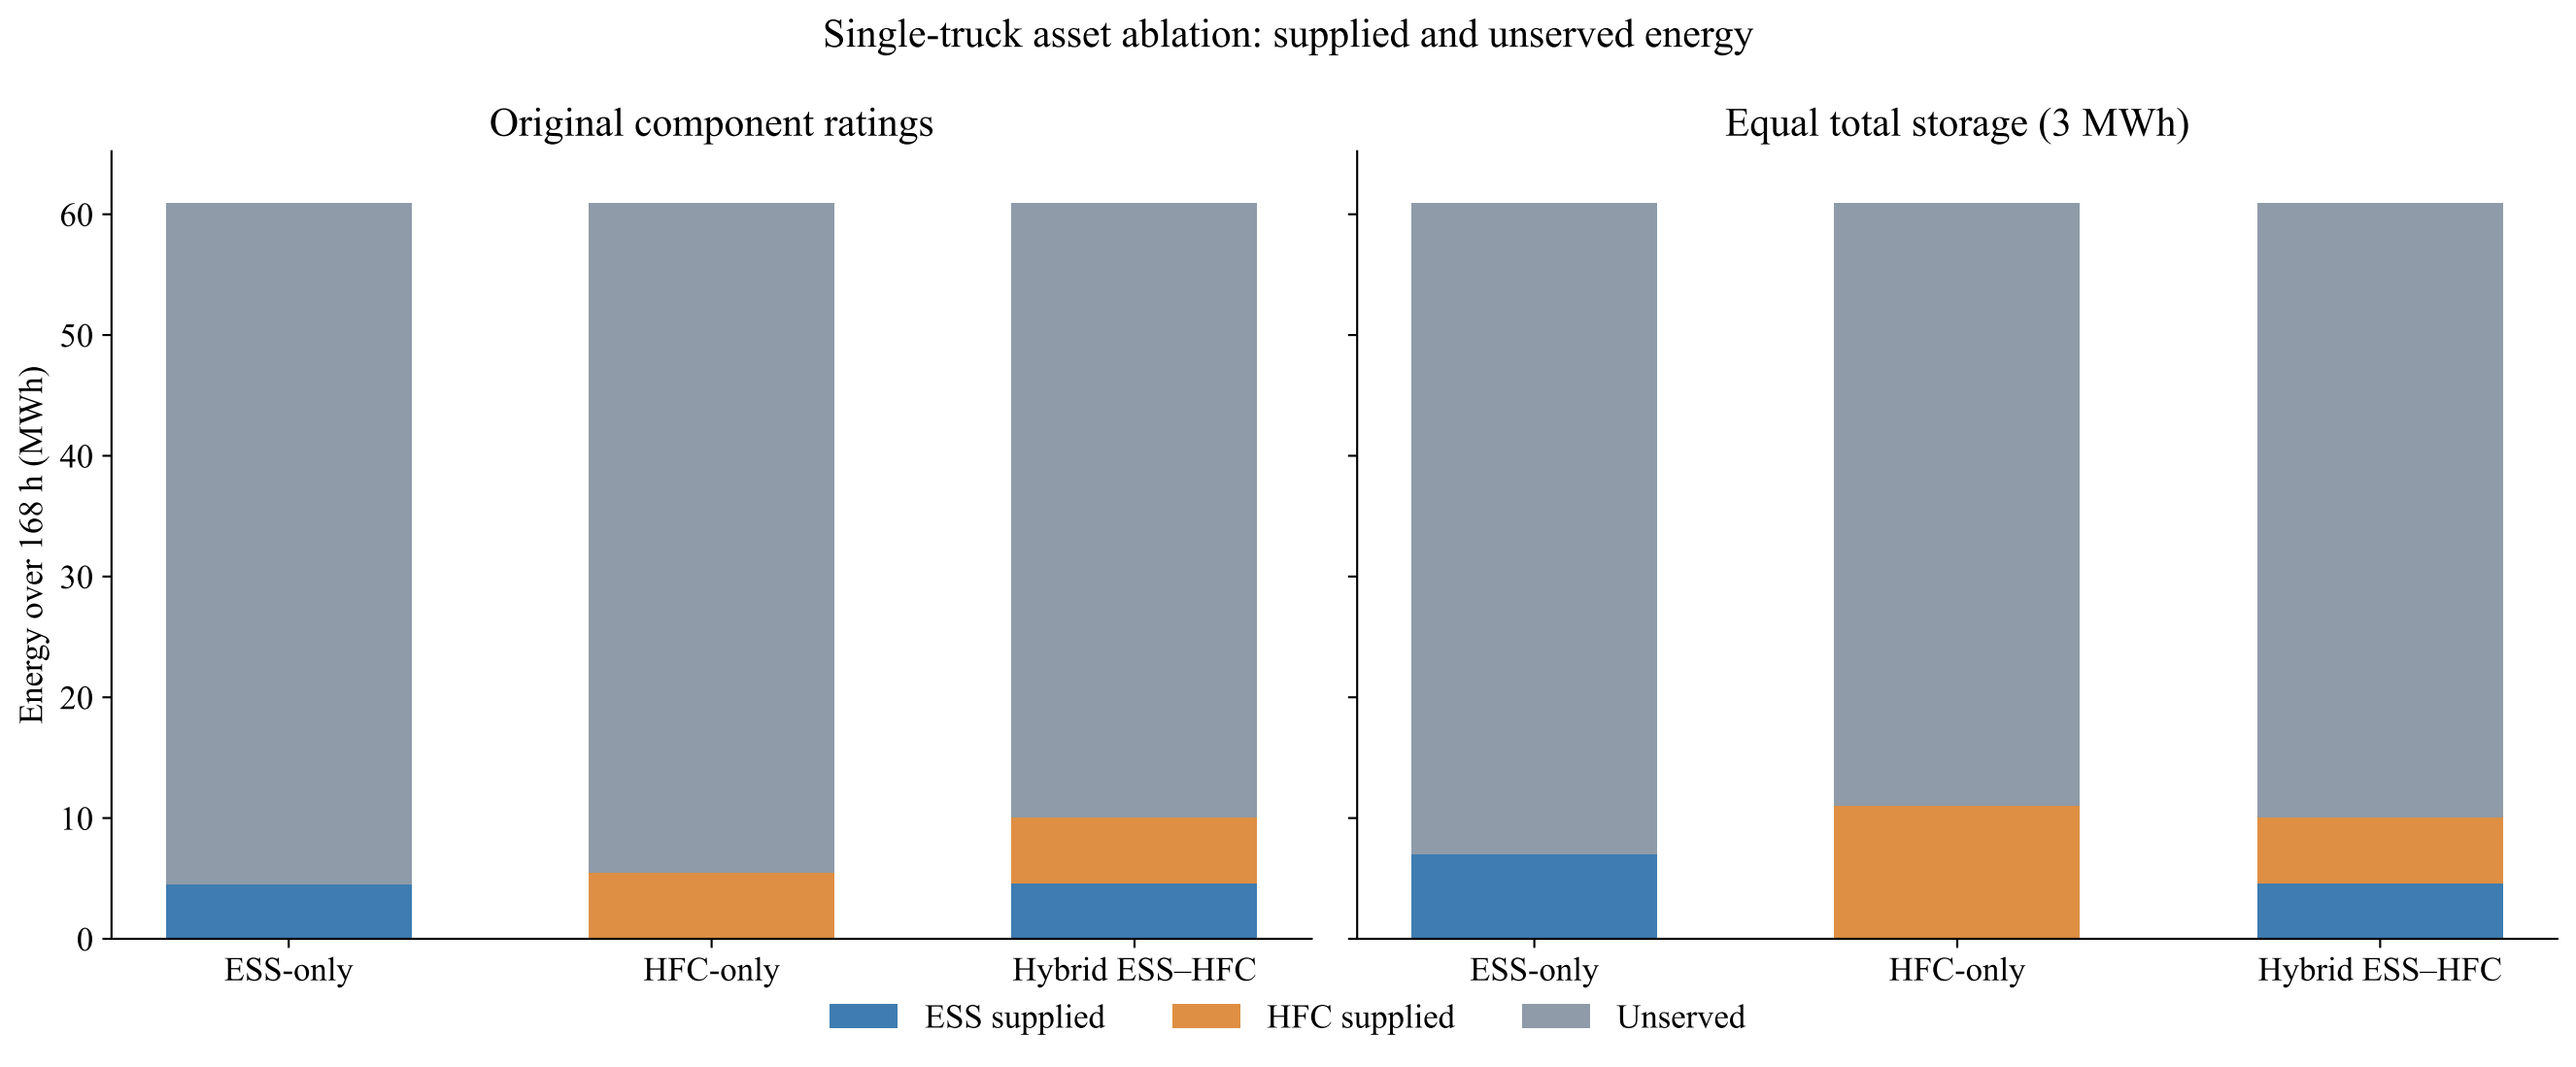
Single-truck asset ablation: supplied and unserved energy
Original component ratings
Equal total storage (3 MWh)
Energy over 168 h (MWh)
0
10
20
30
40
50
60
ESS-only
HFC-only
Hybrid ESS–HFC
ESS-only
HFC-only
Hybrid ESS–HFC
ESS supplied
HFC supplied
Unserved