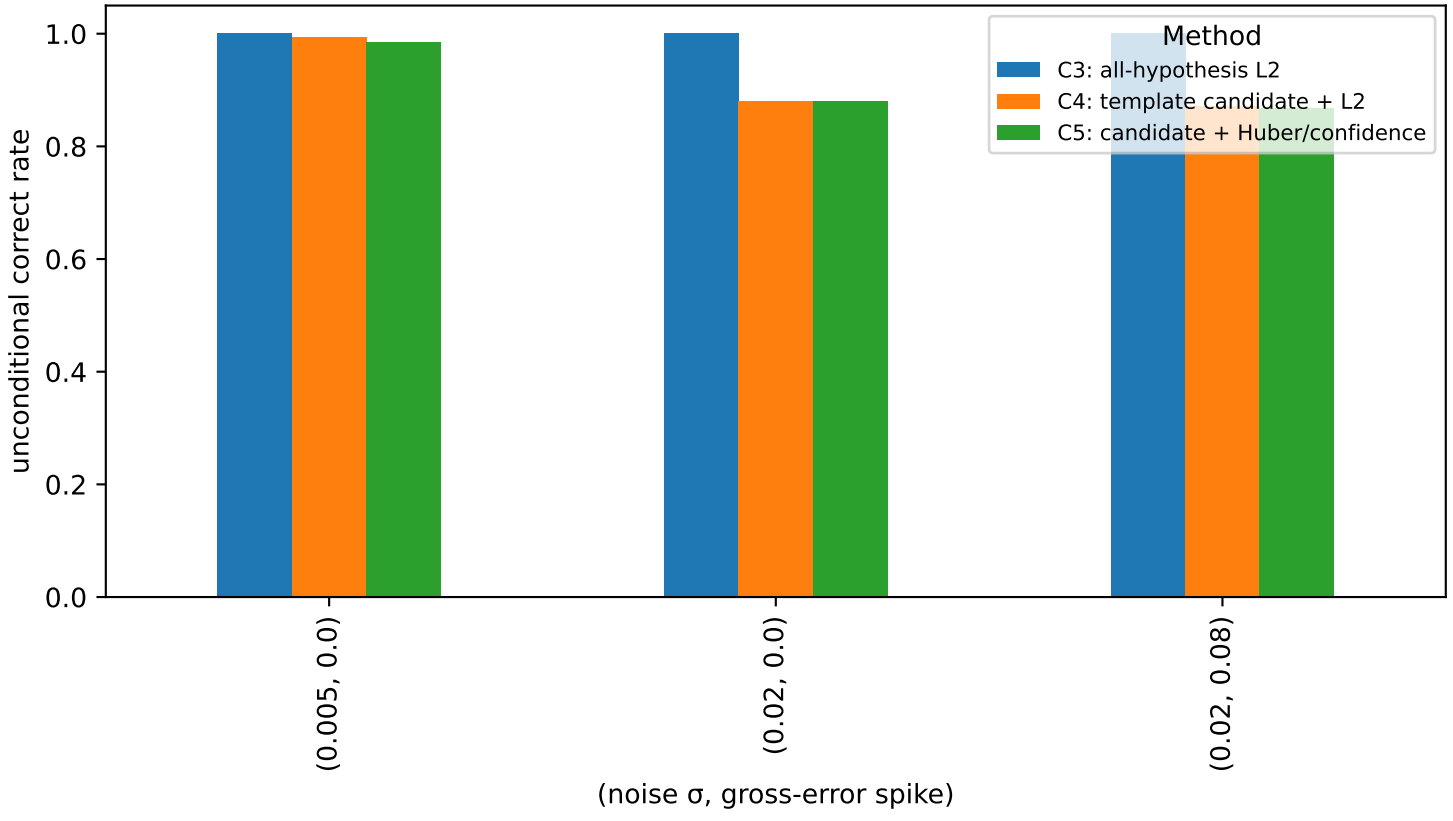
SYNTHETIC ONLY: C3/C4/C5 ablation
unconditional correct rate
1.0
0.8
0.6
0.4
0.2
0.0
Method
C3: all-hypothesis L2
C4: template candidate + L2
C5: candidate + Huber/confidence
(0.005, 0.0)
(0.02, 0.0)
(0.02, 0.08)
(noise σ, gross-error spike)