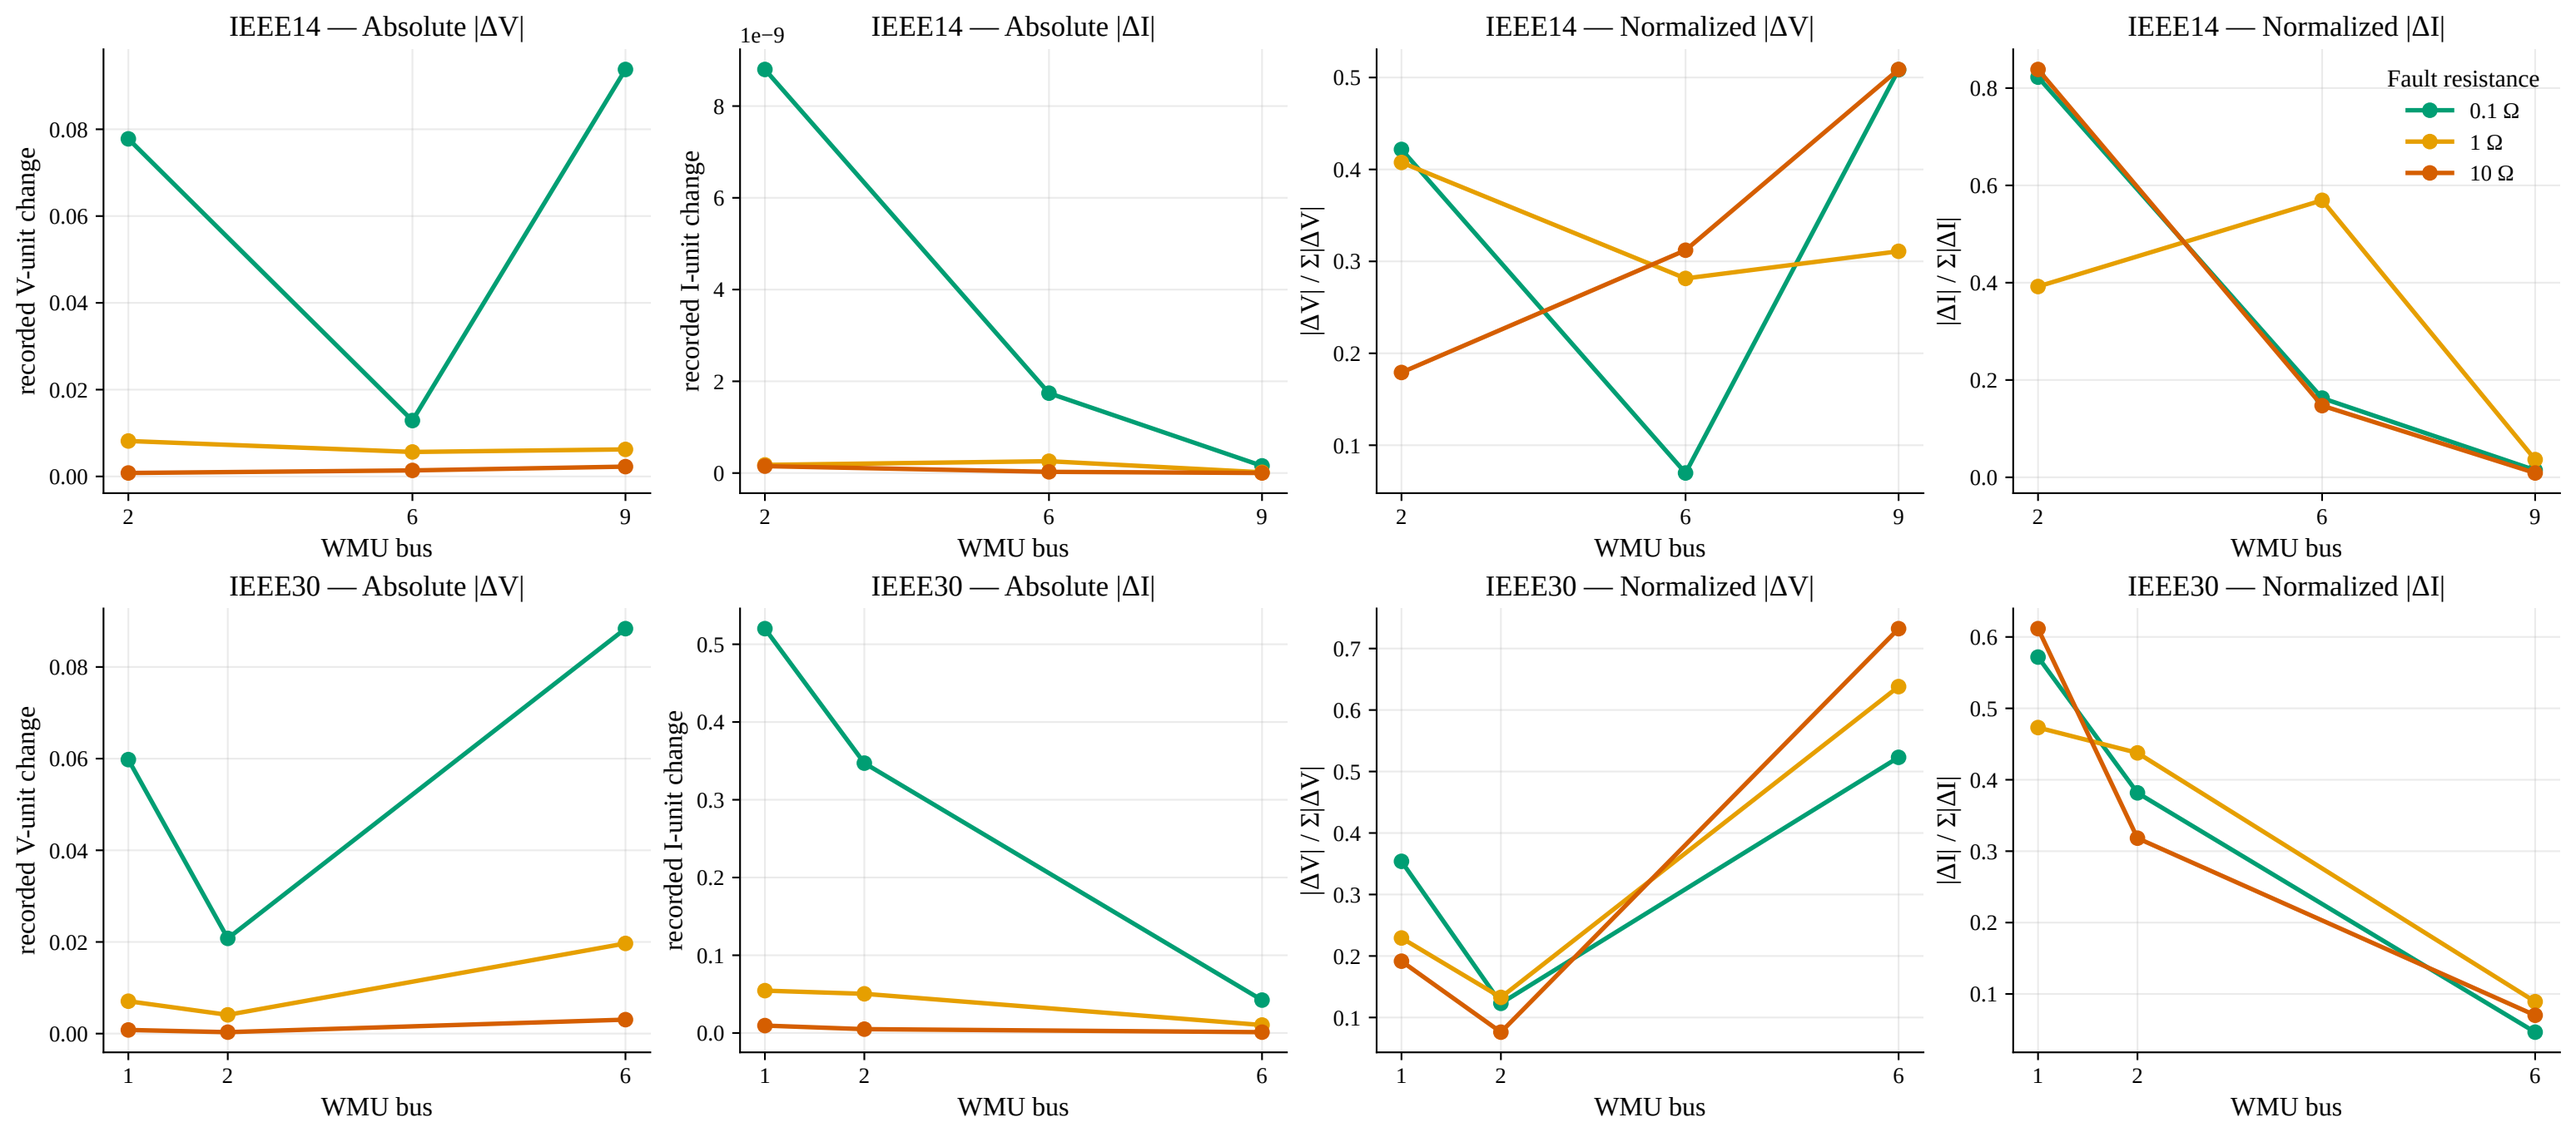
IEEE14 — Absolute |ΔV|
recorded V-unit change
WMU bus
IEEE14 — Absolute |ΔI|
1e−9
recorded I-unit change
WMU bus
IEEE14 — Normalized |ΔV|
|ΔV| / Σ|ΔV|
WMU bus
IEEE14 — Normalized |ΔI|
|ΔI| / Σ|ΔI|
WMU bus
Fault resistance
0.1 Ω
1 Ω
10 Ω
IEEE30 — Absolute |ΔV|
recorded V-unit change
WMU bus
IEEE30 — Absolute |ΔI|
recorded I-unit change
WMU bus
IEEE30 — Normalized |ΔV|
|ΔV| / Σ|ΔV|
WMU bus
IEEE30 — Normalized |ΔI|
|ΔI| / Σ|ΔI|
WMU bus