



Final Stress Grid: C4 versus C3 (mean $\pm$ 95% CI, n=50)


Power = 1 kW

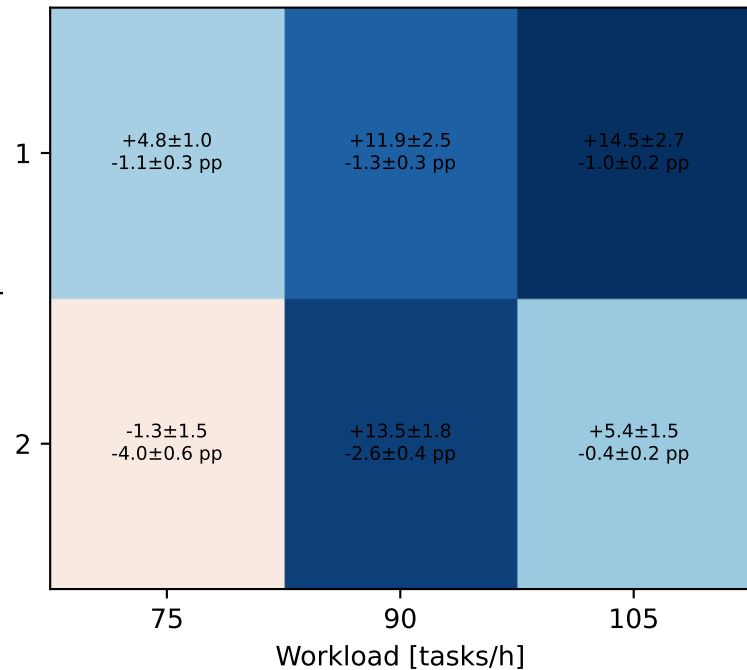

Power = 3 kW

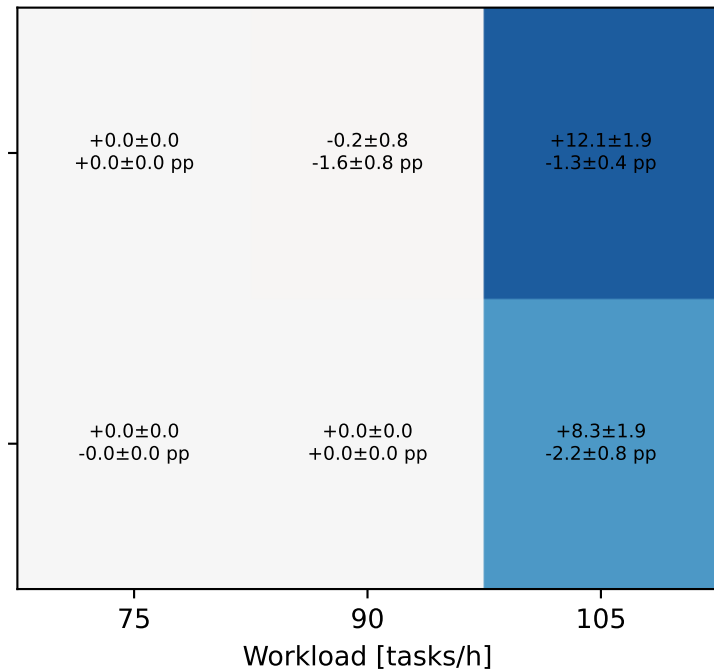

Power = 5 kW

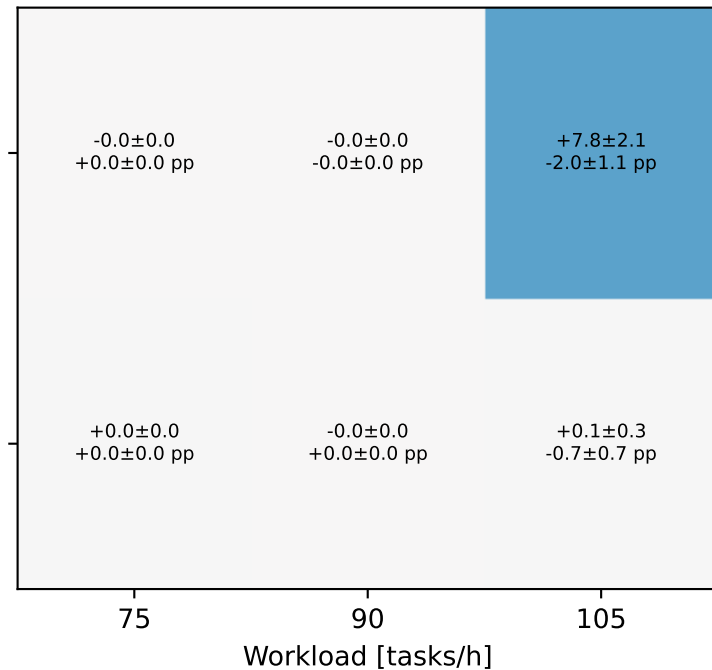

Paired C3 - C4 delay [min] (positive = C4 lower delay)