


ELECTRIC HEAT TRACING DESIGN DATA CHART

DISTRIBUTION PANEL AND CIRCUIT NUMBER	HEAT TRACE NUMBER	INSULATION			MINIMUM AMBIENT TEMPERATURE (°C)	START-UP AMBIENT TEMPERATURE (°C)	MAXIMUM EXPOSURE TEMPERATURE (°C)	MAINTAIN TEMPERATURE (°C)	HEATING CABLE TYPE	CABLE LENGTH (m)	SUPPLY VOLTAGE (V ac)	HEAT TRACE RATIO	CURRENT		WATTAGE		HEATER OUTPUT (W/m)	PIPE MATERIAL	HEAT LOSS (W/m)	ELECTRICAL CLASSIFICATION		
		THICKNESS (mm)	CODE	SIZE (mm)									OPERATING (A)	COLD (A)	OPERATING (W)	COLD (W)				AREA	TEMPERATURE CODE or AUTOIGNITION TEMPERATURE	HIGH LIMIT SET POINT (°C)
HTPI01-CCT1/15	HT-PE-P0101-1B	64	MF	114	-40	-40	295	60	D/MIQ-30EZH-2S/16.7m/872/120/1.2m/10/6	16.7	120	1	7.3	8.1	872	972	47.5	CS	35.5	ZONE 2	T2D	N/A

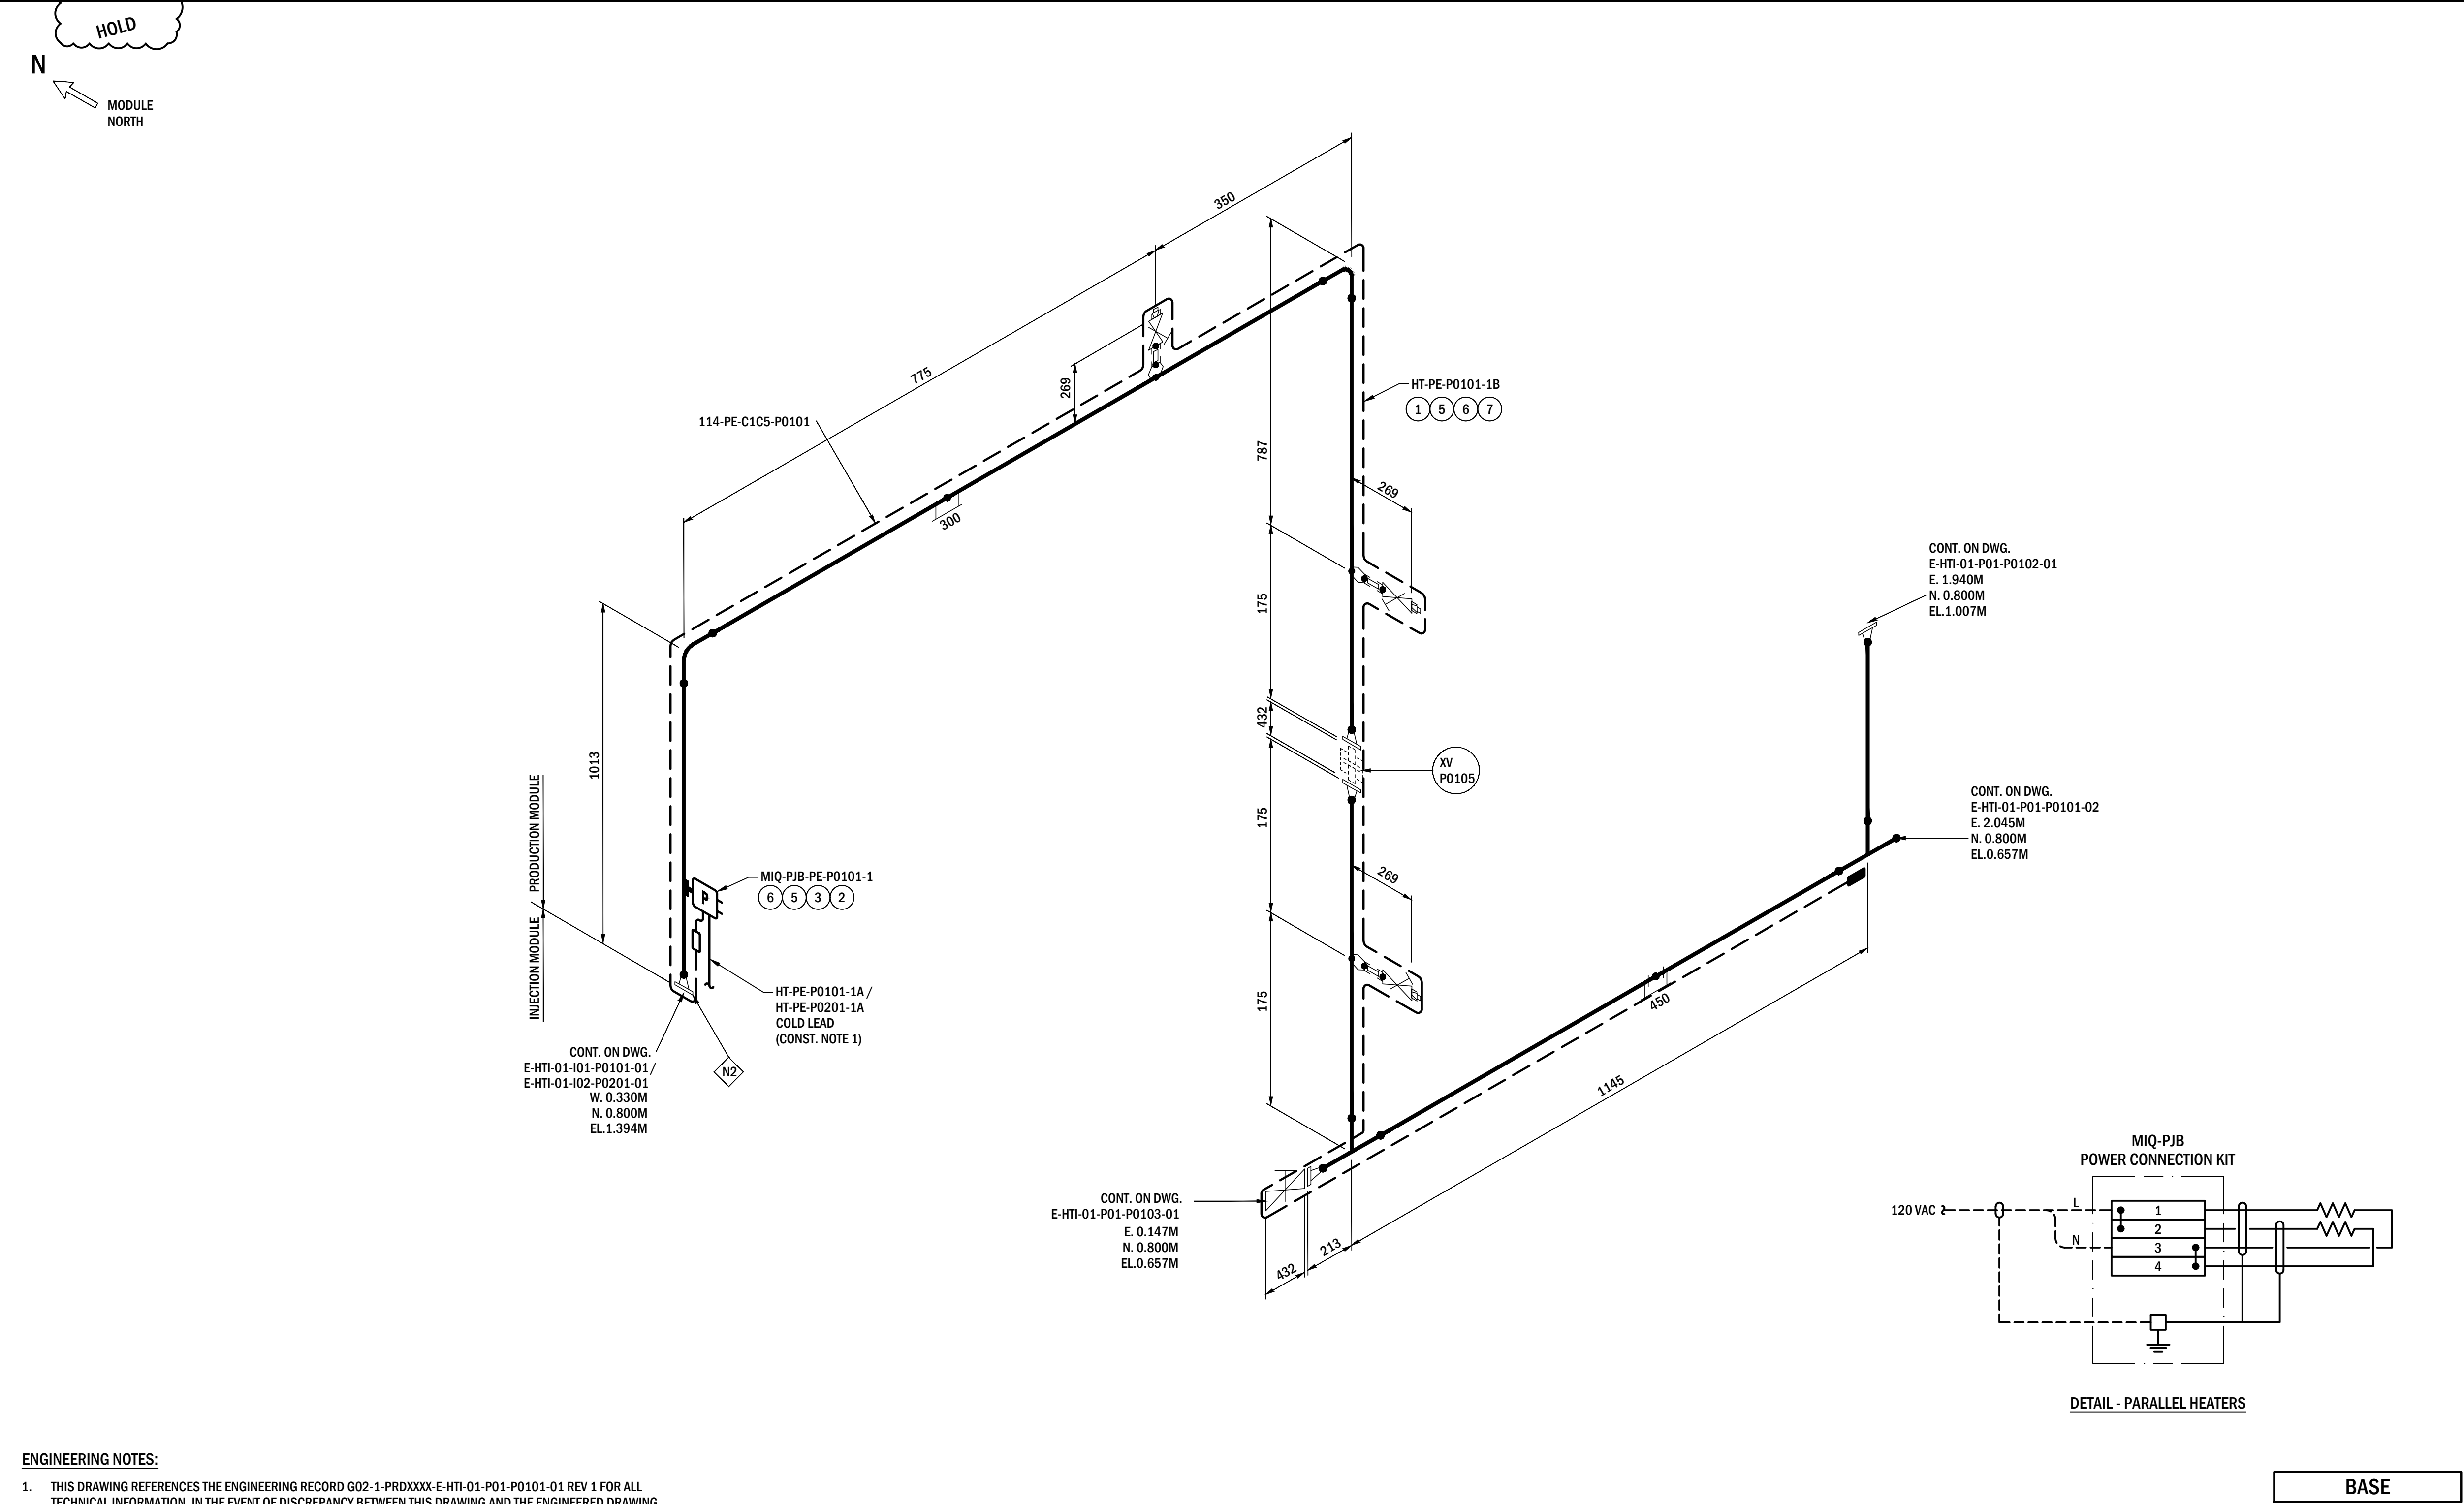

CONSTRUCTION NOTES:

1. FIELD ELECTRICAL CONTRACTOR TO TERMINATE COLD LEAD FOR HT-PE-P0101-1A/HT-PE-P0201-1A.

SHOP NOTES:

1. ALL ITEMS ON THIS MODULE (EXCLUDING MANUAL VALVES) INCLUDE THE TAG PREFIX XXXX.

NOTES:

1. HEAT TRACE AND EQUIPMENT SHALL BE INSTALLED IN COMPLIANCE WITH THE CEC.
2. FIELD ELECTRICAL CONTRACTOR TO INSTALL HEAT TRACE AS PER MANUFACTURER RECOMMENDATION. HEAT TRACE CABLE LENGTHS TO BE FIELD VERIFIED.
3. HEAT TRACE POWER, RTD, SPLICE, AND END KITS SHALL BE IDENTIFIED WITH LAMICOID.
4. PIPE HEAT LOSS VALUES INCLUDE SAFETY FACTOR OF 20% FOR ALL LINES.
5. REFERENCE TABLE ONLY INCLUDES THE MOST COMMON INSTALLATION SCENARIOS. REFER TO HEAT TRACE INSTALLATION DETAILS DWG. E-STD-00-600 SERIES FOR FURTHER DETAILS.
6. HEAT TRACING TO BE INSTALLED USING ITEMS LISTED IN THE BILL OF MATERIALS.
7. ALLOWANCES SHOWN ARE PER VALVE, SUPPORT, AND FLANGE.
8. HEAT TRACE CALCULATION IS BASED ON CONTROLLED DESIGN.
9. COORDINATES ARE BASED ON MODULE DATUM.
10. AN ALLOWANCE OF 0.8m WAS INCLUDED FOR TERMINATIONS, AND AN ADDITIONAL 10% ALLOWANCE WAS APPLIED TO THE CALCULATED HEAT TRACE LENGTH.

INSTALLATION DETAIL REFERENCE TABLE				(NOTE 5)
DETAIL	ITEM	DETAIL	ITEM	
606	HT CABLE/RTD ORIENTATION	620	RTD	
607	ELBOW	621	PIPE RACK MODULES - FLANGED CONNECTIONS	
608	PIPE SHOE	622	M.I. HEAT TRACER	
609	FREEZE PROTECTED PIPE ENTERING BUILDING			
610	UNDERGROUND PIPE			
611	FLANGE			
612	DRAIN			
613	VALVE			
614	RELIEF VALVE			
615	STRAINER			

BILL OF MATERIALS (BASED ON THERMON PRODUCTS)

ITEM	QUANTITY	CATALOG NUMBER	DESCRIPTION
①	1	MIQ-SERIES	MI-SERIES CONSTANT WATTAGE HEATER, 600 VAC, 2 CONDUCTOR
②	1	MIQ-PJBRP-TB4	POWER CONNECTION JUNCTION BOX c/w 4 TERMINAL BLOCKS
③	2	MIQ-JBS	POWER CONNECTION PIPE MOUNT STAINLESS STEEL BRACKET
④	-	RTD-100-KIT	100 OHM PLATINUM RTD PIPE MOUNT
⑤	AS REQ'D	T2SSB	BANDING, STAINLESS STEEL, 0.020" x 1/2" WIDE
⑥	AS REQ'D	T34PB-CR	BANDING CRIMP SEAL
⑦	AS REQ'D	CL	CAUTION LABEL (ENGLISH), 25 PER PACKAGE
⑧	-	B-4	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 4" (100 mm) DIAMETER
⑨	-	B-10	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 10" (250 mm) DIAMETER
⑩	-	B-21	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 21" (530 mm) DIAMETER
⑪			
⑫			

VALVE ALLOWANCES				OTHER ALLOWANCES			
(NOTE 7)				(NOTE 7)			
PIPE DIA.	TYPE	QTY.	ALLOW. EACH (m)	SIZE/TYPE	DESCRIPTION	QTY.	ALLOW. EACH (m)
114	FLANGED	2	1.52	114	FLANGE	1	0.80
33	SOCKET WELDED	3	0.30	300	PIPE SHOE	1	0.90
				450	PIPE SHOE	1	1.20
				114	ELBOW	3	0.15

ENGINEERING NOTES:

1. THIS DRAWING REFERENCES THE ENGINEERING RECORD G02-1-PRDXXXX-E-HTI-01-P01-P0101-01 REV 1 FOR ALL TECHNICAL INFORMATION. IN THE EVENT OF DISCREPANCY BETWEEN THIS DRAWING AND THE ENGINEERED DRAWING OF RECORD, THE ENGINEERED DRAWING OF RECORD WILL TAKE PRECEDENCE UNLESS THE CHANGE IS PROPERLY CLOUDED AS A REVISION TO THIS DRAWING AND STAMPED BY A PROFESSIONAL ENGINEER.

LEGEND PIPE HEAT TRACE CABLE P POWER CONNECTION KIT S SPLICE KIT QUICK CONNECT COLD LEAD CONNECTION END SEAL LIGHTED END SEAL RTD xxx RTD SENSOR T PIPE SENSING THERMOSTAT PIPE SUPPORT														REF. NO. 114-PE-C1C5-P0101						
				SCOVAN INC. 2026.05.26 ISSUED FOR CONSTRUCTION												PadX PARTNERSHIP Scovan		PADX NEXT GENERATION ENERGY SOLUTIONS PRODUCTION MODULE (MOD-01-P01) HEAT TRACE ISOMETRIC		
DRAWING NO.	REFERENCE DRAWINGS	STAMPS APPLY TO CURRENT REVISION ONLY				REV.	DESCRIPTION	JOB No.	DATE	BY	CHK	PE	CLIENT DRAWING NO. -		DRAWING NO. G02-1-PRD0154-E-HTI-01-P01-P0101-01		REV. 1			
						1	ISSUED FOR CONSTRUCTION WITH OPTION(S) 3, 9	2026.1111	2026.05.26	AUTO	AUTO	AUTO								
						0	ISSUED FOR CONSTRUCTION	2026.1111	2026.05.26	AUTO	AUTO	AUTO								