
ELECTRIC HEAT TRACING DESIGN DATA CHART

DISTRIBUTION PANEL AND CIRCUIT NUMBER	HEAT TRACE NUMBER	INSULATION			MINIMUM AMBIENT TEMPERATURE (°C)	START-UP AMBIENT TEMPERATURE (°C)	MAXIMUM EXPOSURE TEMPERATURE (°C)	MAINTAIN TEMPERATURE (°C)	HEATING CABLE TYPE	CABLE LENGTH (m)	SUPPLY VOLTAGE (V ac)	HEAT TRACE RATIO	CURRENT		WATTAGE		HEATER OUTPUT (W/m)	PIPE MATERIAL	HEAT LOSS (W/m)	ELECTRICAL CLASSIFICATION		
		THICKNESS (mm)	CODE	SIZE (mm)									OPERATING (A)	COLD (A)	OPERATING (W)	COLD (W)				AREA	TEMPERATURE CODE or AUTOIGNITION TEMPERATURE	HIGH LIMIT SET POINT (°C)
HTPI01-CCT7/21 HOLD	HT-FG-P0106-1A	38	MF	32	-40	-40	100	10	HTSX-6-1-0J	9.5	120	1	9.2	14	1103	1680	19.7	CS	17.4	ZONE 2	T2D	N/A
	HT-FG-P0106-1B	38	MF	32	-40	-40	100	10	HTSX 6-1-0J	12.1												
	HT-FG-P0107-1	38	MF	32	-40	-40	100	10	HTSX 6-1-0J	8.8												

N

MODULE NORTH

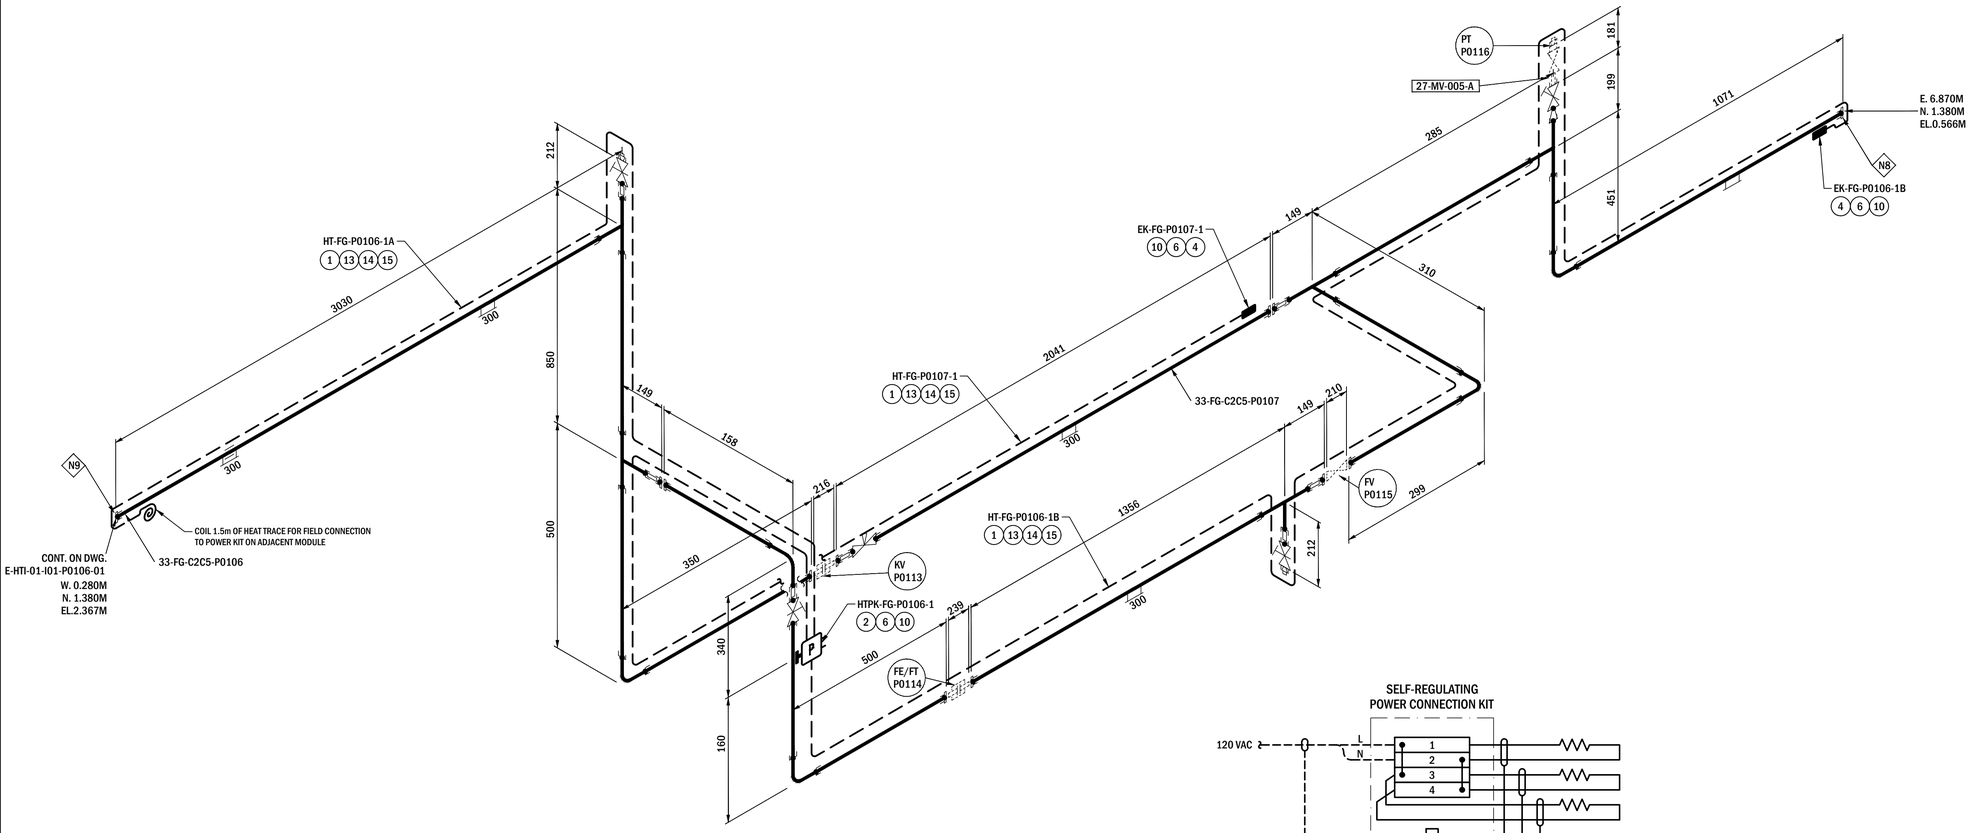

NOTES:

1. HEAT TRACE AND EQUIPMENT SHALL BE INSTALLED IN COMPLIANCE WITH THE CEC.
2. FIELD ELECTRICAL CONTRACTOR TO INSTALL HEAT TRACE AS PER MANUFACTURER RECOMMENDATION. HEAT TRACE CABLE LENGTHS TO BE FIELD VERIFIED.
3. HEAT TRACE POWER, RTD, SPLICE, AND END KITS SHALL BE IDENTIFIED WITH LAMICOID.
4. PIPE HEAT LOSS VALUES INCLUDE SAFETY FACTOR OF 20% FOR ALL LINES.
5. REFERENCE TABLE ONLY INCLUDES THE MOST COMMON INSTALLATION SCENARIOS. REFER TO HEAT TRACE INSTALLATION DETAILS DWG. E-STD-00-600 SERIES FOR FURTHER DETAILS.
6. HEAT TRACING TO BE INSTALLED USING ITEMS LISTED IN THE BILL OF MATERIALS.
7. ALLOWANCES SHOWN ARE PER VALVE, SUPPORT, AND FLANGE.
8. HEAT TRACE CALCULATION IS BASED ON CONTROLLED DESIGN.
9. COORDINATES ARE BASED ON MODULE DATUM.
10. AN ALLOWANCE OF 0.8m WAS INCLUDED FOR TERMINATIONS, AND AN ADDITIONAL 10% ALLOWANCE WAS APPLIED TO THE CALCULATED HEAT TRACE LENGTH.

DETAIL - THREE HEATERS (POWER T-SPLICE)

SHOP NOTES:

1. ALL ITEMS ON THIS MODULE (EXCLUDING MANUAL VALVES) INCLUDE THE TAG PREFIX XXXX.

BASE

INSTALLATION DETAIL REFERENCE TABLE (NOTE 5)

DETAIL	ITEM	DETAIL	ITEM
601	POWER KIT	611	FLANGE
602	SPLICE KIT	612	DRAIN
603	TEE SPLICE KIT	613	VALVE
604	LIGHTED END KIT	614	RELIEF VALVE
605	END SEAL	615	STRAINER
606	HT CABLE/RTD ORIENTATION	620	RTD
607	ELBOW	621	PIPE RACK MODULES - FLANGED CONNECTIONS
608	PIPE SHOE		
609	FREEZE PROTECTED PIPE ENTERING BUILDING		
610	UNDERGROUND PIPE		

BILL OF MATERIALS (BASED ON THERMON PRODUCTS)

ITEM	QUANTITY	CATALOG NUMBER	DESCRIPTION
1	31 m	HTSX SERIES	SELF-REGULATING HEATER WITH BRAID AND OVERJACKET
2	1	DP	TERMINATOR POWER CONNECTION/TEE KIT - PIPE MOUNT
3	1	DS/DE	TERMINATOR IN-LINE SPLICE/END KIT - PIPE MOUNT
4	2	DL	TERMINATOR LIGHTED POWER CONNECTION/END KIT - PIPE MOUNT
5	-	DE-B	TERMINATOR LIGHTED END KIT - PIPE MOUNT
6	3	PETK-2D	CIRCUIT FABRICATION KIT
7	1	SCTK-2D	SPLICE CONNECTION/TERMINATION KIT
8	-	RTD-100-KIT	100 OHM PLATINUM RTD PIPE MOUNT
9	-	E7-25325	THERMOSTAT, PIPEWALL SENSING, -4 °C TO 163 °C ADJUSTMENT RANGE
10	4	B-4	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 4" (100 mm) DIAMETER
11	-	B-10	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 10" (250 mm) DIAMETER
12	-	B-21	STAINLESS STEEL BANDING CLAMP, FOR LINES UP TO 21" (530 mm) DIAMETER
13	AS REQ'D	FF-1H	FIXING TAPE, FIBERGLASS 12 mm x 33 m (1/2" x 180') ROLL
14	AS REQ'D	CL	CAUTION LABEL (ENGLISH), 25 PER PACKAGE
15	AS REQ'D	AL-20H	ALUMINUM TAPE, 50 mm x 55 mm (2" x 180')
16			
17			
18			

VALVE ALLOWANCES (NOTE 7)

PIPE DIA.	TYPE	QTY.	ALLOW. EACH (m)
33	FLANGED	3	0.61
33	SOCKET WELDED	5	0.30

OTHER ALLOWANCES (NOTE 7)

SIZE/ TYPE	DESCRIPTION	QTY.	ALLOW. EACH (m)
33	FLANGE	6	0.23
300	PIPE SHOE	4	0.90

ENGINEERING NOTES:

1. THIS DRAWING REFERENCES THE ENGINEERING RECORD G02-1-PRDXXXX-E-HTI-01-P01-P0106-01 REV 0 FOR ALL TECHNICAL INFORMATION. IN THE EVENT OF DISCREPANCY BETWEEN THIS DRAWING AND THE ENGINEERED DRAWING OF RECORD, THE ENGINEERED DRAWING OF RECORD WILL TAKE PRECEDENCE UNLESS THE CHANGE IS PROPERLY CLOUDED AS A REVISION TO THIS DRAWING AND STAMPED BY A PROFESSIONAL ENGINEER.

LEGEND

PIPE — HEAT TRACE CABLE — P POWER CONNECTION KIT — S SPLICE KIT — QUICK CONNECT — COLD LEAD CONNECTION — END SEAL — LIGHTED END SEAL — RTD XXX RTD SENSOR — T PIPE SENSING THERMOSTAT — PIPE SUPPORT

REF. NO. 33-FG-C2C5-P0106/33-FG-C2C5-P0107

DRAWING NO.	REFERENCE DRAWINGS

STAMPS APPLY TO CURRENT REVISION ONLY

SCOVAN INC.
2026.05.26
ISSUED FOR CONSTRUCTION

REV.	DESCRIPTION	JOB No.	DATE	BY	CHK	PE
1	ISSUED FOR CONSTRUCTION WITH OPTION(S) 3, 9	2026.1111	2026.05.26	AUTO	AUTO	AUTO
0	ISSUED FOR CONSTRUCTION	2026.1111	2026.05.26	AUTO	AUTO	AUTO

PadX PARTNERSHIP
Scovan

PADX
NEXT GENERATION ENERGY SOLUTIONS
PRODUCTION MODULE (MOD-01-P01)
HEAT TRACE ISOMETRIC

CLIENT DRAWING NO.	DRAWING NO.	REV.
-	G02-1-PRD0154-E-HTI-01-P01-P0106-01	1

DWG Path: C:\DAROOT\JOBS\E2507CB5277F499C9EAA5F1520517B33 PLOTTED BY: ACESUSER Plot Date: May 26, 26 @ 06:47 PM
THIS DOCUMENT'S USE IS CONDITIONED UPON THE USER'S AGREEMENT NOT TO USE, DISCLOSE OR OTHERWISE DISSEMINATE DOCUMENT, IN WHOLE OR IN PART, FOR ANY PURPOSE EXCEPT AS SPECIFICALLY INTENDED BY SCOVAN INC. ANY PRINTED VERSION OF THIS DOCUMENT IS A COPY AND IS NOT A REPRESENTATION OF THE ORIGINALLY AUTHENTICATED DOCUMENT.