
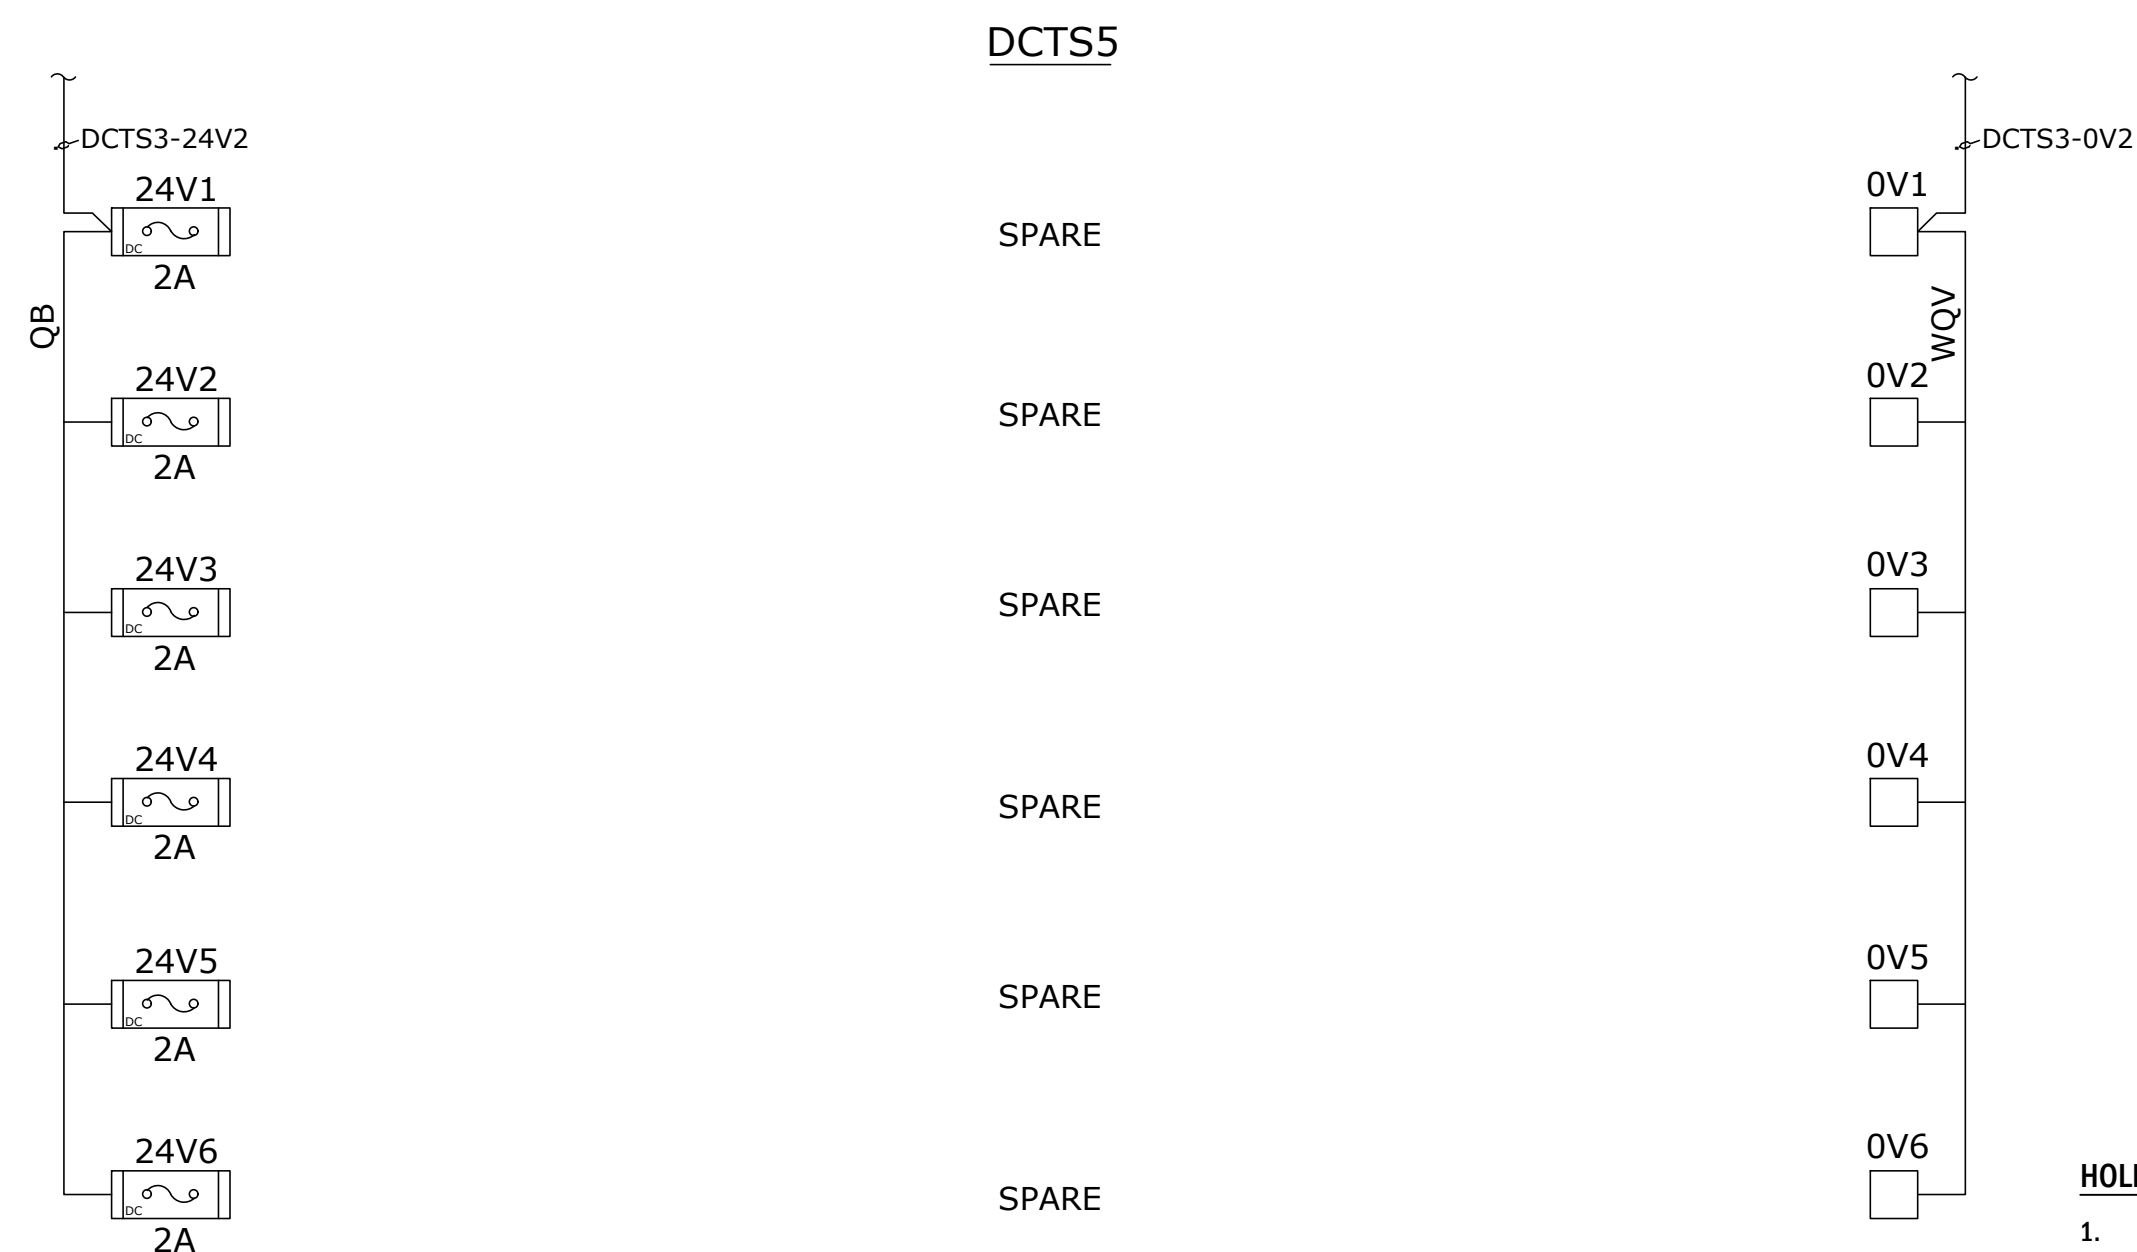
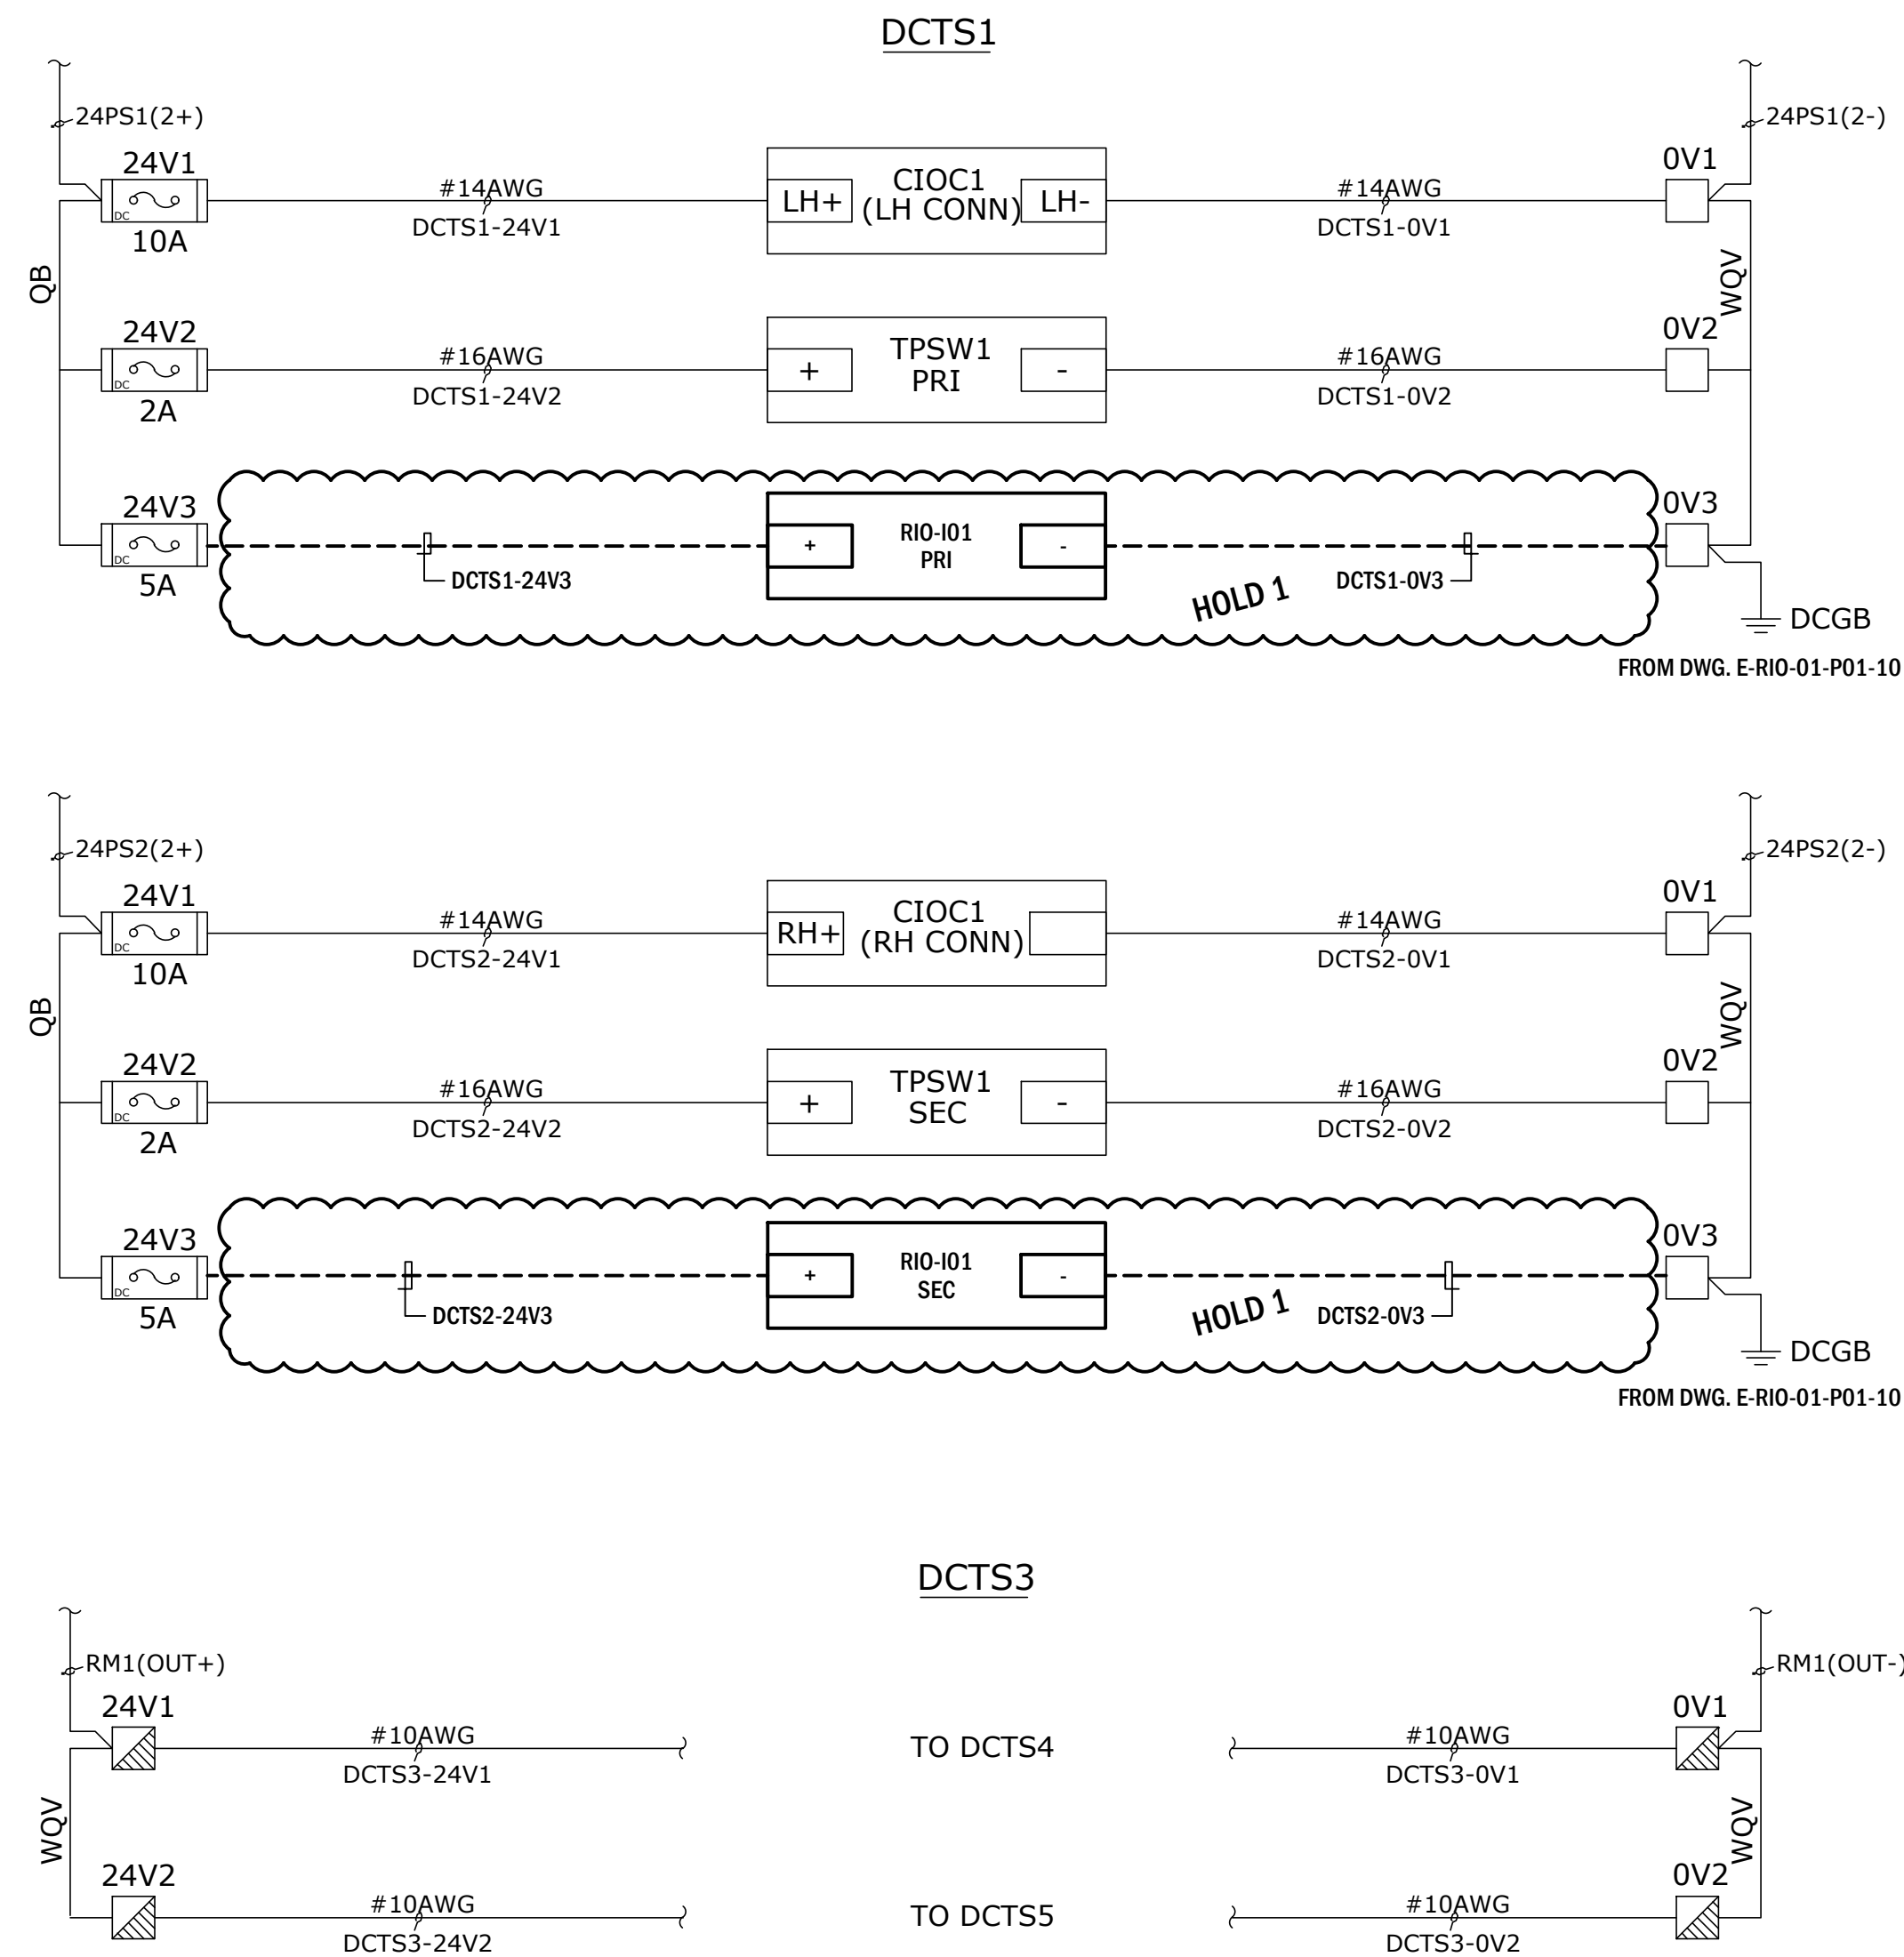


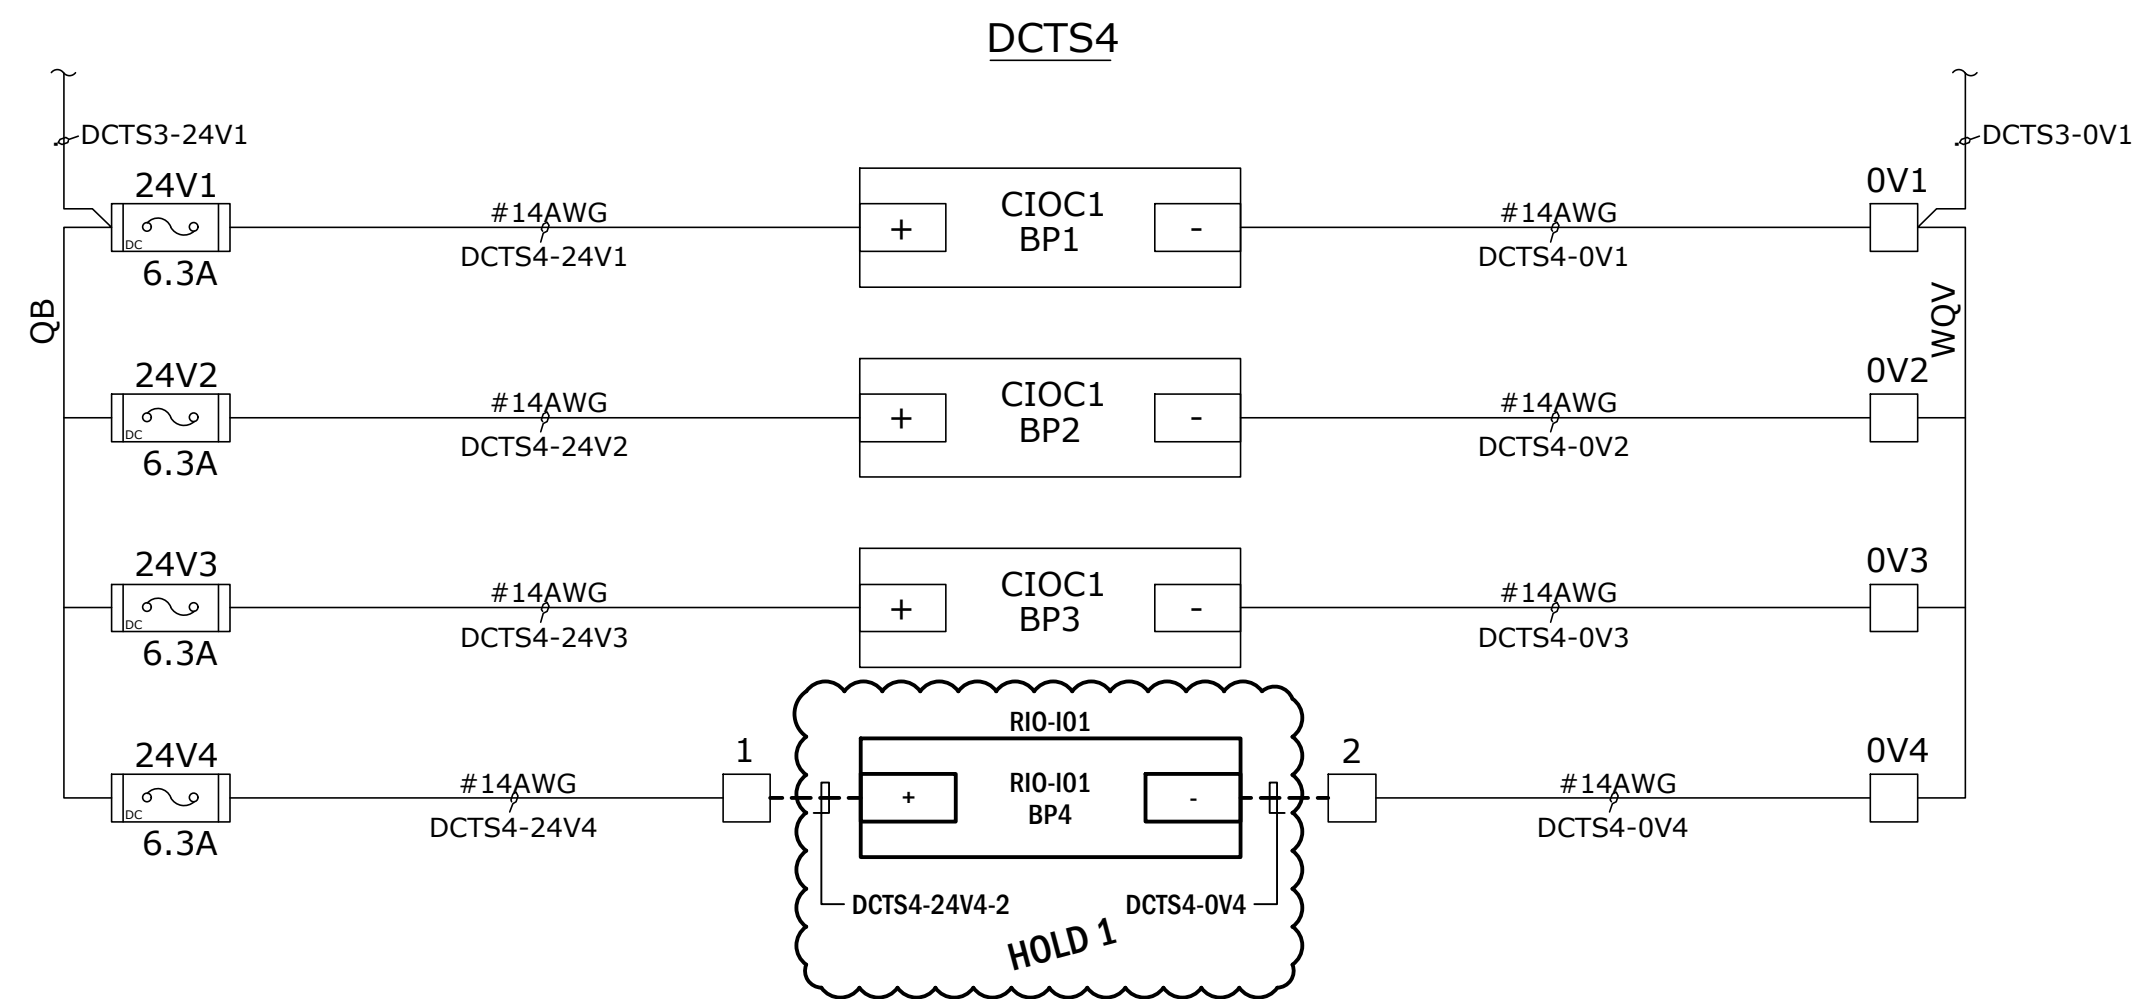

NOTES:

1 USE FERRULE AT ALL WIRE TERMINALS.

REDRAWN FROM SPARTAN
VENDOR DRAWING PACKAGE
DV-54809-ZX-510-00 REV 0

DWG Path: R:\01 - SCOVAN\11 - PADX 2.0\100 - WELL PAD\E - ELECTRICAL\RIO - REMOTE INPUT AND OUTPUT PANEL\AREA 01

PLOTTED BY: ACESUSER

Plot Date: "March 06, 26 @ 02:54 PM"

THIS DOCUMENT'S USE IS CONDITIONED UPON THE USER'S AGREEMENT NOT TO USE, DISCLOSE OR OTHERWISE DISSEMINATE DOCUMENT, IN WHOLE OR IN PART, FOR ANY PURPOSE EXCEPT AS SPECIFICALLY INTENDED BY SCOVAN INC. ANY PRINTED VERSION OF THIS DOCUMENT IS A COPY AND IS NOT A REPRESENTATION OF THE ORIGINALLY AUTHENTICATED DOCUMENT.