




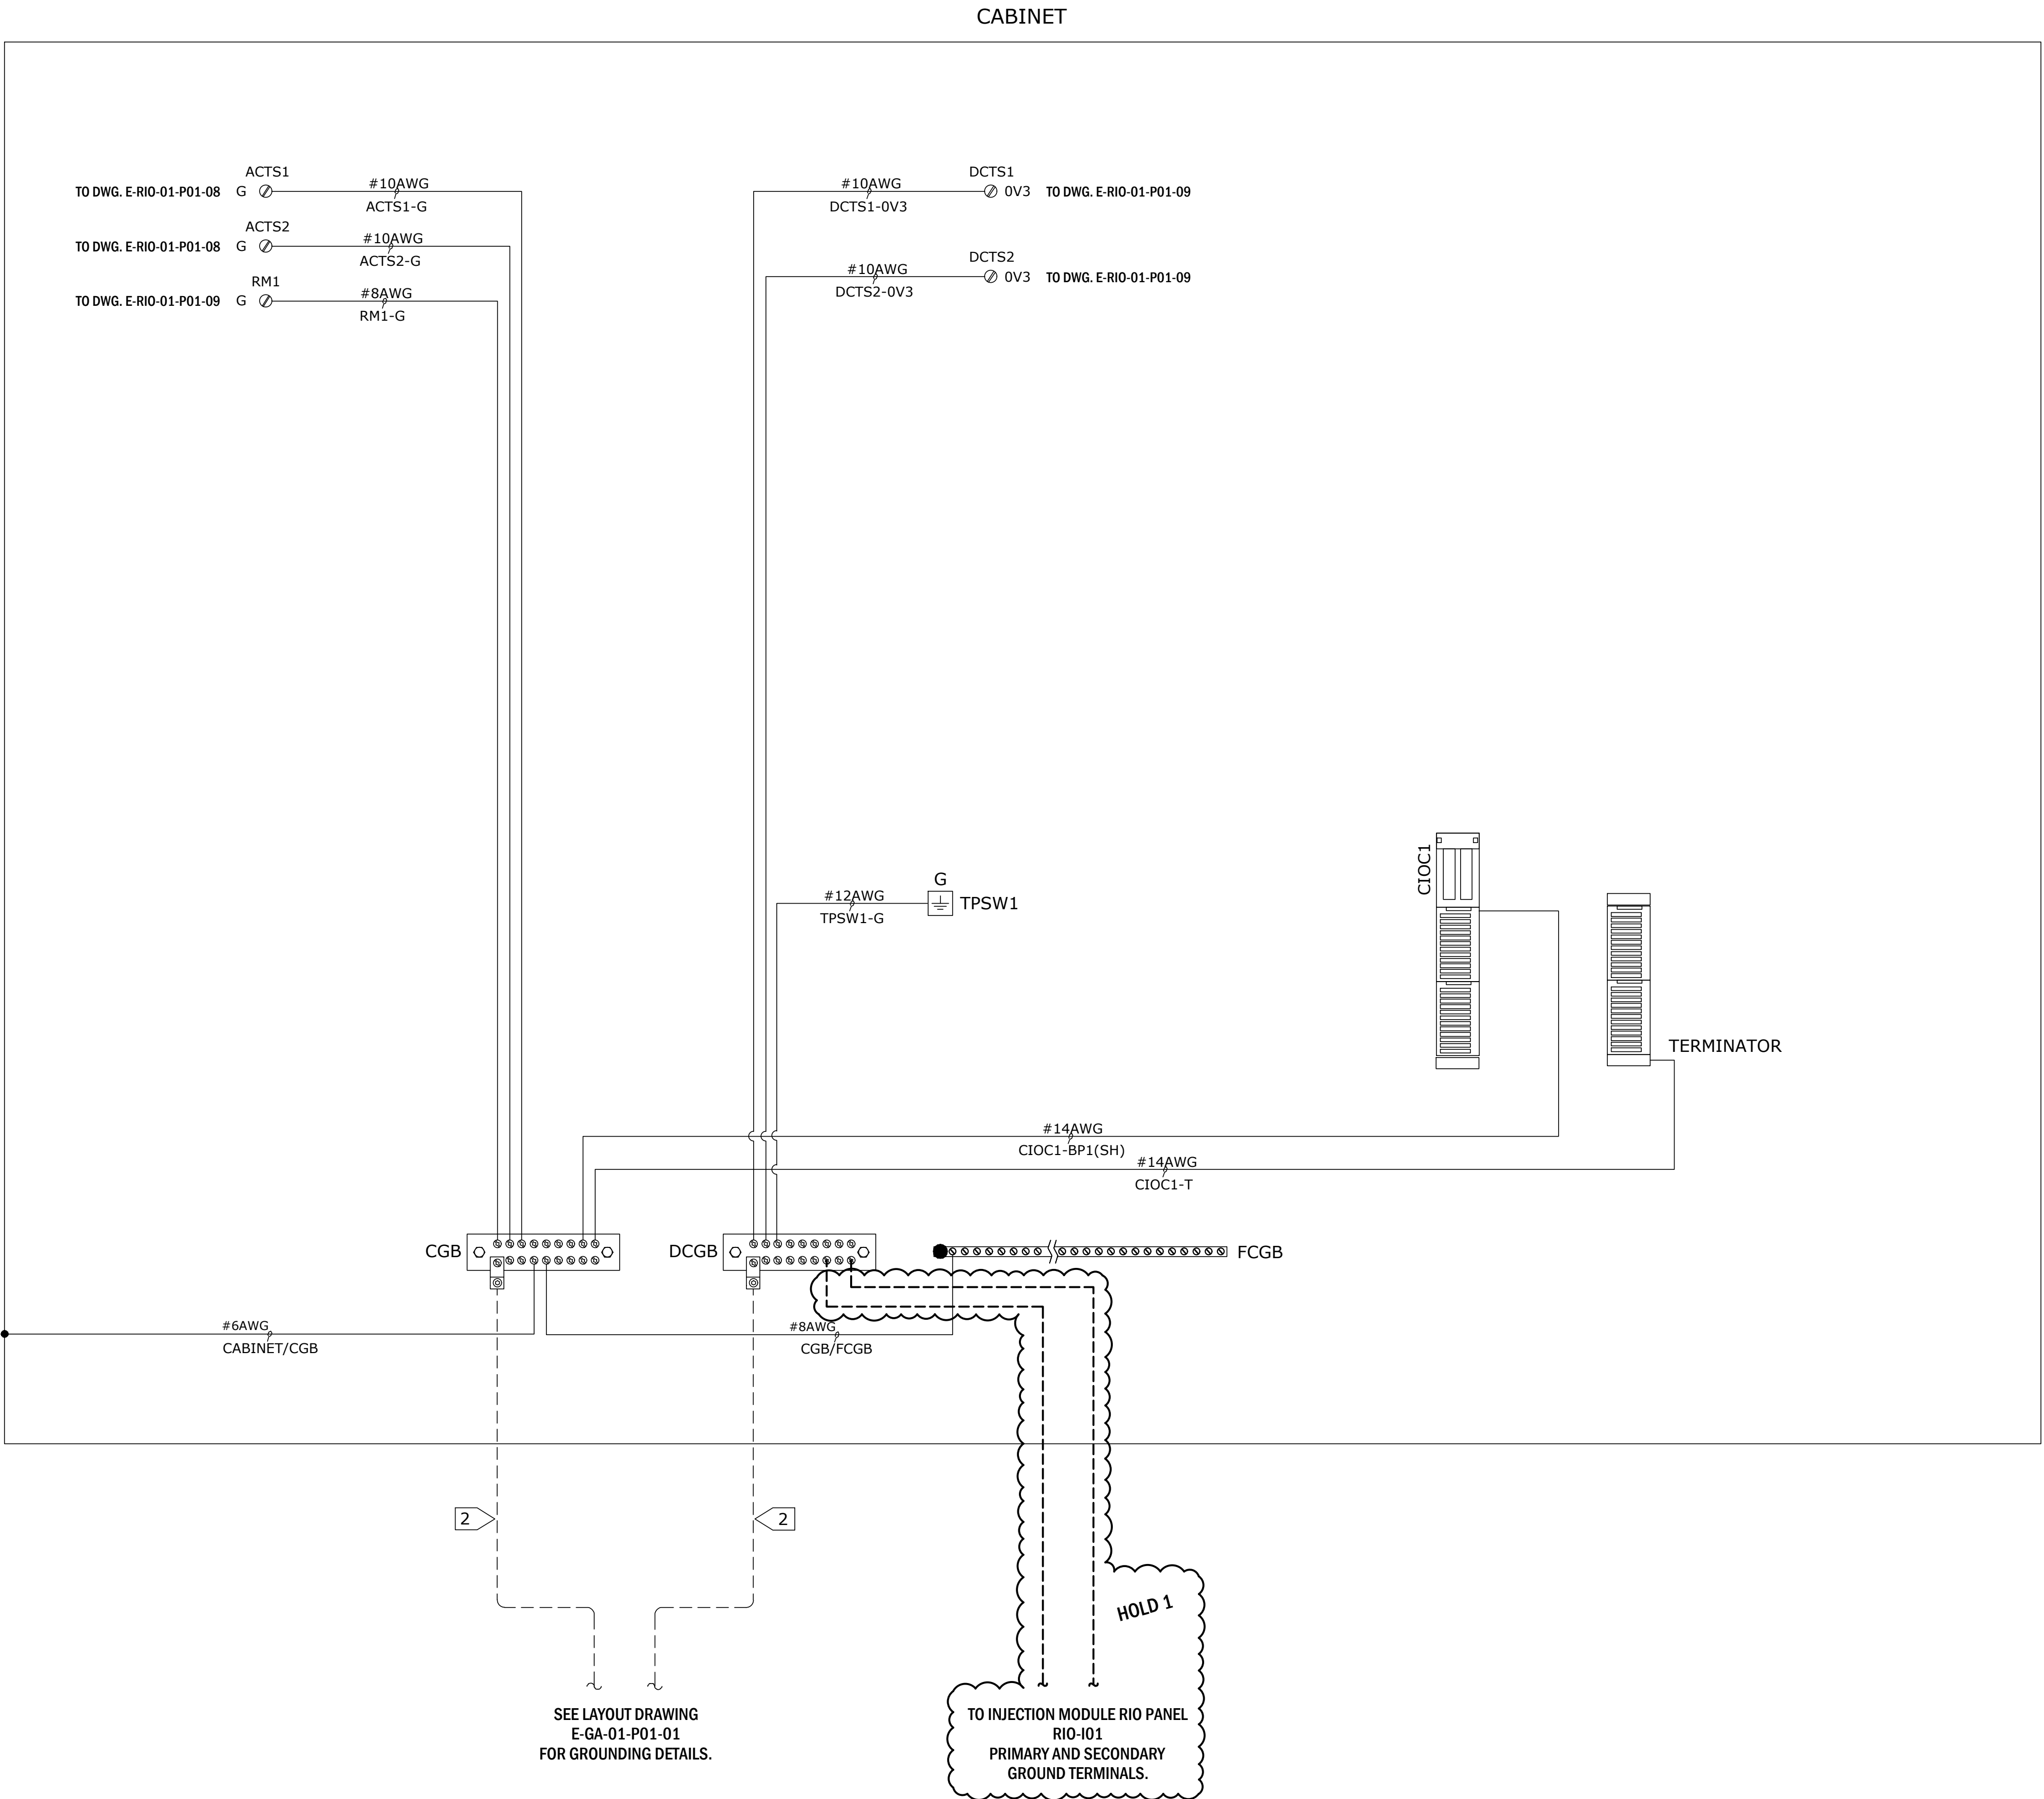

CIOC/CSLS BOTTOM TERMINATOR GROUND CONNECTION DETAIL

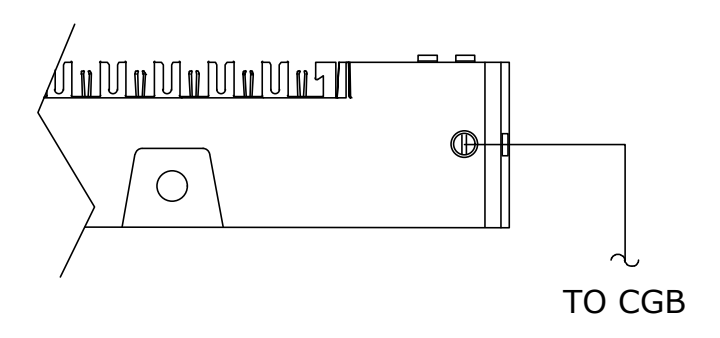

CIOC/CSLS BASEPLATE GROUND CONNECTION DETAIL

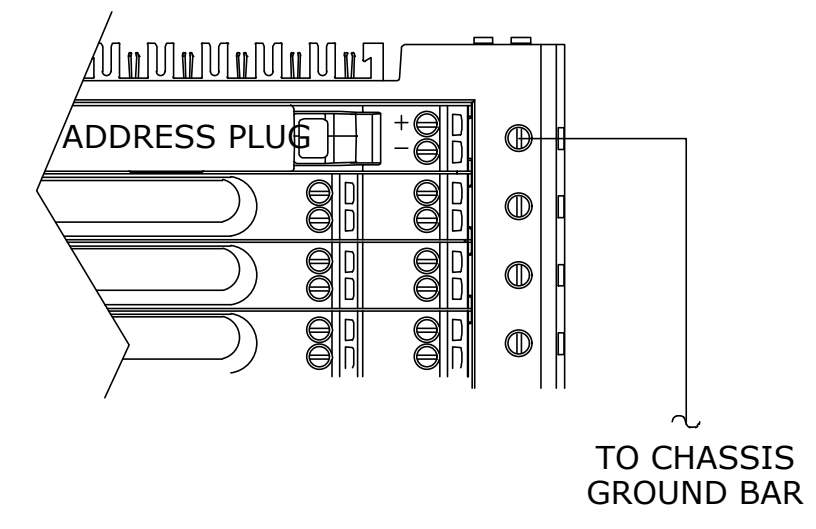

- HOLDS:**
- LIGHTING INTERCONNECTING CABLE TO I01 TO BE DETERMINED BY SITE SPECIFIC ENGINEERING.
- SHOP NOTES:**
- ALL ITEMS ON THIS MODULE (EXCLUDING MANUAL VALVES) INCLUDE THE TAG PREFIX PRD0154.

ENGINEERING NOTES:

- THIS DRAWING REFERENCES THE ENGINEERING RECORD G02-1-PRDXXX-E-RIO-01-P01-10 REV 0 FOR ALL TECHNICAL INFORMATION. IN THE EVENT OF DISCREPANCY BETWEEN THIS DRAWING AND THE ENGINEERED DRAWING OF RECORD, THE ENGINEERED DRAWING OF RECORD WILL TAKE PRECEDENCE UNLESS THE CHANGE IS PROPERLY CLOUDED AS A REVISION TO THIS DRAWING AND STAMPED BY A PROFESSIONAL ENGINEER.

- NOTES:**
- ALL GROUND BARS MOUNTED USING ISOLATING STANDOFFS TO FACILITATE GROUND SYSTEM TESTING.
 - THE TABLE SHOWS APPROPRIATE WIRE SIZE WITH RESPECT TO THE DISTANCE BETWEEN A CABINET AND THE CLOSEST GROUND BAR OR BETWEEN INDIVIDUAL GROUND BARS. CABLE SIZES ARE DETERMINED BASED ON THE NUMBER OF I/O POINTS ASSOCIATED WITH THAT PARTICULAR SECTION OF CABLE. THE OVERALL DISTANCE FROM AN ENCLOSURE TO THE EARTHING POINT AT THE DELTAV INSTRUMENT GROUND (DIG) SHOULD NOT EXCEED 300 FEET.
 - ALL CABINET STEEL COMPONENTS TO BE BONDED TO CABINET FRAME USING #6 AWG CONDUCTORS AND STAR WASHERS.
 - USE FERRULE AT ALL WIRE TERMINALS.

I/O POINTS	CABLE LENGTH - ft (m)				
	10' (3m)	25' (7.6m)	50' (15.2m)	100' (30.5m)	300' (91.4m)
64	8AWG /10mm²	8AWG /10mm²	8AWG /10mm²	6AWG /16mm²	2AWG/35mm²

REDRAWN FROM SPARTAN
VENDOR DRAWING PACKAGE
DV-54809-ZX-550-00 REV 0

		SCOVAN INC. 2026.05.26 ISSUED FOR CONSTRUCTION									PadX PARTNERSHIP Scovan	PADX NEXT GENERATION ENERGY SOLUTIONS PRODUCTION MODULE (MOD-01-P01) REMOTE I/O PANEL RIO-P01 DC POWER DISTRIBUTION				
			1	ISSUED FOR CONSTRUCTION WITH OPTION(S) 3, 9			2026.1111	2026.05.26	AUTO	AUTO					AUTO	
			0	ISSUED FOR CONSTRUCTION			2026.1111	2026.05.26	AUTO	AUTO		AUTO				
DRAWING NO.	REFERENCE DRAWINGS		STAMPS APPLY TO CURRENT REVISION ONLY			REV.	DESCRIPTION			JOB No.		DATE	BY	CHK	PE	CLIENT DRAWING NO.
														-	G02-1-PRD0154-E-RIO-01-P01-10	1