

750XCXH RELAY PIN DETAILS




1. GROUND CABLE TO BE DETERMINED BY SITE SPECIFIC ENGINEERING.

SHOP NOTES:

1. ALL ITEMS ON THIS MODULE (EXCLUDING MANUAL VALVES) INCLUDE THE TAG PREFIX PRD0154.


ENGINEERING NOTES:

1. THIS DRAWING REFERENCES THE ENGINEERING RECORD G02-1-PRDXXX-E-RIO-01-P01-11 REV 0 FOR ALL TECHNICAL INFORMATION. IN THE EVENT OF DISCREPANCY BETWEEN THIS DRAWING AND THE ENGINEERED DRAWING OF RECORD, THE ENGINEERED DRAWING OF RECORD WILL TAKE PRECEDENCE UNLESS THE CHANGE IS PROPERLY CLOUDED AS A REVISION TO THIS DRAWING AND STAMPED BY A PROFESSIONAL ENGINEER.

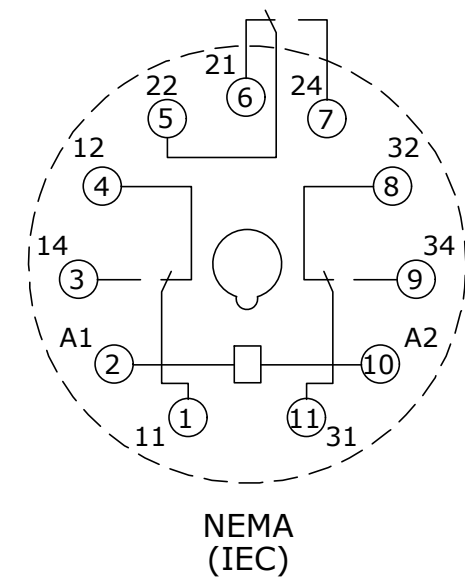

NOTES:

- 1 ALL CONTACTS SHOWN IN SHELF/ALARM STATE; OPEN CONTACTS WILL BE CLOSED UNDER NORMAL OPERATING CONDITIONS.
- 2 WEIDMULLER WQV SCREW-IN CROSS-CONNECTION
- 3 ESD RELAY CONTACTS RATED FOR 12A
- 4 THE TERMINAL BLOCKS FOR FIELD NEUTRALS WIRING ONLY
- 5 USE FERRULE AT ALL WIRE TERMINALS.

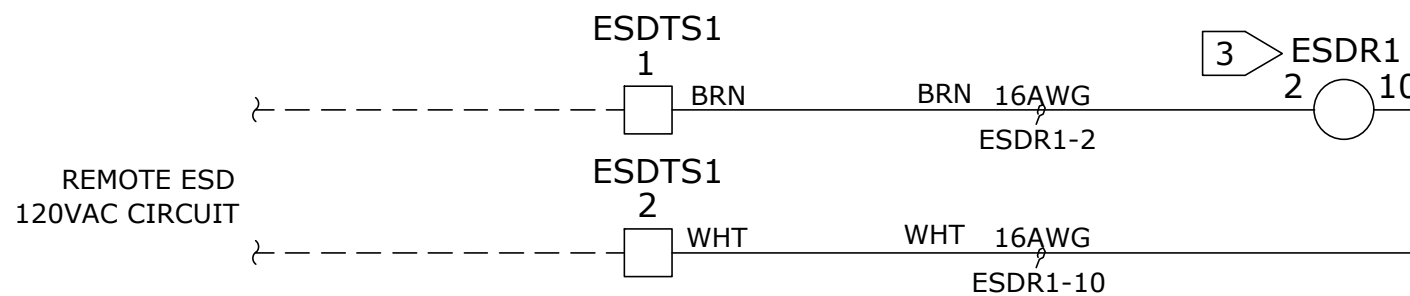

REDRAWN FROM SPARTAN
VENDOR DRAWING PACKAGE
DV-54809-ZX-560-00 REV 0