
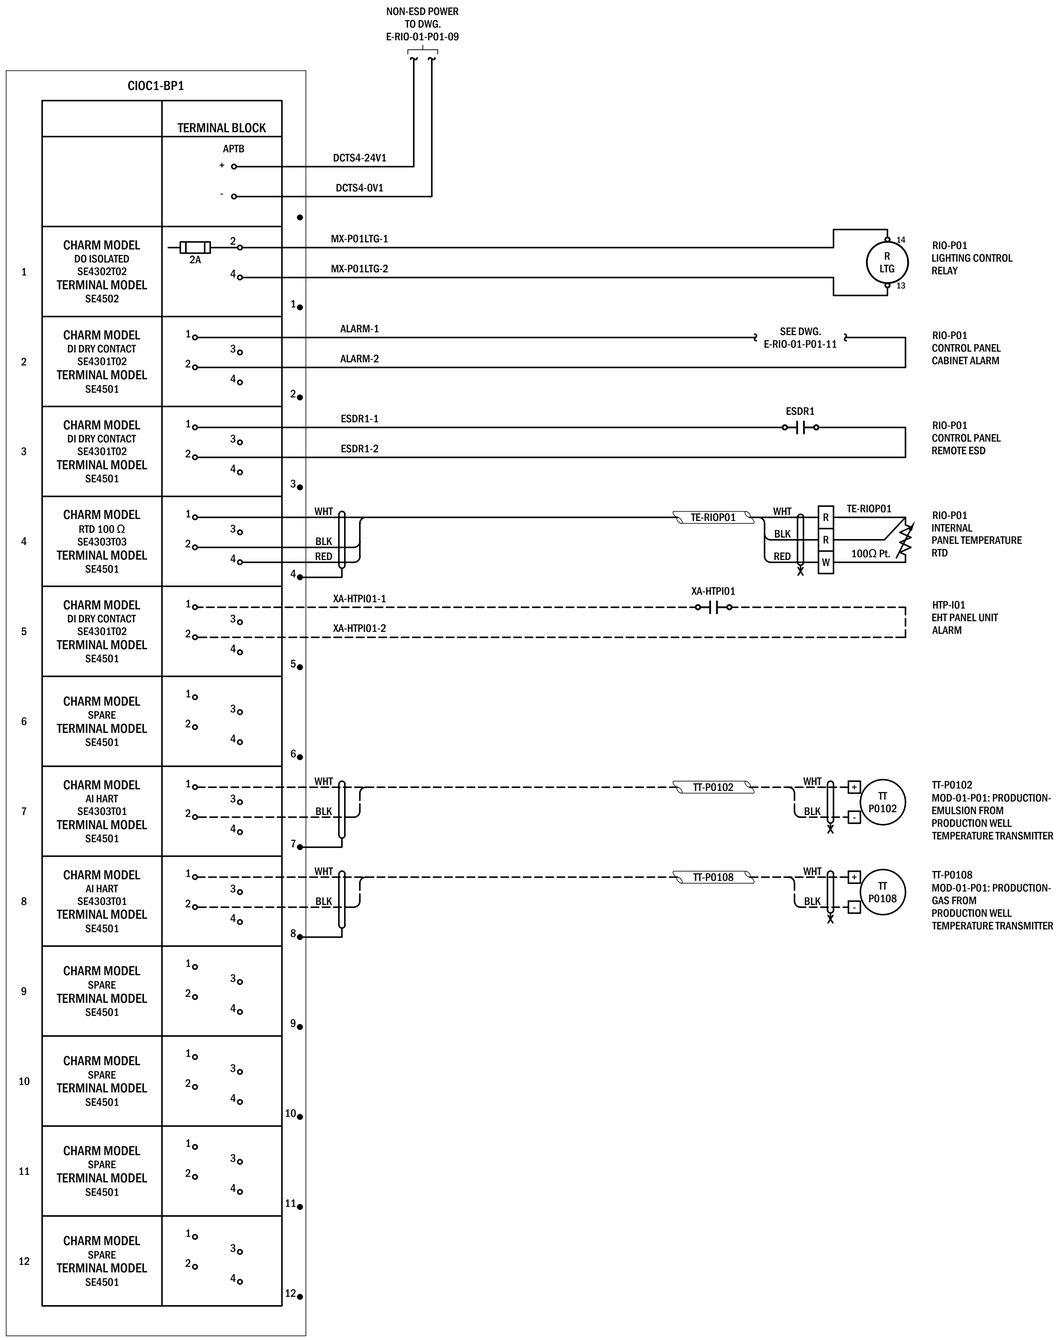


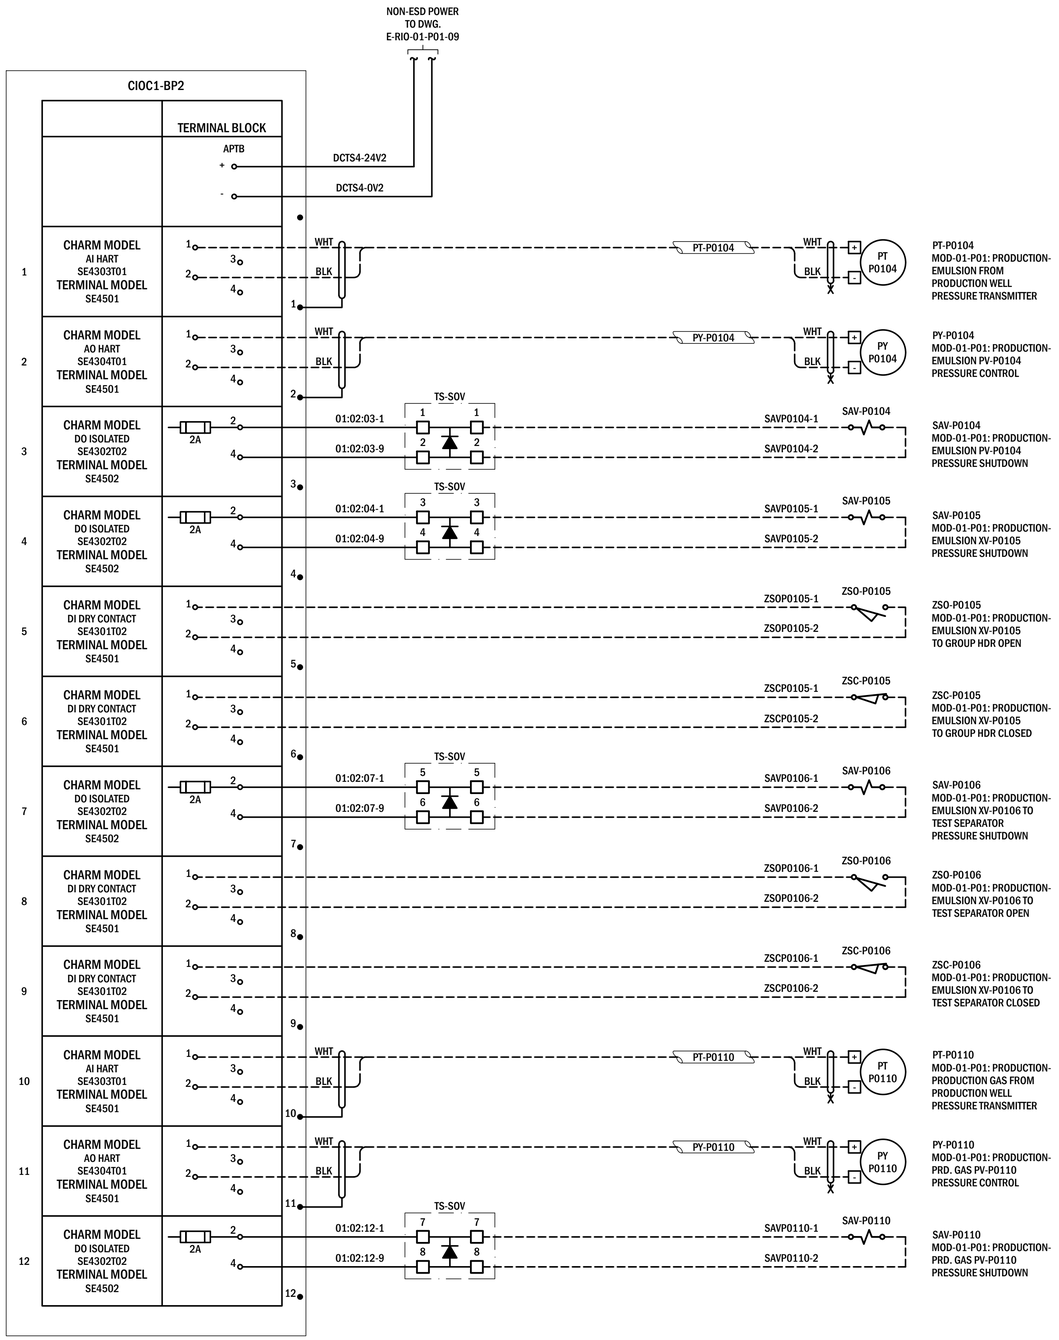

TERMINAL LEGEND

CONTROL PANEL

- FUSED TERMINAL c/w LED & GROUND TERMINAL
- D DISCONNECT TERMINAL
- FEED THROUGH TERMINAL
- MCC TERMINAL
- CONTACTOR PANEL TERMINAL
- VENDOR TERMINAL
- FIELD JUNCTION BOX TERMINAL

SHOP NOTES:

1. ALL ITEMS ON THIS MODULE (EXCLUDING MANUAL VALVES) INCLUDE THE TAG PREFIX PRD0154.

ENGINEERING NOTES:

1. THIS DRAWING REFERENCES THE ENGINEERING RECORD G02-1-PRDXXXX-E-RIO-01-P01-13 REV 0 FOR ALL TECHNICAL INFORMATION. IN THE EVENT OF DISCREPANCY BETWEEN THIS DRAWING AND THE ENGINEERED DRAWING OF RECORD, THE ENGINEERED DRAWING OF RECORD WILL TAKE PRECEDENCE UNLESS THE CHANGE IS PROPERLY CLOUDED AS A REVISION TO THIS DRAWING AND STAMPED BY A PROFESSIONAL ENGINEER.

BASE

DRAWING NO.	REFERENCE DRAWINGS

STAMPS APPLY TO CURRENT REVISION ONLY

SCOVAN INC.
2026.05.26
ISSUED FOR CONSTRUCTION

REV.	DESCRIPTION	JOB No.	DATE	BY	CHK	PE
1	ISSUED FOR CONSTRUCTION WITH OPTION(S) 3, 9	2026.1111	2026.05.26	AUTO	AUTO	AUTO
0	ISSUED FOR CONSTRUCTION	2026.1111	2026.05.26	AUTO	AUTO	AUTO

PadX PARTNERSHIP
Scovan

PADX
NEXT GENERATION ENERGY SOLUTIONS
PRODUCTION MODULE (MOD-01-P01)
REMOTE I/O PANEL RIO-P01 CIOC1-BP1 & 2 I/O SCHEMATICS

CLIENT DRAWING NO.	DRAWING NO.	REV.
-	G02-1-PRD0154-E-RIO-01-P01-13	1

DWG Path: R:\01 - SCOVAN\11 - PADX 2.0\100 - WELL PAD\E - ELECTRICAL\RIO - REMOTE INPUT AND OUTPUT PANEL\AREA 01
PLOTTED BY: ACESUSER
Plot Date: "March 06, 26 @ 02:55 PM"
THIS DOCUMENT'S USE IS CONDITIONED UPON THE USER'S AGREEMENT NOT TO USE, DISCLOSE OR OTHERWISE DISSEMINATE DOCUMENT, IN WHOLE OR IN PART, FOR ANY PURPOSE EXCEPT AS SPECIFICALLY INTENDED BY SCOVAN INC. ANY PRINTED VERSION OF THIS DOCUMENT IS A COPY AND IS NOT A REPRESENTATION OF THE ORIGINALLY AUTHENTICATED DOCUMENT.