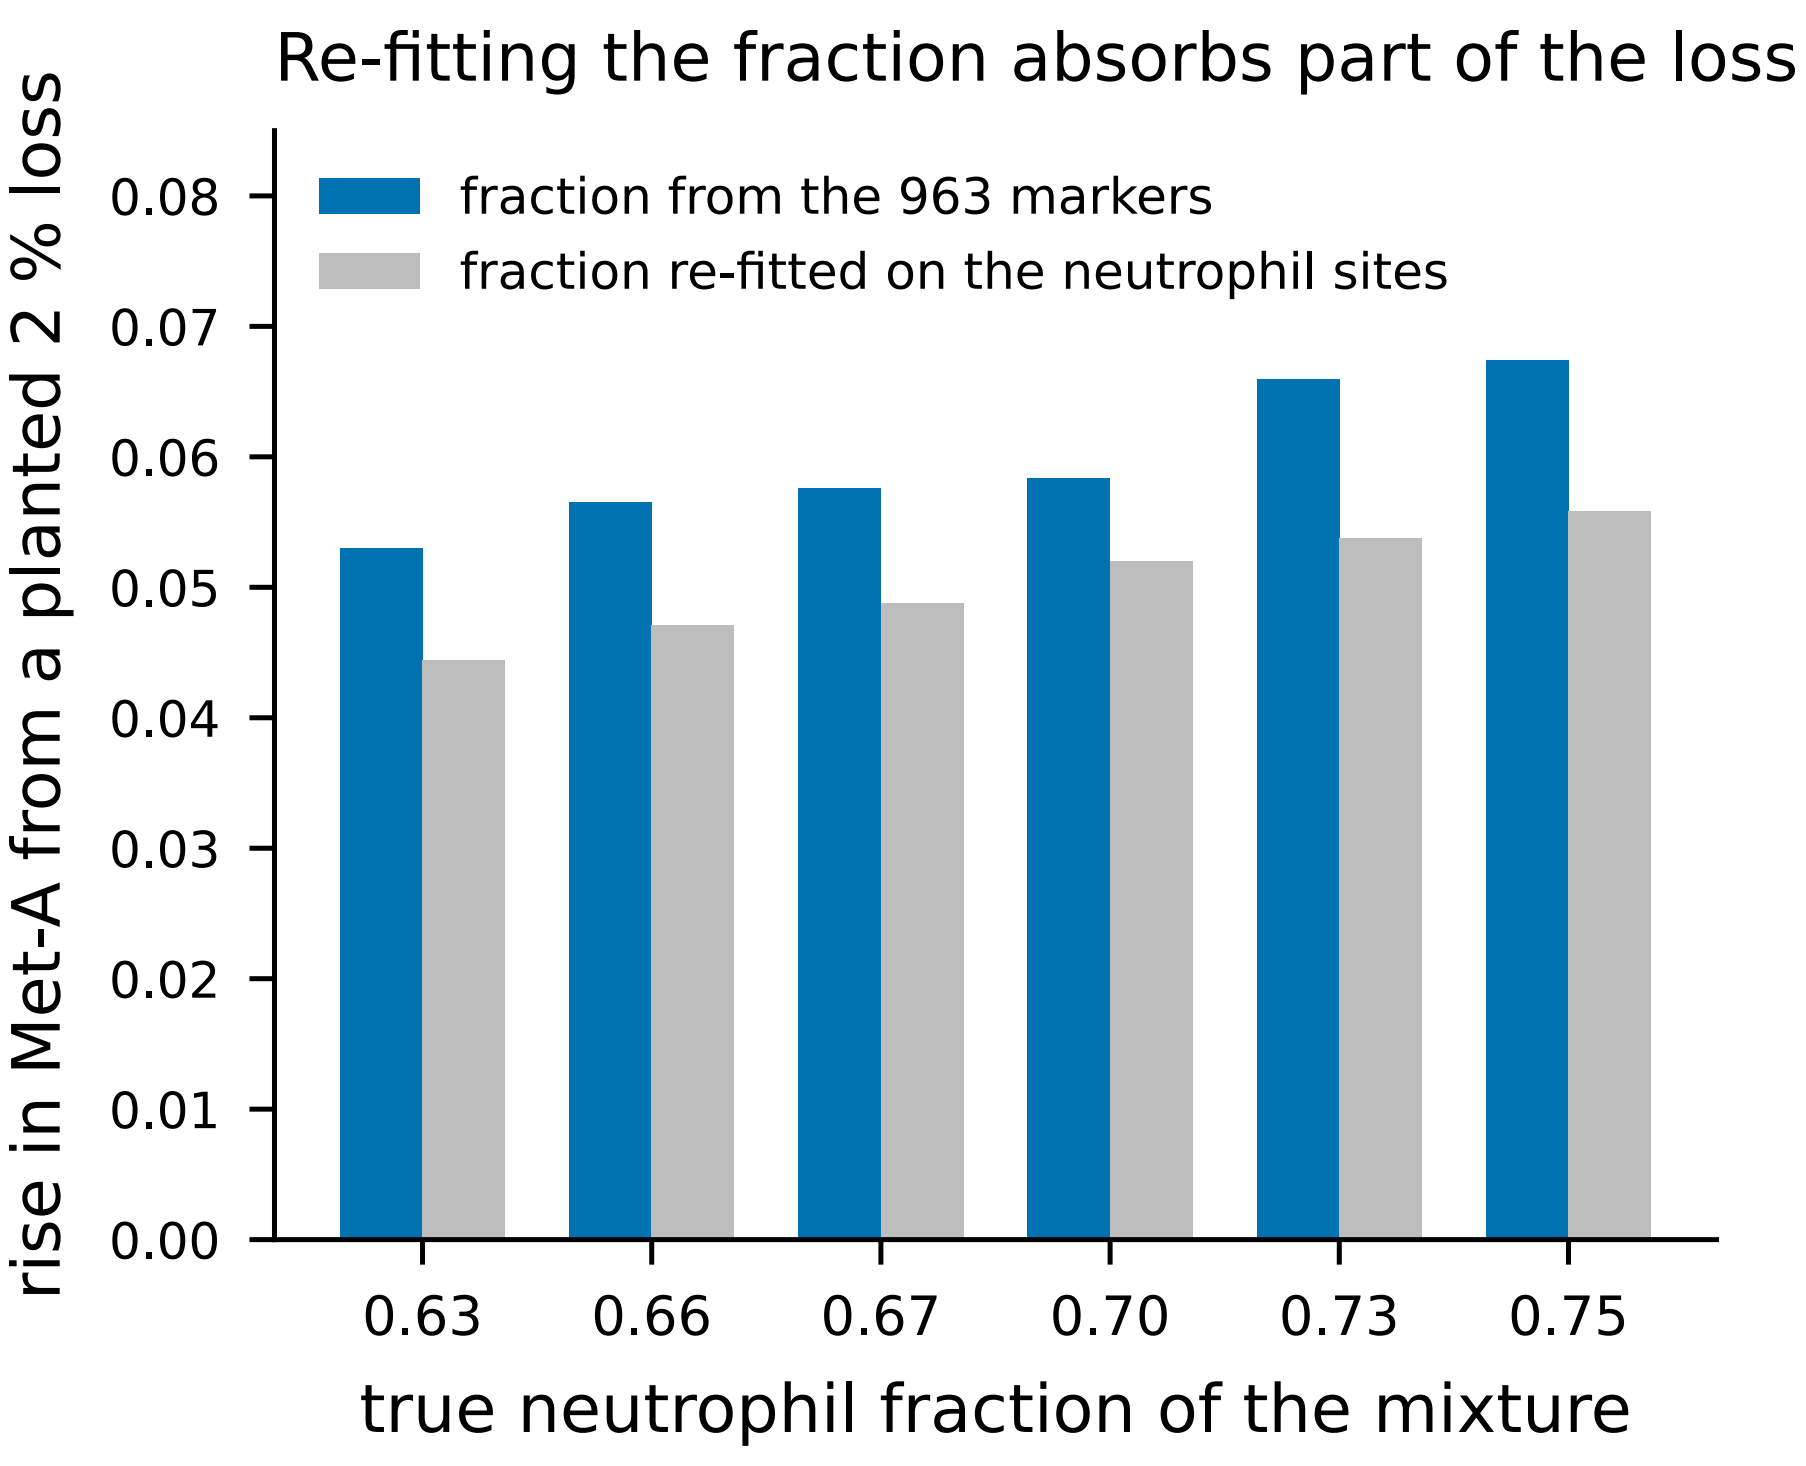
Re-fitting the fraction absorbs part of the loss
fraction from the 963 markers
fraction re-fitted on the neutrophil sites
rise in Met-A from a planted 2 % loss
0.00
0.01
0.02
0.03
0.04
0.05
0.06
0.07
0.08
0.63
0.66
0.67
0.70
0.73
0.75
true neutrophil fraction of the mixture